

# AMBERWOOD

3-5 Bedrooms | 2.5-3 Bathrooms | 2,323+ sq. ft.

Pulte Planning Center® | Ranch-Style Floorplan | Large, Eat-In Island






## Amberwood Home Exteriors

---




Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on Pulte.com.

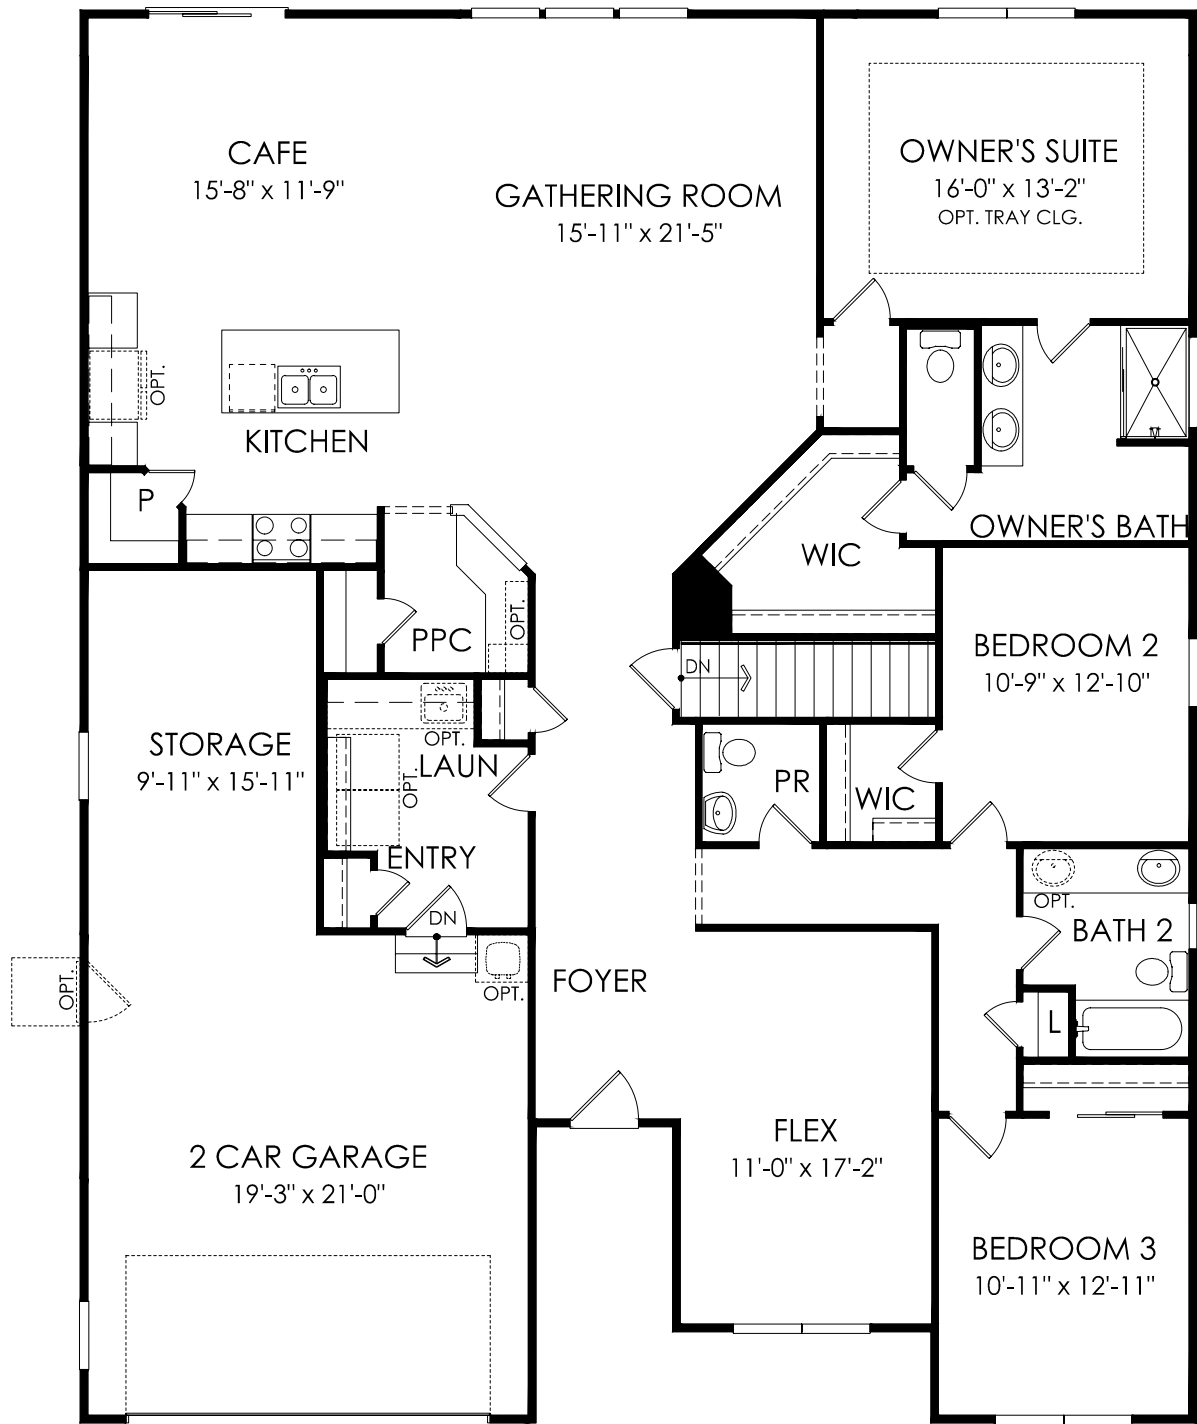

### GENERAL SPECIFICATIONS

41. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE.
42. ALL NON-BEARING WALLS TO BE 2x4 STUDS AT 24" O.C. KITCHEN AND KILN PLANNING CENTER WALLS, WHERE CABSINETS ARE TO BE HUNG, SHALL BE FRAMED AT 16" O.C.
43. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
44. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
45. PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OR STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
46. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLASS BEARING THE MANUFACTURER'S NAME, THE GLASS TYPE, AND THE THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
47. ALL BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
48. PROVIDE 1/2" MAX. SHEATHING ON TAPERED JOINTS AS DRAFT STOP WITH BATT INSULATION FILLING ALL CAVITIES AT WALLS ADJACENT TO TUBS AND SHOWERS.
49. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
50. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL PROVIDE SUPPORT AT LEAST ONE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHTS OF 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
51. BASEMENTS, HABITABLE ATTICS AND ALL SLEEPING ROOMS MUST HAVE AT LEAST ONE EMERGENCY ESCAPE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. THE EMERGENCY ESCAPE MUST HAVE A 5/7 SIGHT GLASS OPENING AND A SILL SHOWING NO MORE THAN 4" ABOVE FINISHED FLOOR. EMERGENCY ESCAPES OF GRADE LEVEL MUST HAVE A MIN. OF 5.0' OF OPEN AREA. REQUIRED CLEAR OPENINGS SHALL BE A MINIMUM OF 20" HIGH AND 20" WIDE. EMERGENCY ESCAPES WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GRADE MUST HAVE A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
52. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES



SCALE: 1/4" = 1'-0"

(c) Copyright 2013 Pearson Group, Inc.

**Midwest Zone Office**  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



## First Floor Plan

## 4" Exterior Walls

PRODUCT MANAGER  
Nick Starkey  
INITIAL RELEASE  
DATE: 01/18/2019

[illegible]

## Single Family

SPECIFICATION LEVEL


AN NAME  
**Amberwood**  
C CHILD NUMBER  
**848.302**

EET	A1
	4-1.1



PLOTTED: November 14, 2019 / A3-CR2M 2FB.LDWG / Annie Lee


ROOF AREA: "A"  
3021 SQ. FT.

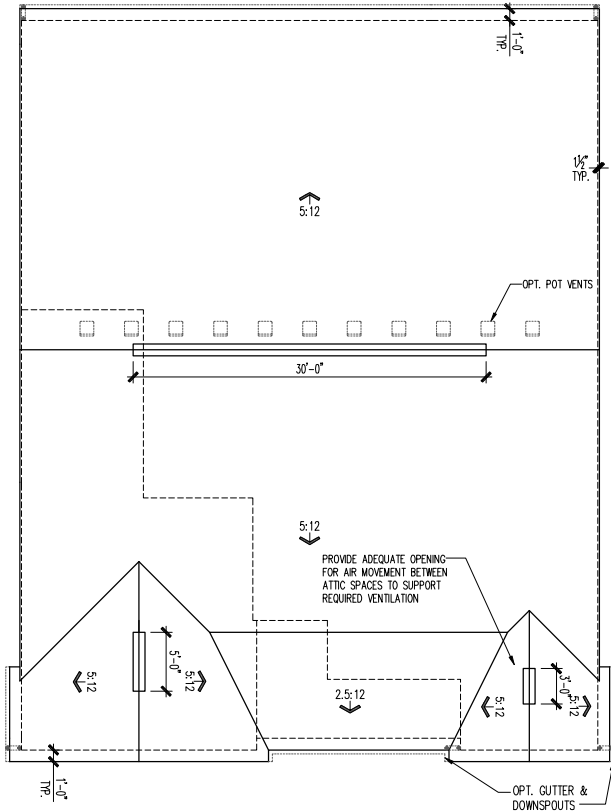


ROOF PLAN  
SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
Craftsman 2M									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON ROOF VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINUOUS INSULATION VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED ARE CAPABLE OPERATING TO MEET CODE REQUIREMENTS									
** SCHEDULE HAS BEEN CALCULATED ASSUMING ONE VENTILATION AT 20'-0" OF PITCH AND ONE AT 40'-0" OF TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FT.	SQ. FT.	PERCENT	POT LARGE	POT SMALL	ROOF VENT	EAVE VENT	CONG. VENT	
VENT TYPE	REQUIRED	SUPPLIED	OFFICIAL	PER AREA	PER AREA	PER AREA	PER AREA	PER AREA	
ROOF VENT ONLY	4.03	5.04	4.46	46.34	11	0			
AT EAVE	6.04	5.04	5.42	63.76			0	78.00	
TOTAL	10.07	10.07	10.08	100.00					
ROOF VENT ONLY	4.03	5.04	4.75	46.72	0	0	38.00		
AT EAVE	6.04	5.04	5.42	63.28			0	78.00	
TOTAL	10.07	10.07	10.17	100.00					


ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AREA AVAILABLE




SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS  
1/4" = 1'-0"

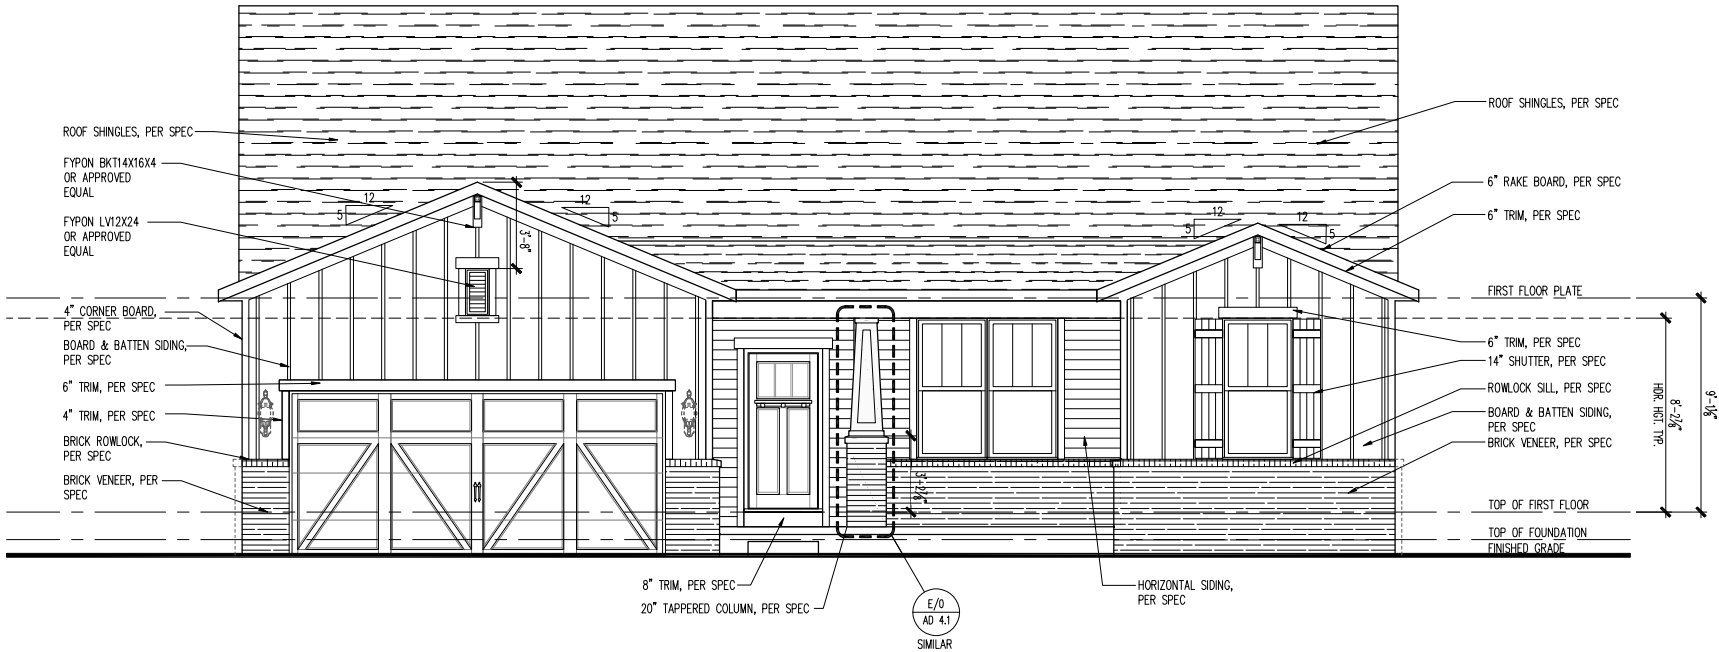


FRONT ELEVATION  
SCALE: 1/4" = 1'-0"

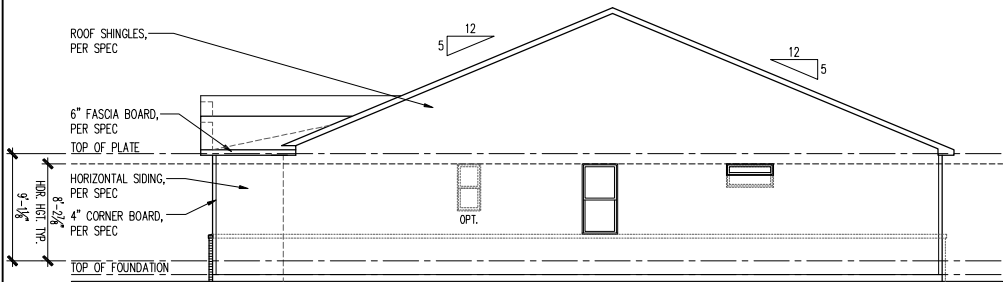

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

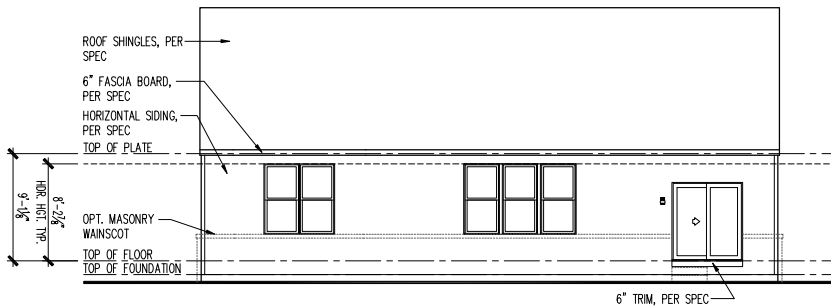

REAR ELEVATION  
SCALE: 1/8" = 1'-0"

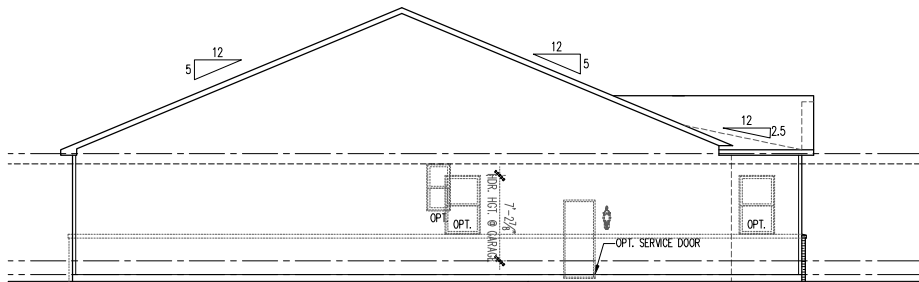

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry

Craftsman 2M

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Amberwood  
NPC CHILD NUMBER  
1848.302

SHEET  
A3-CR2M  
2FB.1

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
△	01/18/2019
△	PLAN REFRESH
△	11/27/2019
△	PCR REVISIONS
△	
△	
△	
△	
△	
△	


GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Amberwood  
NPC CHILD NUMBER  
1848.302

SHEET  
A3-EC2G  
2FB.1

(c) Copyright 2019 PulteGroup, Inc.

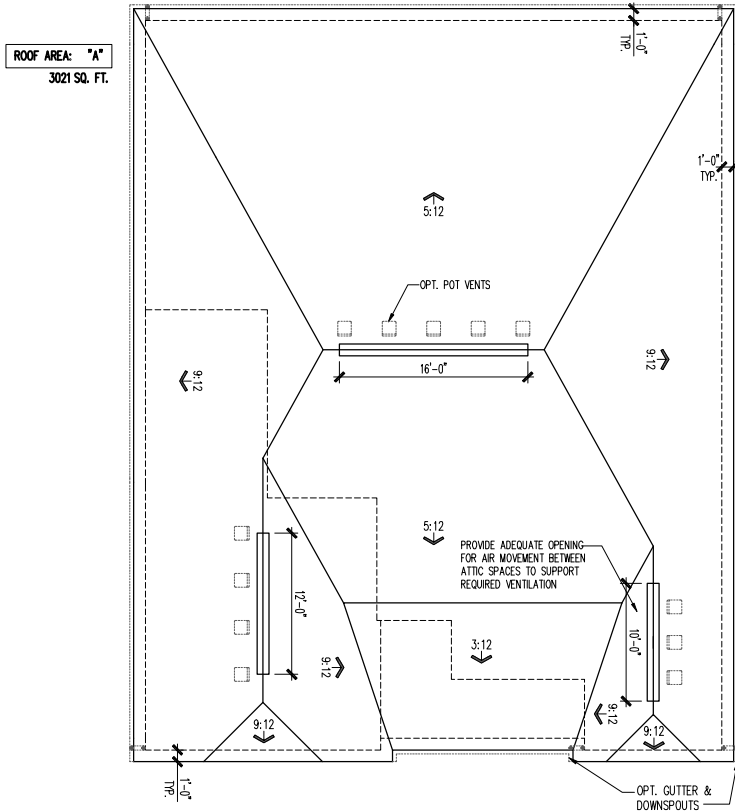

ROOF PLAN

SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE

VENTILATION REQUIRED AND REPORTED IS BASED ON ROOF VENT VALUES AND ROOF AREA VALUES SHOWN IN TABLE ABOVE.  
\* CONTINUOUS INSULATION, VENTILATION AND RESPONSIBILITY FOR VERIFYING THAT VENTS MEET ALL CODE REQUIREMENTS TO MEET CODE REQUIREMENTS  
\* SCHEDULE HAS BEEN CALCULATED ASSUMING THE VENTILATION AT 30-DEGREE OF PITCH AND MEET AT 40-DEGREE OF PITCH, REQUIRED VENTILATION


Euro Country 2G

ROOF AREA "A" SQ FTG 3021 AT / NEAR RIDGE AT / NEAR EAVE

VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. PROVIDED	PERCENT OFFICIAL SUPPLIED	POT LARGE (SQUARE FEET)	POT SMALL (SQUARE FEET)	ROOF VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONG. VENT (SQUARE FEET)
ROOF VENT ONLY	4.00 5.04	4.44	46.34	11	0			
AT EAVE	6.04 6.04	6.42	63.76				0	78.00
TOTAL #sqft	10.07 10.07	10.86	100.00					


ROOF VENT ONLY	SQ. FT. REQUIRED RANGE	SQ. FT. PROVIDED	PERCENT OFFICIAL SUPPLIED	POT LARGE (SQUARE FEET)	POT SMALL (SQUARE FEET)	ROOF VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONG. VENT (SQUARE FEET)
ROOF VENT ONLY	4.00 5.04	4.44	46.34	11	0			
AT EAVE	6.04 6.04	6.42	63.76				0	78.00
TOTAL #sqft	10.07 10.07	10.86	100.00					

ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE




SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS

1/4" = 1'-0"

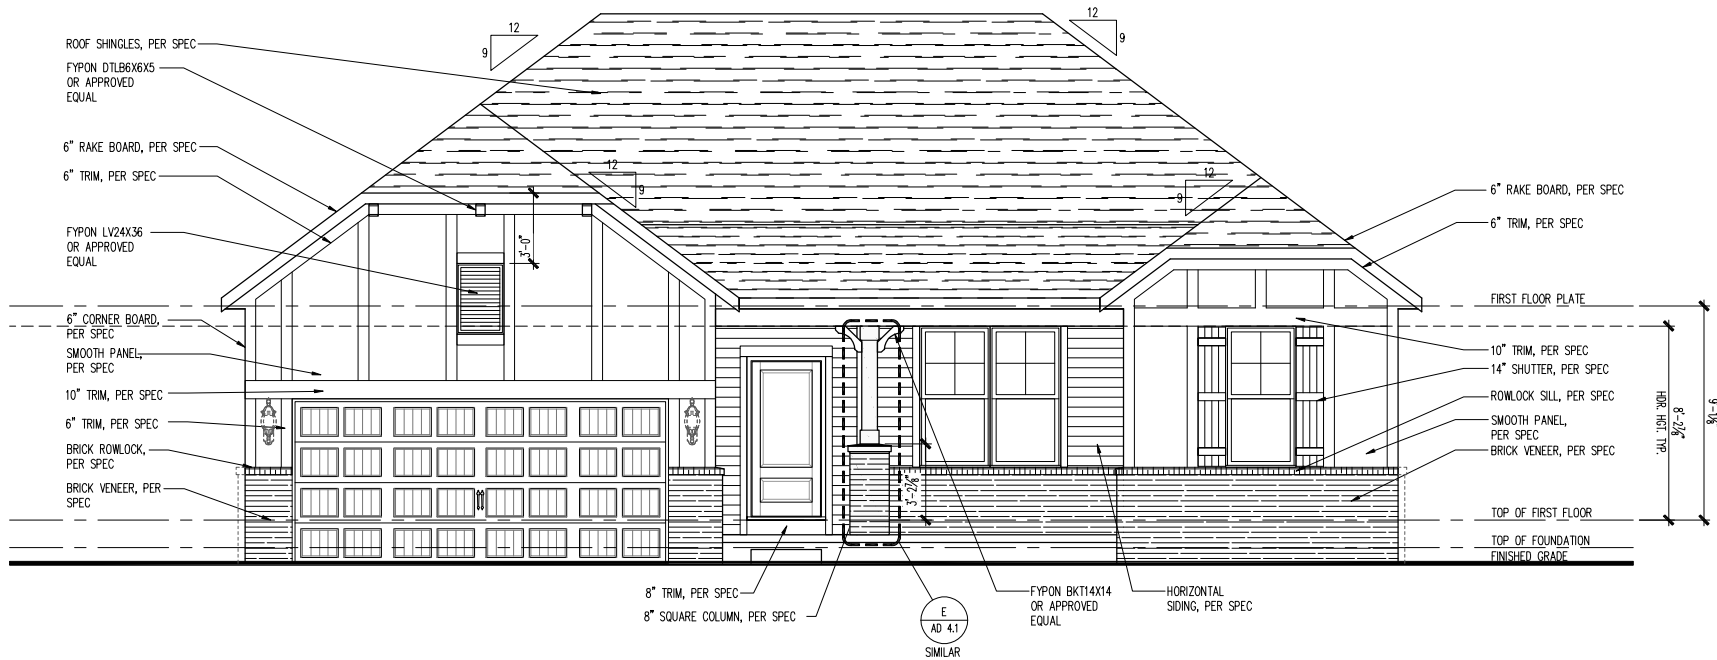


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

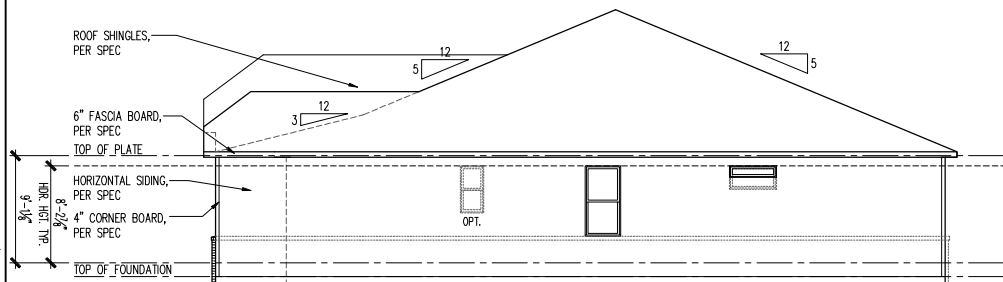


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

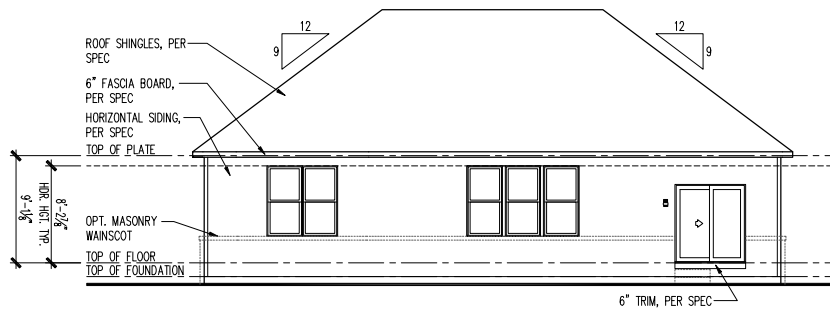

REAR ELEVATION

SCALE: 1/8" = 1'-0"

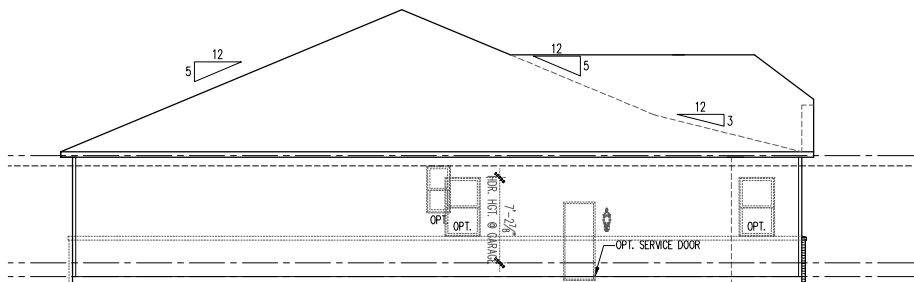

LEFT ELEVATION

SCALE: 1/8" = 1'-0"



PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
△	01/18/2019
PLAN REFRESH	
△	11/27/2019
PCR REVISIONS	
△	
△	
△	
△	
△	
△	


GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Amberwood  
NPC CHILD NUMBER  
1848.302

SHEET  
A3-EC2H  
2FB.1


(c) Copyright 2019 PulteGroup, Inc.

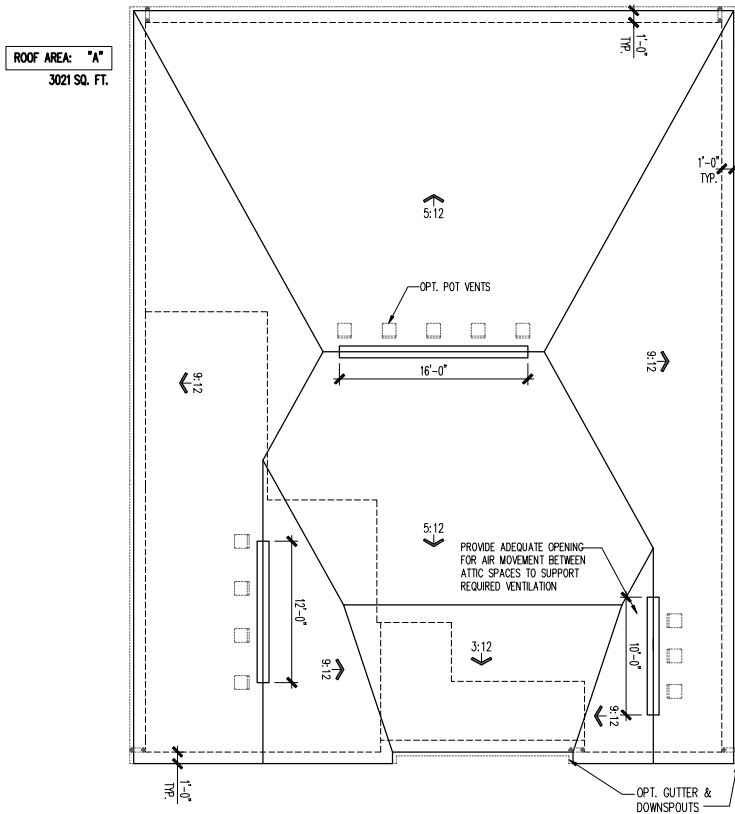

ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON ROOF VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINUOUS MECHANICAL VENTILATION IS RESPONSIBLE FOR VERIFYING THAT VENTS USED ARE CAPABLE OF MEETING ALL MEET CODE REQUIREMENTS									
** SCHEDULE HAS BEEN CALCULATED ASSUMING THE VENTILATION AT 30-DEGREE OF PITCH AND 100% OF TOTAL REQUIRED VENTILATION									
Euro Country 2H									
ROOF AREA "A"		SQ. FTG	3021	AT / NEAR RIDGE		AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OFFICIAL SUPPLIED	POT LARGE (SQUARE FEET)	POT SMALL (SQUARE FEET)	ROOF VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONG. VENT (SQUARE FEET)	
ROOF POT VENT ONLY	4.03 - 5.04	4.46	46.34	11	0				
AT EAVE	6.04 - 5.04	5.42	63.76				0	78.00	
TOTAL #REQ	10.07	10.07	10.08	100.00					
ROOF ROOF VENT	4.03 - 5.04	4.75	46.72	0	0	38.00			
AT EAVE	6.04 - 5.04	5.42	63.28				0	78.00	
TOTAL #REQ	10.07	10.07	10.17	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									




SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS

1/4" = 1'-0"

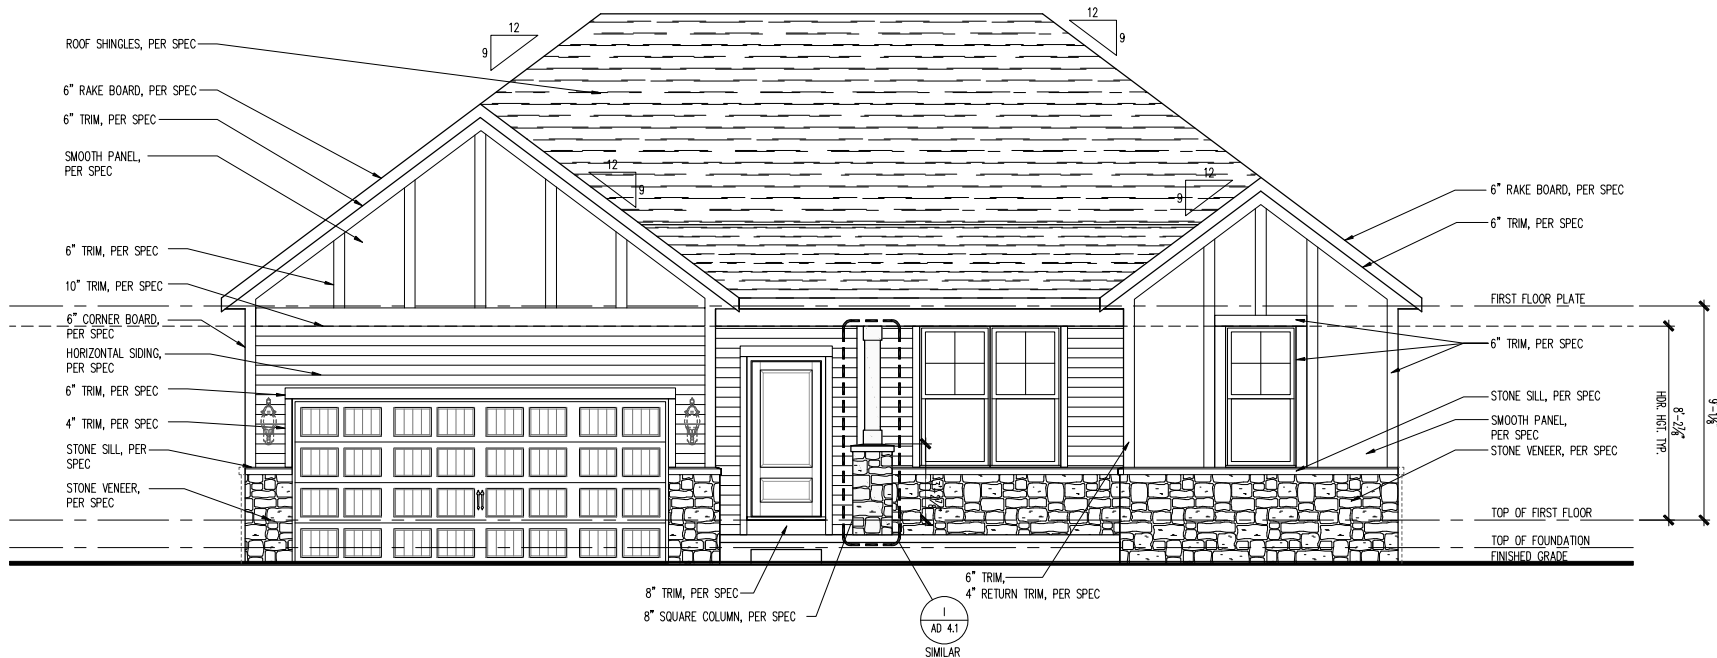


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

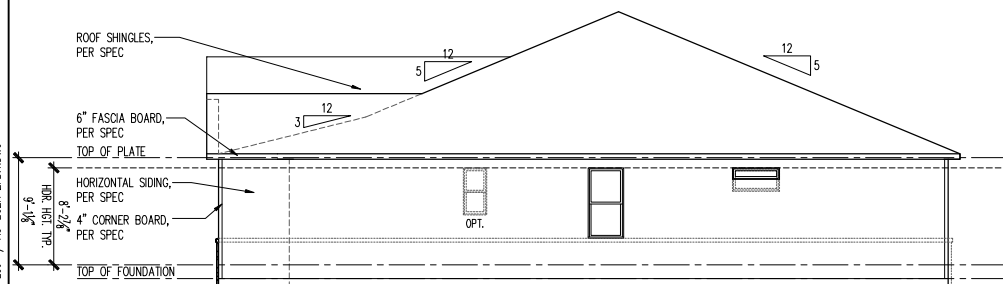


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

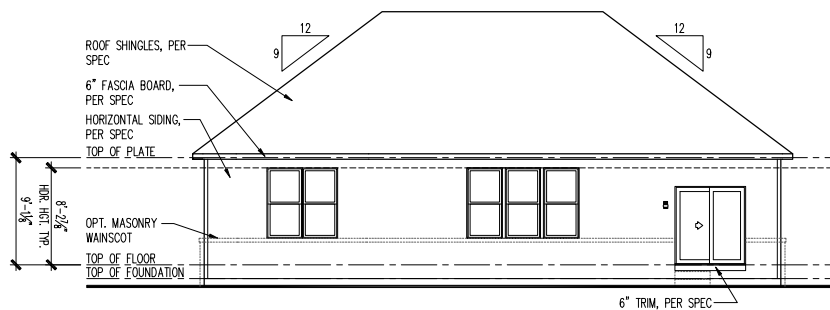

REAR ELEVATION


SCALE: 1/8" = 1'-0"

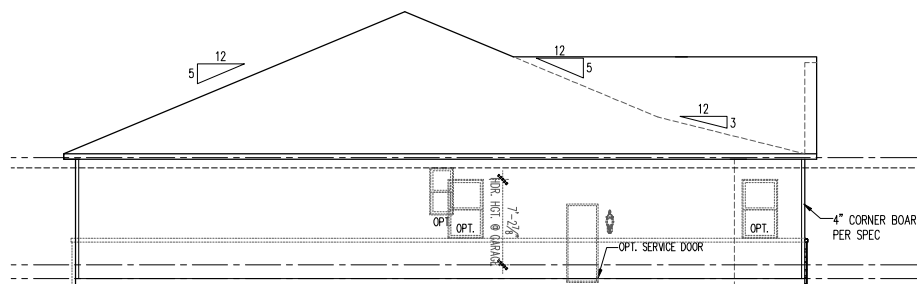

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

PLOTTED: November 14, 2019 / A3-HR2M 2FB.LDWG / Annie Lee

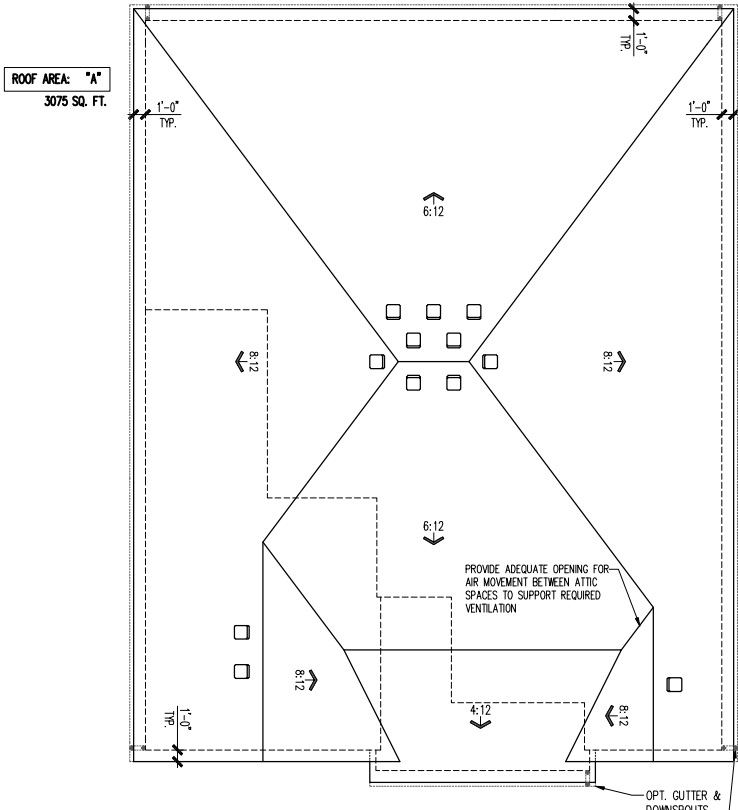


ROOF PLAN

SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
Heartland 2M									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OFFICIAL SUPPLIED	POT LARGE (SQUARE FEET)	POT SMALL (SQUARE FEET)	ROOF VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONG. VENT (SQUARE FEET)	
ROOF VENT ONLY	4.10 5.10	5.10	49.04	12	0				
AT EAVE	6.10 8.10	8.10	65.94				0	70.00	
TOTAL	10.20 13.20	13.20	100.00						
ROOF VENT ONLY	4.10 5.10	0.00	0.00	0	0	0.00			
AT EAVE	6.10 8.10	0.00	0.00				0	0.00	
TOTAL	10.20 13.20	0.00	0.00						

ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AVAILABLE




SIDE AND REAR WINDOWS PER COMMUNITY SPECS

1/4" = 1'-0"

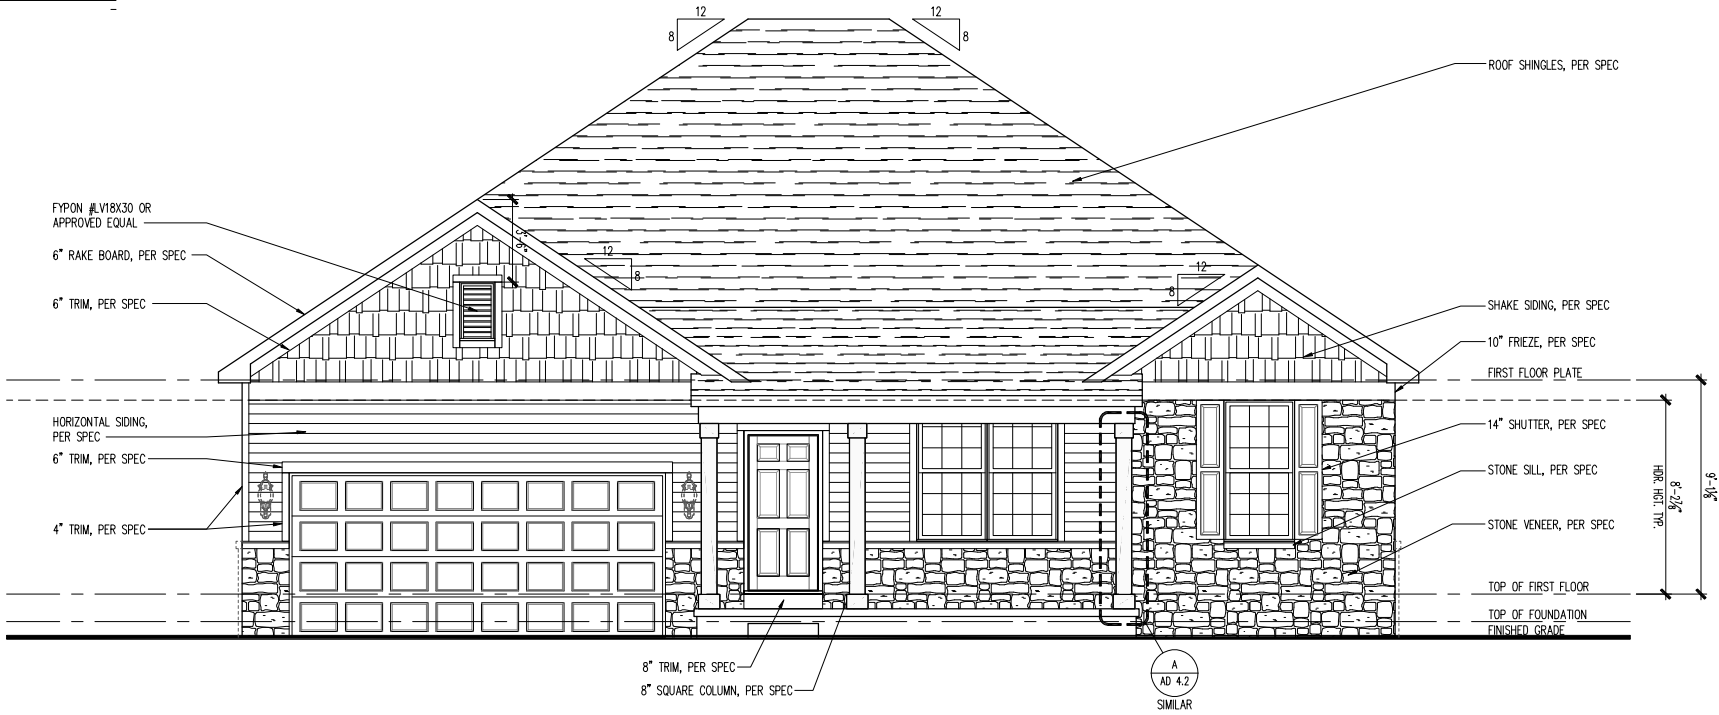


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

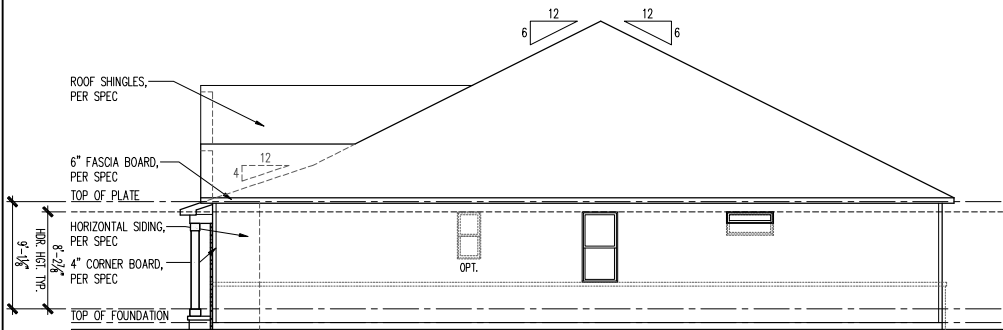


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

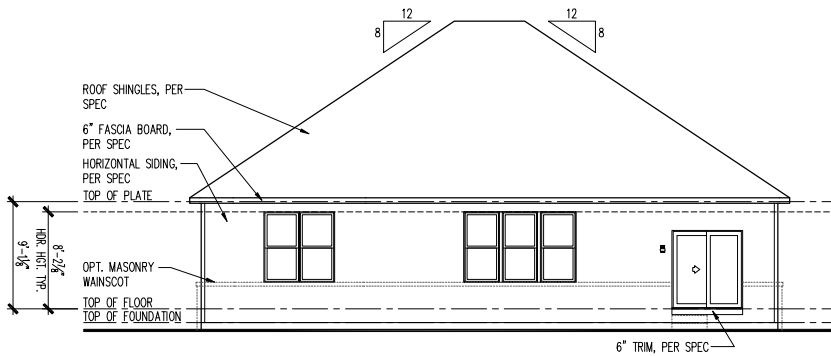

REAR ELEVATION

SCALE: 1/8" = 1'-0"

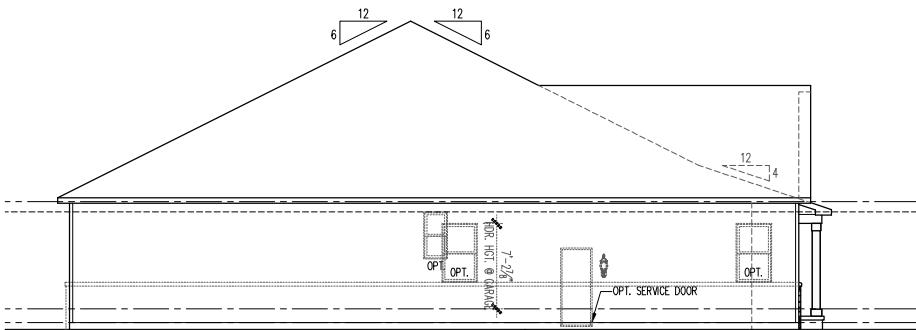

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

(c) Copyright 2019 PulteGroup, Inc.

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry

Heartland 2M

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
 Single Family

SPECIFICATION LEVEL

PLAN NAME  
 Amberwood  
 NPC CHILD NUMBER  
 1848.302

SHEET  
 A3-HR2M  
 2FB.1



SCALE: 1/8" = 1'-0"

HIGH- BUDGET	4.10	5.13	5.00	48.65	0	0	40.00	
AT RISK	4.15	5.13	5.28	51.35				0 76.00
TOTAL	10.25	10.25	10.28	100.00	ADDITIONAL FORTNITE MAY BE REQUIRED IF THERE IS INSUFFICIENT RISK AVAILABLE			


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

$$\overline{1/4''} = 1'-0''$$


SCALE: 1/4" = 1'-0"



SCALE: 1/8" = 1'-0"



### REAR ELEVATION

SCALE: 1/8" = 1'-0"



SCALE:  $1/8" = 1'-0"$

三

**Midwest Zone Office**  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



### Front, Side and Rear Elevations

2 Car Front Entry  
Heartland 2S

PRODUCT MANAGER  
Nick Starkey  
INITIAL RELEASE  
DATE: 01/18/2019

[illegible]


### Single Family

Specification Level	Specification	Test Case	Test Case Description	Test Case Data	Test Case Results	Test Case Status	Test Case Comments
1	1.1	1.1.1	1.1.1.1	1.1.1.1.1	1.1.1.1.1.1	1.1.1.1.1.1.1	1.1.1.1.1.1.1.1
2	2.1	2.1.1	2.1.1.1	2.1.1.1.1	2.1.1.1.1.1	2.1.1.1.1.1.1	2.1.1.1.1.1.1.1
3	3.1	3.1.1	3.1.1.1	3.1.1.1.1	3.1.1.1.1.1	3.1.1.1.1.1.1	3.1.1.1.1.1.1.1
4	4.1	4.1.1	4.1.1.1	4.1.1.1.1	4.1.1.1.1.1	4.1.1.1.1.1.1	4.1.1.1.1.1.1.1
5	5.1	5.1.1	5.1.1.1	5.1.1.1.1	5.1.1.1.1.1	5.1.1.1.1.1.1	5.1.1.1.1.1.1.1
6	6.1	6.1.1	6.1.1.1	6.1.1.1.1	6.1.1.1.1.1	6.1.1.1.1.1.1	6.1.1.1.1.1.1.1
7	7.1	7.1.1	7.1.1.1	7.1.1.1.1	7.1.1.1.1.1	7.1.1.1.1.1.1	7.1.1.1.1.1.1.1
8	8.1	8.1.1	8.1.1.1	8.1.1.1.1	8.1.1.1.1.1	8.1.1.1.1.1.1	8.1.1.1.1.1.1.1
9	9.1	9.1.1	9.1.1.1	9.1.1.1.1	9.1.1.1.1.1	9.1.1.1.1.1.1	9.1.1.1.1.1.1.1
10	10.1	10.1.1	10.1.1.1	10.1.1.1.1	10.1.1.1.1.1	10.1.1.1.1.1.1	10.1.1.1.1.1.1.1
11	11.1	11.1.1	11.1.1.1	11.1.1.1.1	11.1.1.1.1.1	11.1.1.1.1.1.1	11.1.1.1.1.1.1.1
12	12.1	12.1.1	12.1.1.1	12.1.1.1.1	12.1.1.1.1.1	12.1.1.1.1.1.1	12.1.1.1.1.1.1.1
13	13.1	13.1.1	13.1.1.1	13.1.1.1.1	13.1.1.1.1.1	13.1.1.1.1.1.1	13.1.1.1.1.1.1.1
14	14.1	14.1.1	14.1.1.1	14.1.1.1.1	14.1.1.1.1.1	14.1.1.1.1.1.1	14.1.1.1.1.1.1.1
15	15.1	15.1.1	15.1.1.1	15.1.1.1.1	15.1.1.1.1.1	15.1.1.1.1.1.1	15.1.1.1.1.1.1.1
16	16.1	16.1.1	16.1.1.1	16.1.1.1.1	16.1.1.1.1.1	16.1.1.1.1.1.1	16.1.1.1.1.1.1.1
17	17.1	17.1.1	17.1.1.1	17.1.1.1.1	17.1.1.1.1.1	17.1.1.1.1.1.1	17.1.1.1.1.1.1.1
18	18.1	18.1.1	18.1.1.1	18.1.1.1.1	18.1.1.1.1.1	18.1.1.1.1.1.1	18.1.1.1.1.1.1.1
19	19.1	19.1.1	19.1.1.1	19.1.1.1.1	19.1.1.1.1.1	19.1.1.1.1.1.1	19.1.1.1.1.1.1.1
20	20.1	20.1.1	20.1.1.1	20.1.1.1.1	20.1.1.1.1.1	20.1.1.1.1.1.1	20.1.1.1.1.1.1.1
21	21.1	21.1.1	21.1.1.1	21.1.1.1.1	21.1.1.1.1.1	21.1.1.1.1.1.1	21.1.1.1.1.1.1.1
22	22.1	22.1.1	22.1.1.1	22.1.1.1.1	22.1.1.1.1.1	22.1.1.1.1.1.1	22.1.1.1.1.1.1.1
23	23.1	23.1.1	23.1.1.1	23.1.1.1.1	23.1.1.1.1.1	23.1.1.1.1.1.1	23.1.1.1.1.1.1.1
24	24.1	24.1.1	24.1.1.1	24.1.1.1.1	24.1.1.1.1.1	24.1.1.1.1.1.1	24.1.1.1.1.1.1.1
25	25.1	25.1.1	25.1.1.1	25.1.1.1.1	25.1.1.1.1.1	25.1.1.1.1.1.1	25.1.1.1.1.1.1.1
26	26.1	26.1.1	26.1.1.1	26.1.1.1.1	26.1.1.1.1.1	26.1.1.1.1.1.1	26.1.1.1.1.1.1.1
27	27.1	27.1.1	27.1.1.1	27.1.1.1.1	27.1.1.1.1.1	27.1.1.1.1.1.1	27.1.1.1.1.1.1.1
28	28.1	28.1.1	28.1.1.1	28.1.1.1.1	28.1.1.1.1.1	28.1.1.1.1.1.1	28.1.1.1.1.1.1.1
29	29.1	29.1.1	29.1.1.1	29.1.1.1.1	29.1.1.1.1.1	29.1.1.1.1.1.1	29.1.1.1.1.1.1.1
30	30.1	30.1.1	30.1.1.1	30.1.1.1.1	30.1.1.1.1.1	30.1.1.1.1.1.1	30.1.1.1.1.1.1.1
31	31.1	31.1.1	31.1.1.1	31.1.1.1.1	31.1.1.1.1.1	31.1.1.1.1.1.1	31.1.1.1.1.1.1.1
32	32.1	32.1.1	32.1.1.1	32.1.1.1.1	32.1.1.1.1.1	32.1.1.1.1.1.1	32.1.1.1.1.1.1.1
33							

AN NAME  
**Amberwood**  
C CHILD NUMBER  
**848.302**

EET
A3-HR2S
2FB.1


PLOTTED: November 14, 2019 / A3-NC2G 2FB.DWG  
 / Annie Lee

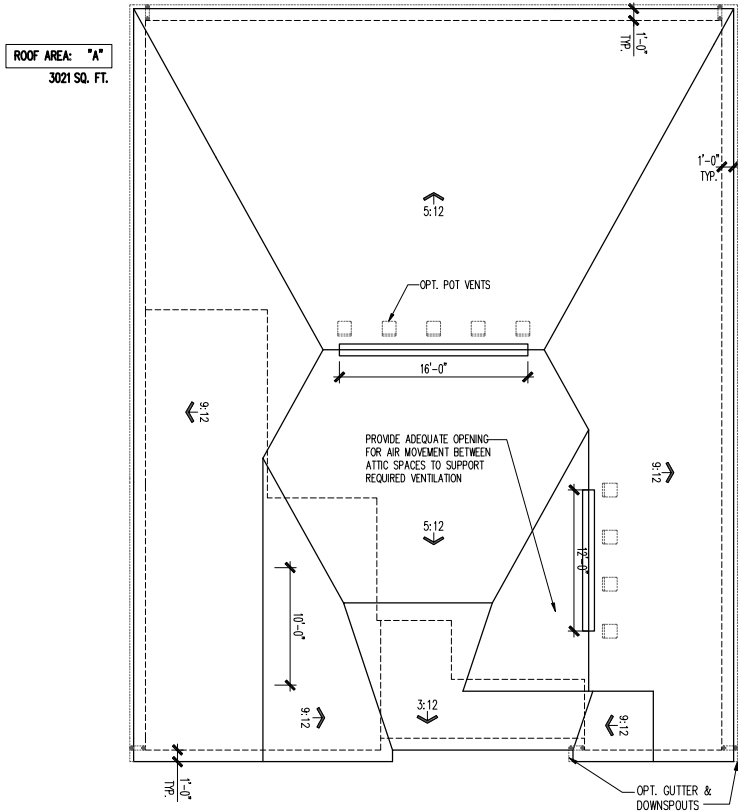

ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINUOUS INSULATION VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED ARE CAPABLE OF MEETING ALL MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING DATE VENTILATION AT 30-DEG OF TILT, AND HEAD AT 40-DEG OF TILT, REQUIRED VENTILATION									
Northern Craftsman 2G									
ROOF AREA "A"	SQ. FTG	3021	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQUARE FEET)	POT SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONG. VENT (SQUARE FEET)		
ROOF POT VENT ONLY	4.00 5.04	4.44	46.34	11	0				
AT EAVE	6.04 5.04	5.42	63.74			0	78.00		
TOTAL #44	10.07 10.07	10.08	100.00						
ROOF RIDGE VENT	4.00 5.04	4.75	46.72	0	0	38.00			
AT EAVE	6.04 5.04	5.42	63.28			0	78.00		
TOTAL #44	10.07 10.07	10.17	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE					




SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS

1/4" = 1'-0"

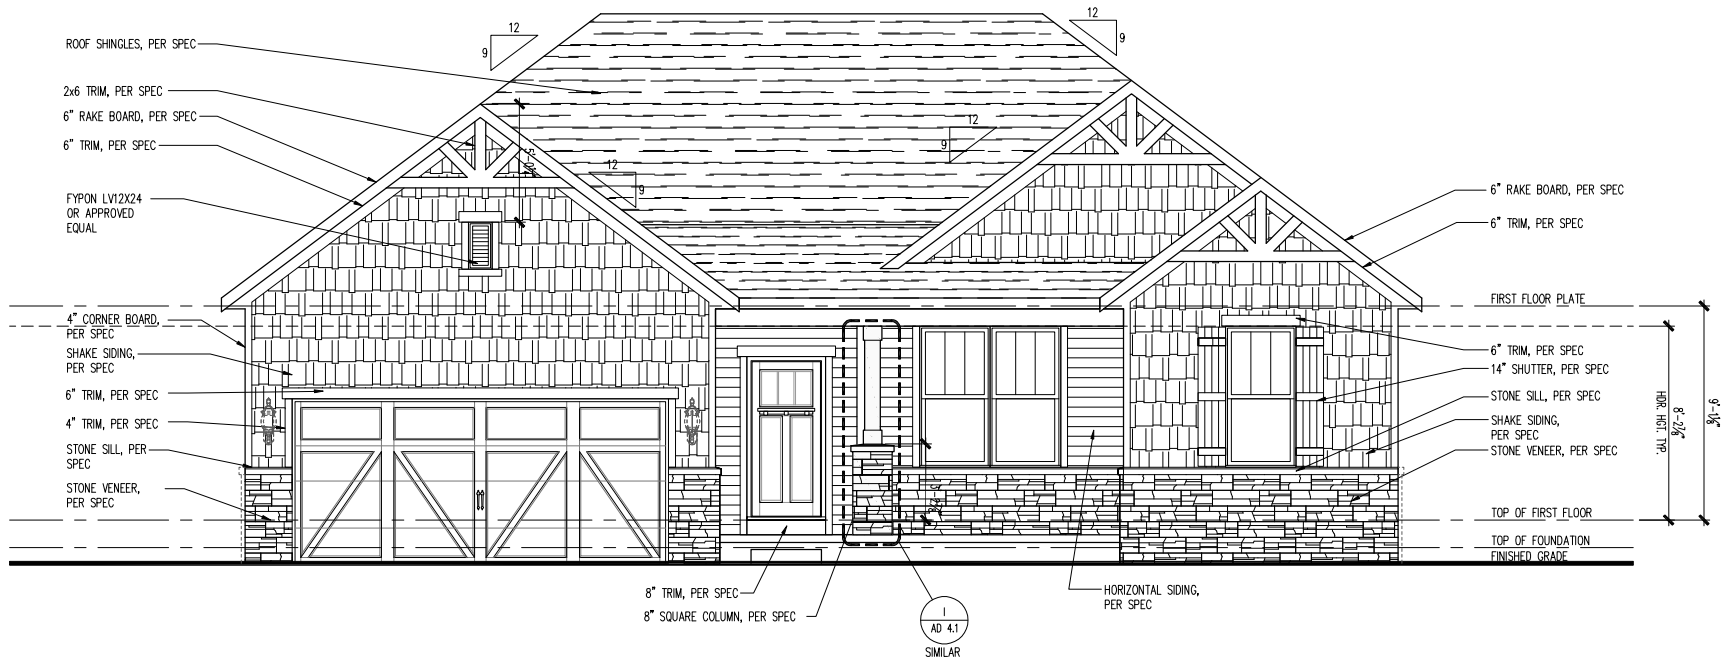


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

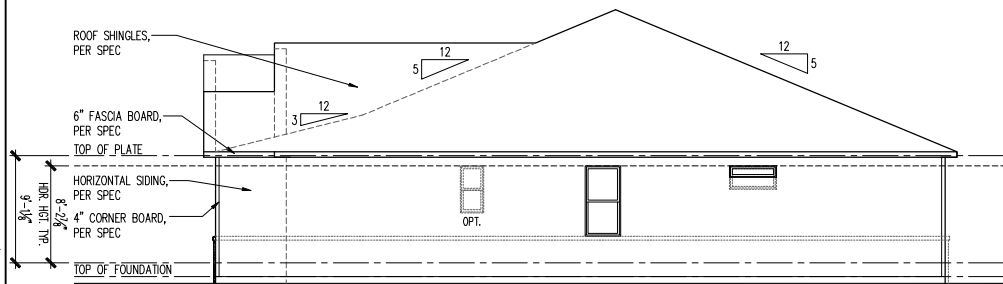


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

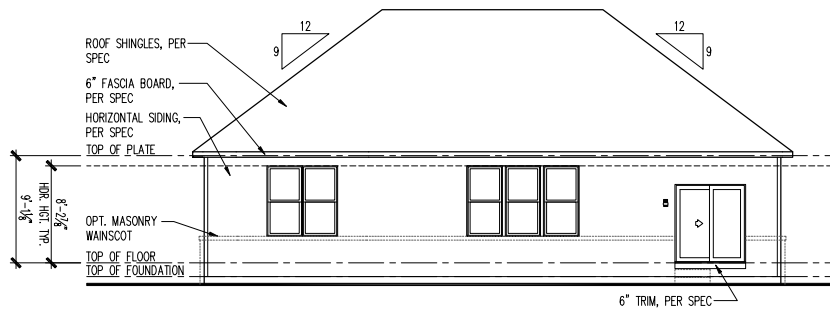

REAR ELEVATION

SCALE: 1/8" = 1'-0"

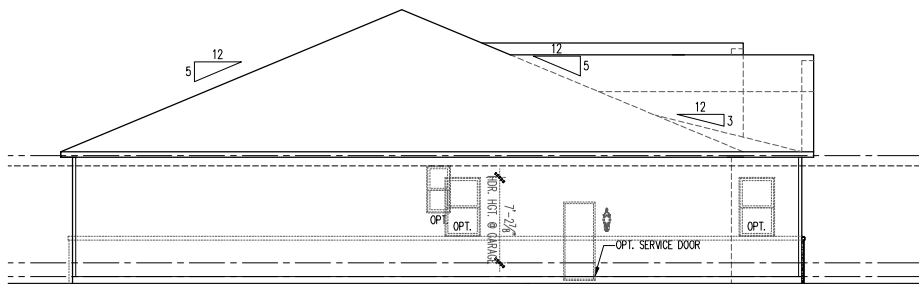

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

(c) Copyright 2019 PulteGroup, Inc.

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry

Northern Craftsman 2G

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
△	01/18/2019
△	PLAN REFRESH
△	11/27/2019
△	PCR REVISIONS
△	
△	
△	
△	
△	
△	

GARAGE HANDING  
Single Family


SPECIFICATION LEVEL

PLAN NAME  
Amberwood  
NPC CHILD NUMBER  
1848.302

SHEET  
A3-NC2G  
2FB.1



PLOTTED: November 14, 2019 / A3-PR2M 2FB.LDWG / Annie Lee

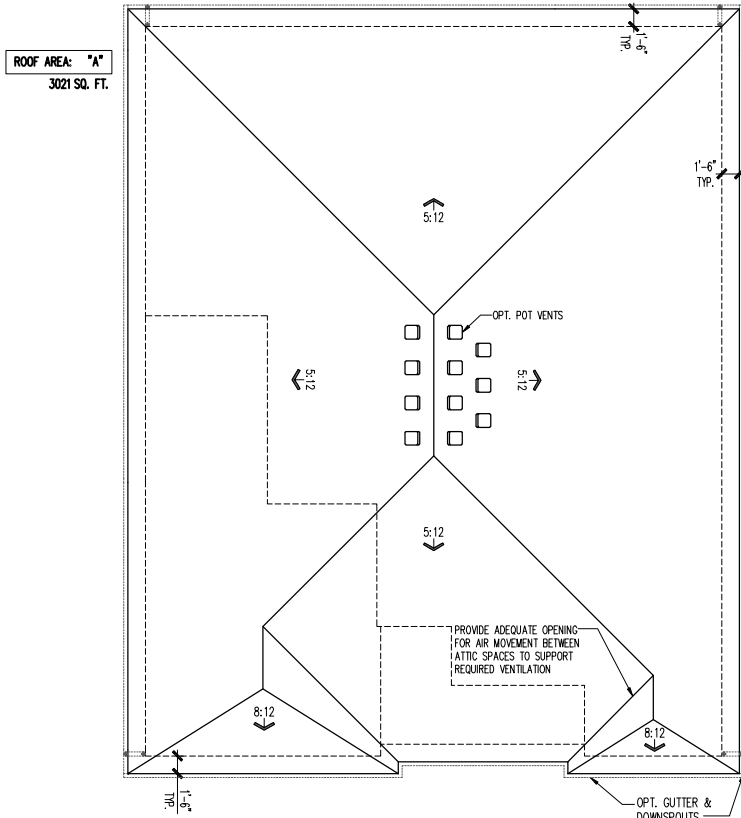


ROOF PLAN

SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
<small>           VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.            * CONTINUOUS INSULATION REQUIRED AND RESPONSIBLE FOR VERIFYING THAT VENTS USED ARE CAPABLE OF MEETING ALL MEET CODE REQUIREMENTS.            ** SCHEDULE HAS BEEN CALCULATED ASSUMING THE VENTILATION AT 30-INCH OF TRIM, AND RIDGE AT 40-INCH OF TOTAL REQUIRED VENTILATION.         </small>									
Prairie 2M									
ROOF AREA "A"	SQ. FTG	3021	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED	SQ. FT. SUPPLIED	PERCENT OFFICIAL SUPPLIED	POT LARGE (SQUARE INCHES)	POT SMALL (SQUARE INCHES)	RIDGE VENT (SQUARE INCHES)	EAVE VENT (SQUARE INCHES)	CONG. VENT (SQUARE INCHES)	
ROOF POT VENT ONLY	4.03	5.04	4.46	46.34	11	0			
AT EAVE	6.04	5.04	5.42	63.76			0	70.00	
TOTAL	10.07	10.07	10.00						
ROOF RIDGE VENT	4.03	5.04	0.00	#####	0	0	0.00		
AT EAVE	6.04	5.04	0.00	#####			0	0.00	
TOTAL	10.07	10.07	0.00	#####					

ADDITIONAL POT VENTS MAY BE REQUIRED IF TRIM IS NEARBY/NOT NEARBY AVAILABLE




SIDE AND REAR WINDOWS PER COMMUNITY SPECS

1/4" = 1'-0"

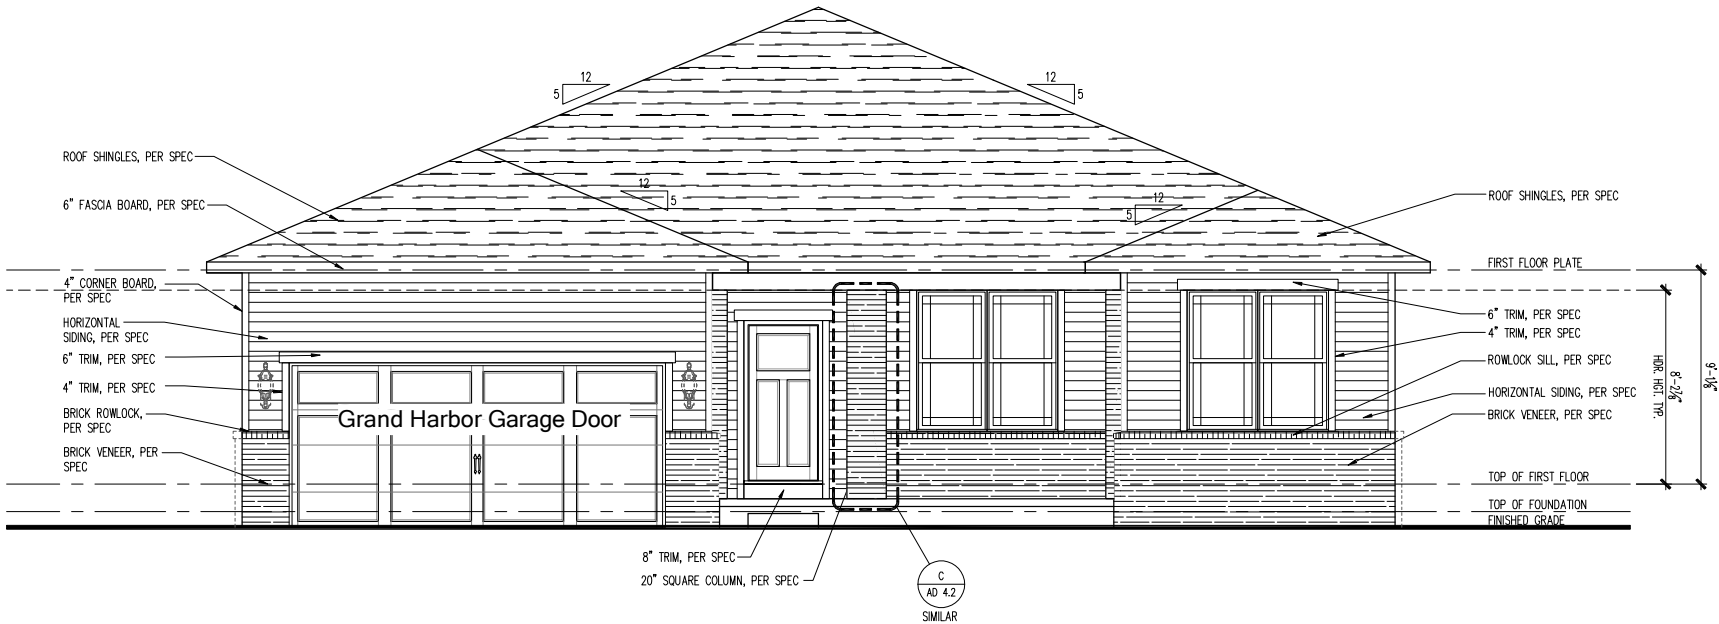


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

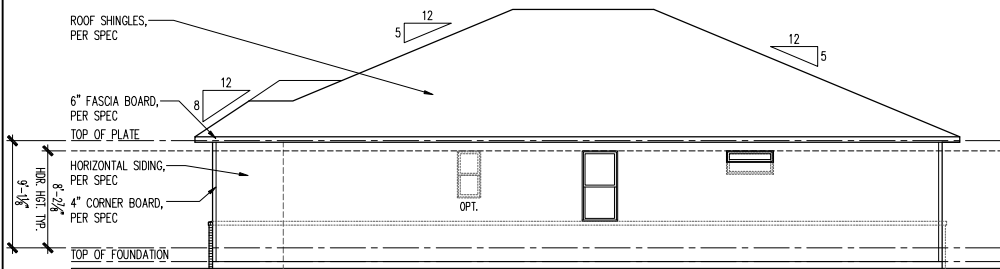


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

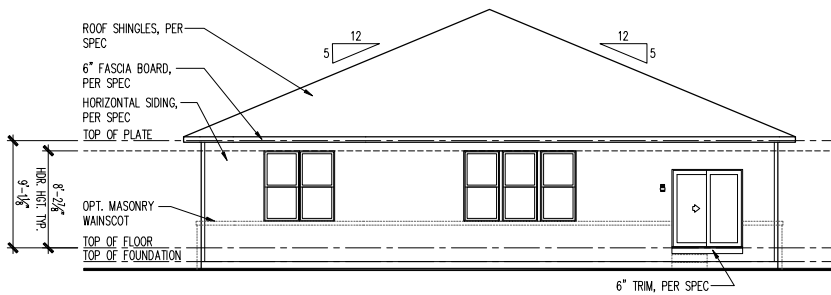

REAR ELEVATION

SCALE: 1/8" = 1'-0"

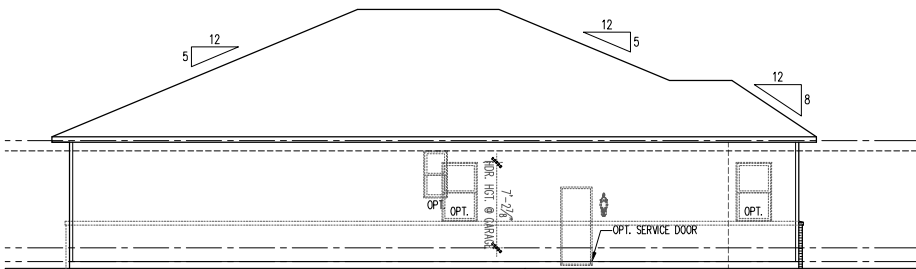

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
 2 Car Front Entry  
 Prairie 2M

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
 Single Family

SPECIFICATION LEVEL

PLAN NAME  
 Amberwood  
 NPC CHILD NUMBER  
 1848.302

SHEET  
 A3-PR2M  
 2FB.1

# GREENFIELD

4-7 Bedrooms | 2.5-5 Bathrooms | 3,021+ sq. ft.  
Walk-In Bedroom Closets | Pulte Planning Center® | Loft/Game Room






# Greenfield Home Exteriors






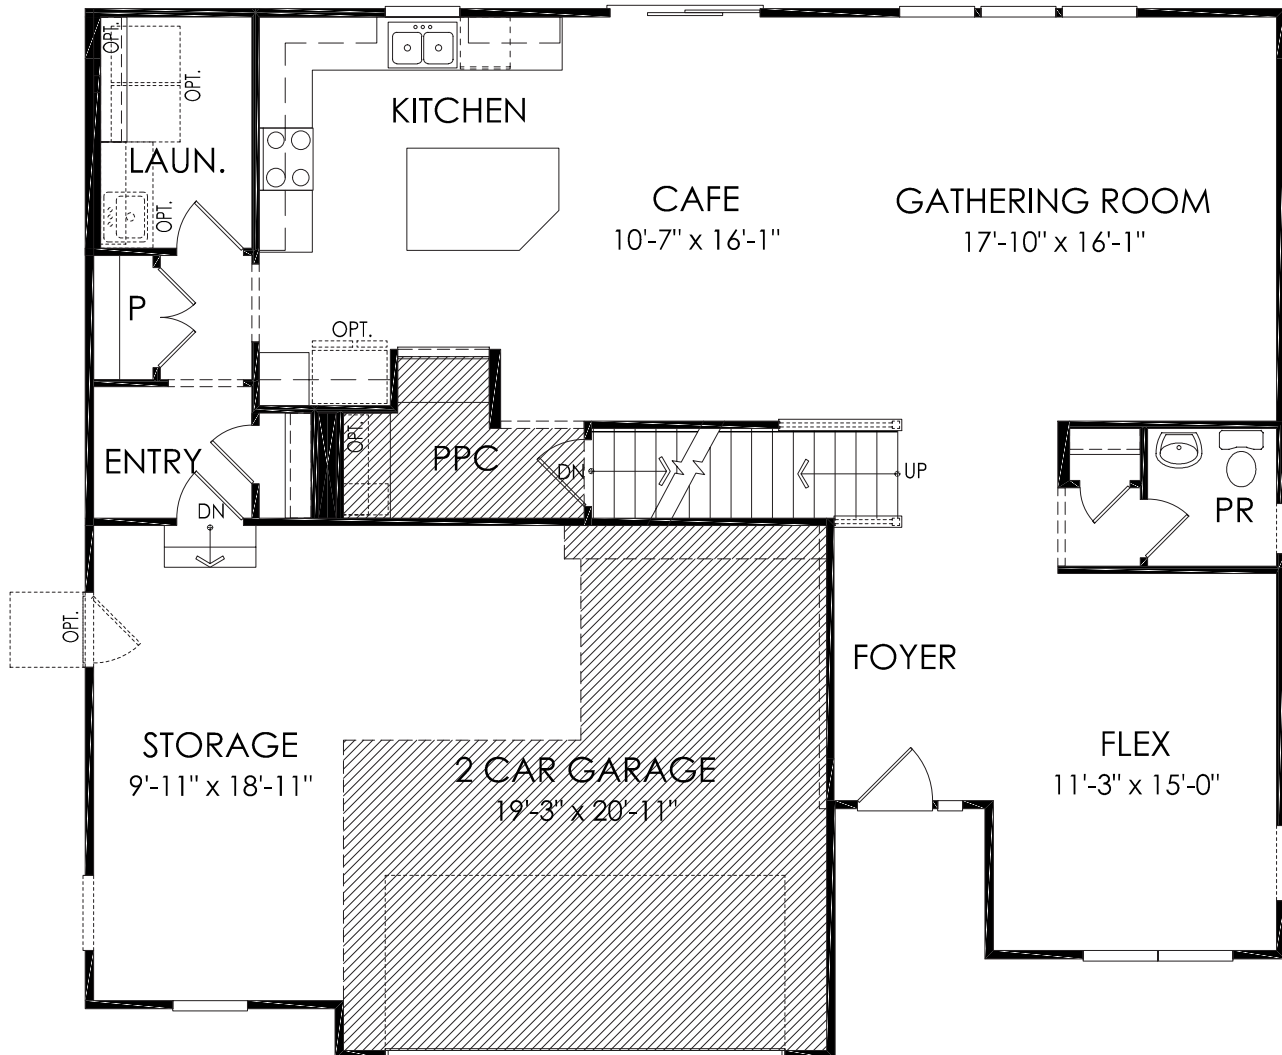

## AVAILABLE OPTIONS


Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on Pulte.com.

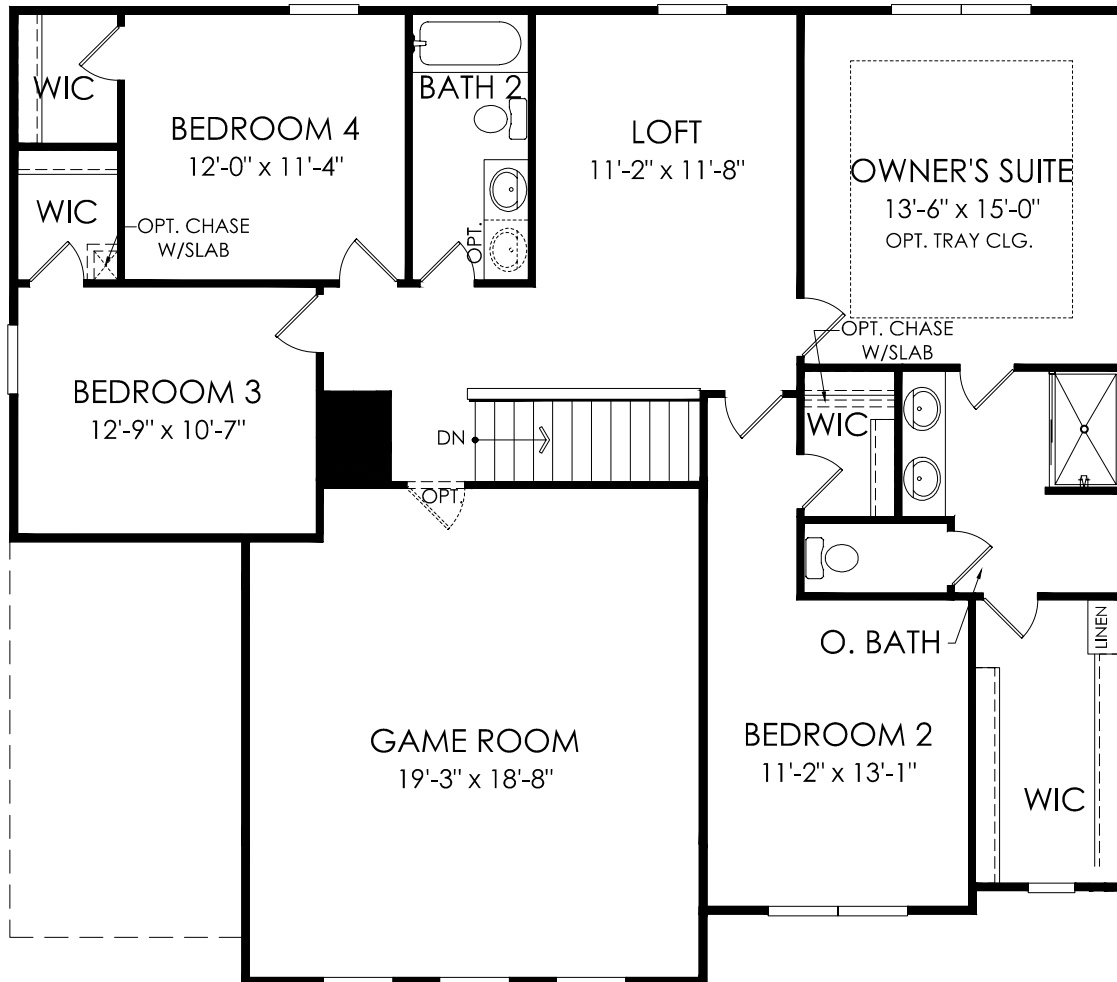

FLOORPLAN NOTES

GENERAL SPECIFICATIONS

1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE.
2. ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED.
3. ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE.
4. ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
5. PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
6. PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
7. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
9. PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
10. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
11. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
12. PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
13. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
14. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
15. BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-FLOOR WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
16. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES.

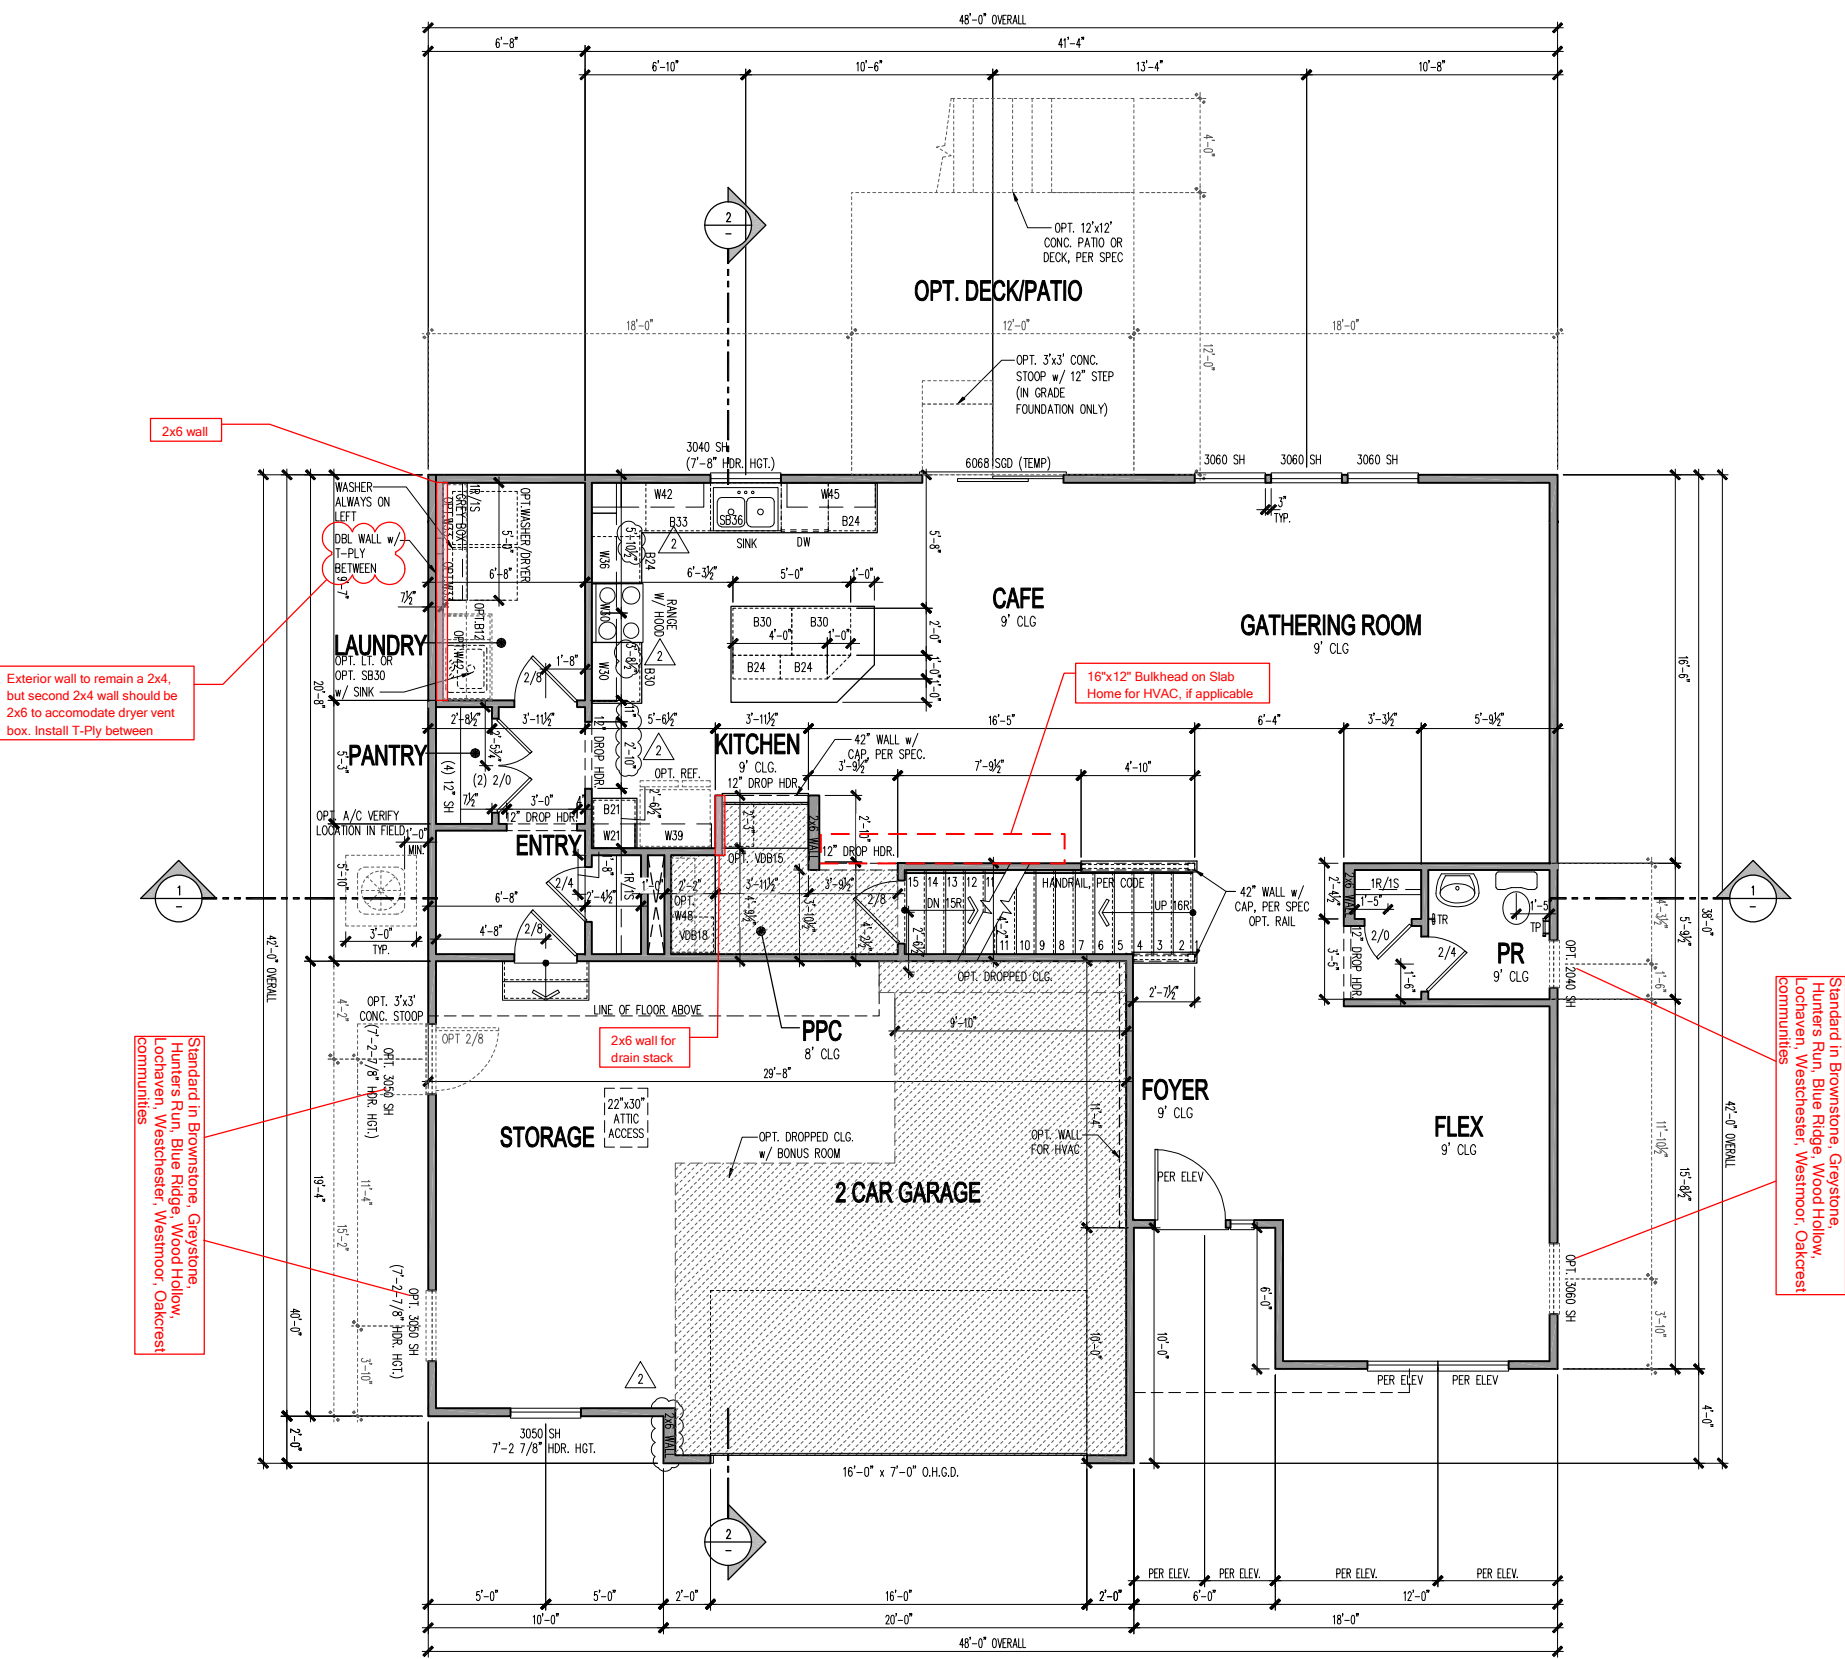

FIRST FLOOR PLAN - 4" EXTERIOR WALLS

SCALE: 1/4" = 1'-0"


PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	



FLOORPLAN NOTES

GENERAL SPECIFICATIONS


1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE.
2. ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED.
3. ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE.
4. ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
5. PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
6. PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
7. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
9. PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
10. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
11. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
12. PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
13. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
14. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
15. BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-FLOOR WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
16. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES.

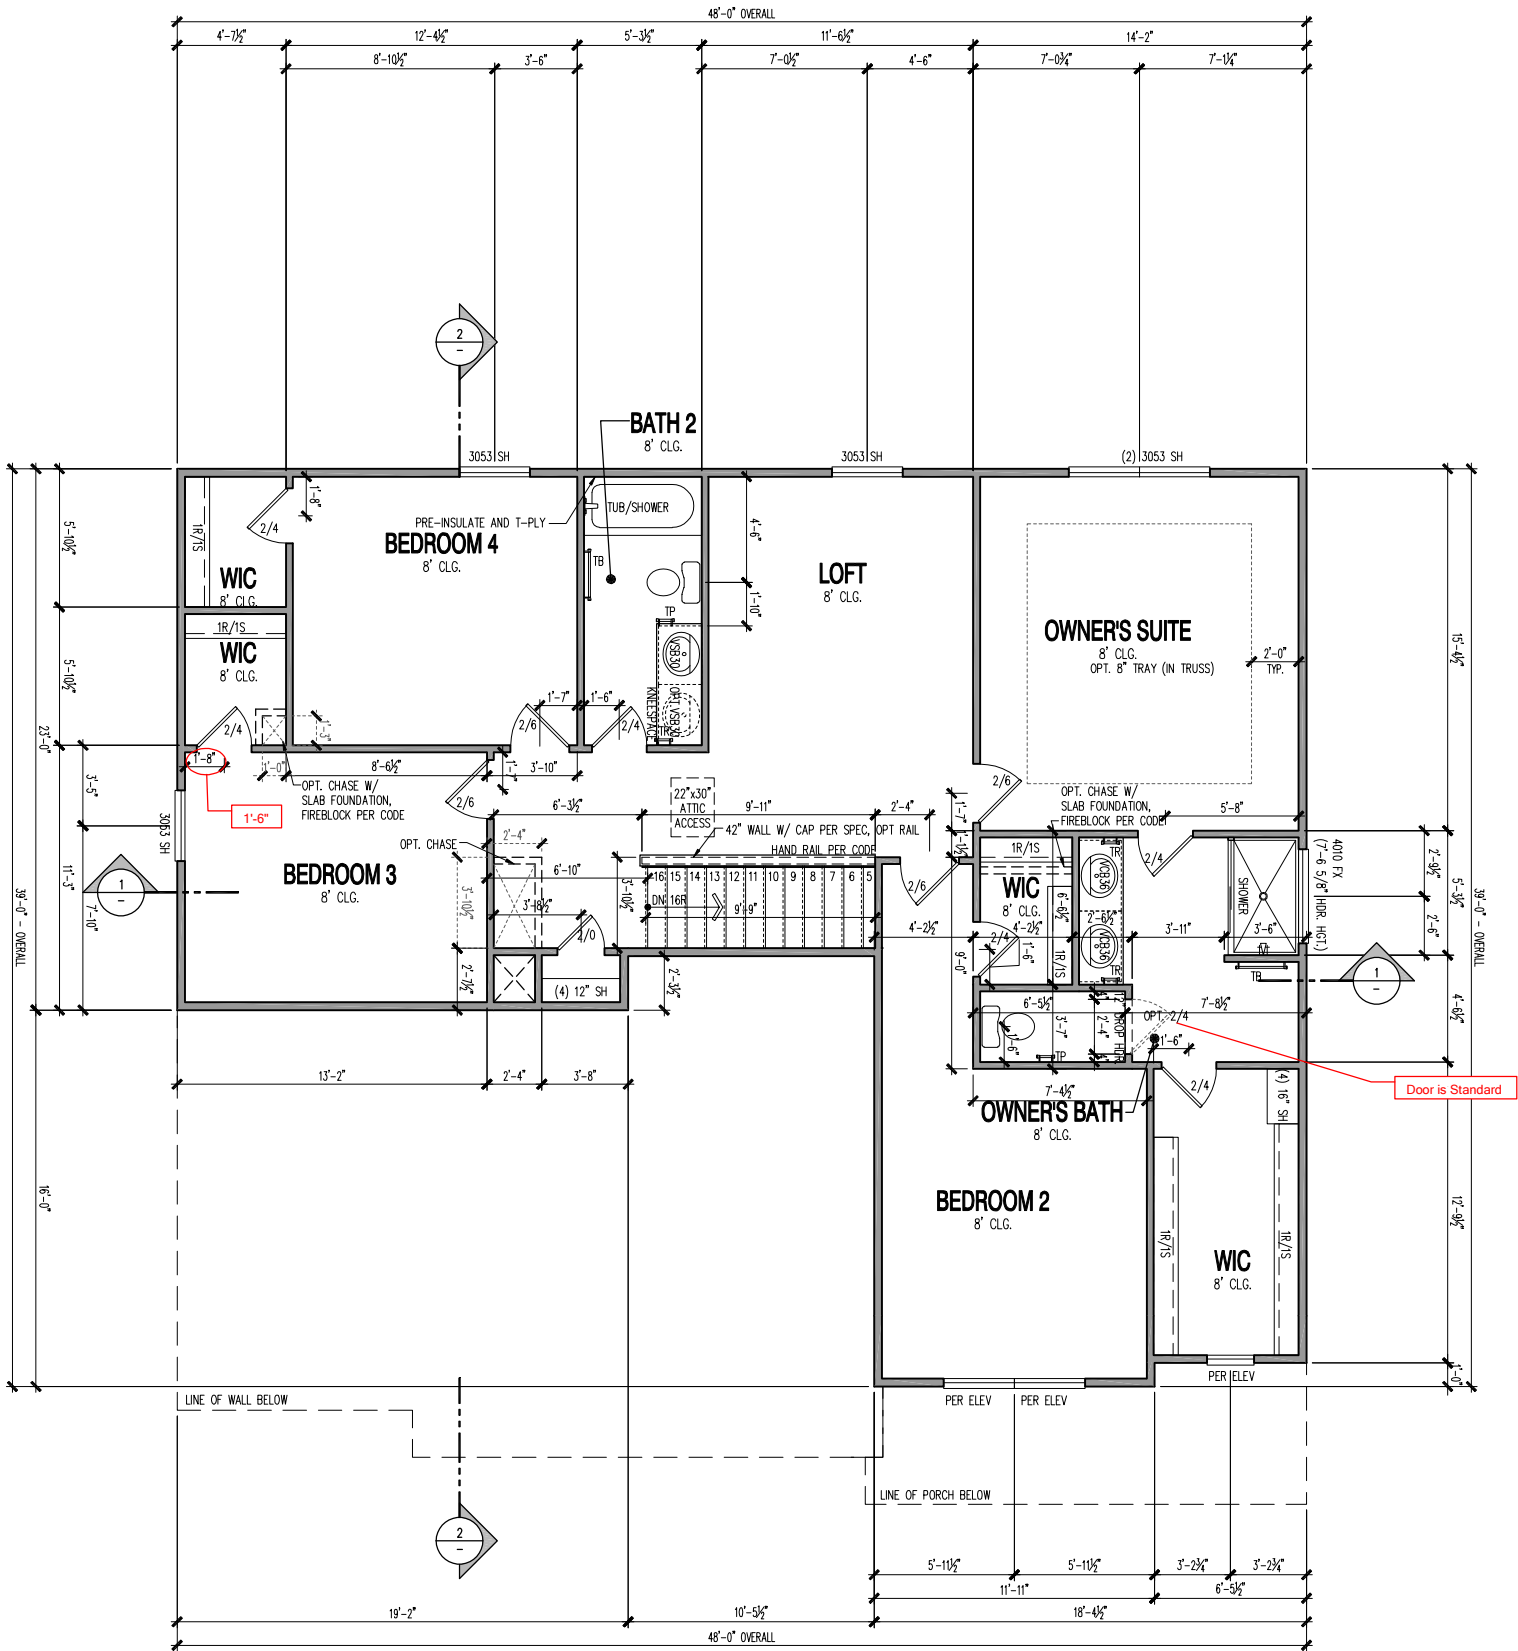





SECOND FLOOR PLAN - 4\"


SCALE: 1/4\"

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	







SCALE: 1/8" = 1'-0"










SCALE: 1/8" = 1'-0"









SCALE: 1/8" = 1'-0"



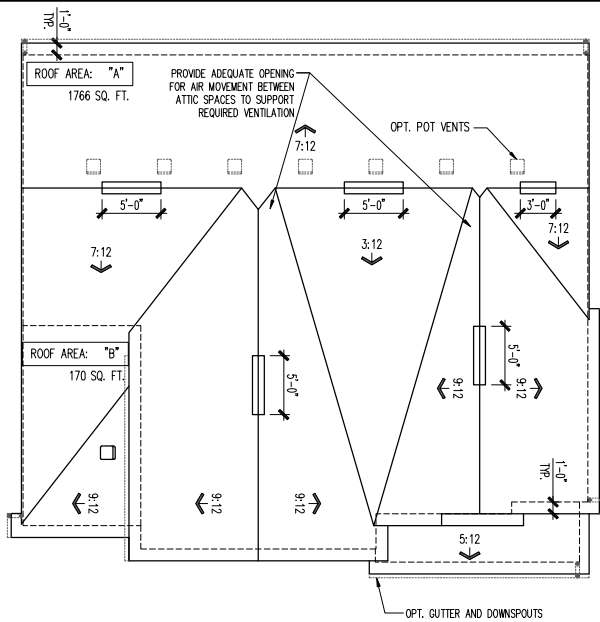


ROOF PLAN  
SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
VENTILATION REQUIREMENTS AND TYPICAL VALUES FOR POT VENT VALUES ARE BASED ON TABLE ABOVE. VERIFY THAT THE INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET THE REQUIREMENTS. A. OVERALL AREA USED FOR CALCULATING ASSUMING EAVE VENTILATION AT 30-40% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION.									
Heartland 2G-B									
ROOF AREA "A"		SQ. FT.	1766	AT / NEAR RIDGE		AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQUARE INCHES)	POT SMALL (SQUARE INCHES)	RIDGE VENT (SQUARE INCHES)	EAVE VENT (SQUARE INCHES)	CONE VENT (SQUARE INCHES)	
HIGH-POT VENTS ONLY	5.38	2.84	5.97	49.38	7	0			
AT EAVE	5.38	2.84	5.96	49.38			0	49.38	
TOTAL (sq. ft.)	5.89	5.89	6.02	100.00					
HIGH-POT VENT	5.38	2.84	5.98	49.48	0	0	23.00		
AT EAVE	5.38	2.84	5.96	49.52			0	49.00	
TOTAL (sq. ft.)	5.89	5.89	5.93	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				
ROOF AREA "B"		SQ. FT.	170	AT / NEAR RIDGE		AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQUARE INCHES)	POT SMALL (SQUARE INCHES)	RIDGE VENT (SQUARE INCHES)	EAVE VENT (SQUARE INCHES)	CONE VENT (SQUARE INCHES)	
HIGH-POT VENTS ONLY	0.35	0.35	0.42	49.84	1	0			
AT EAVE	0.34	0.35	0.49	49.44			0	7.00	
TOTAL (sq. ft.)	0.57	0.57	0.91	100.00					
HIGH-POT VENT	0.35	0.35	0.00	0.00	0	0	0.00		
AT EAVE	0.34	0.35	0.00	0.00			0	0.00	
TOTAL (sq. ft.)	0.57	0.57	0.00	0.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

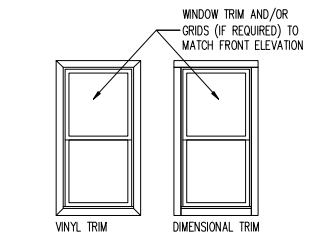


SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS  
SCALE: 1/4" = 1'-0"

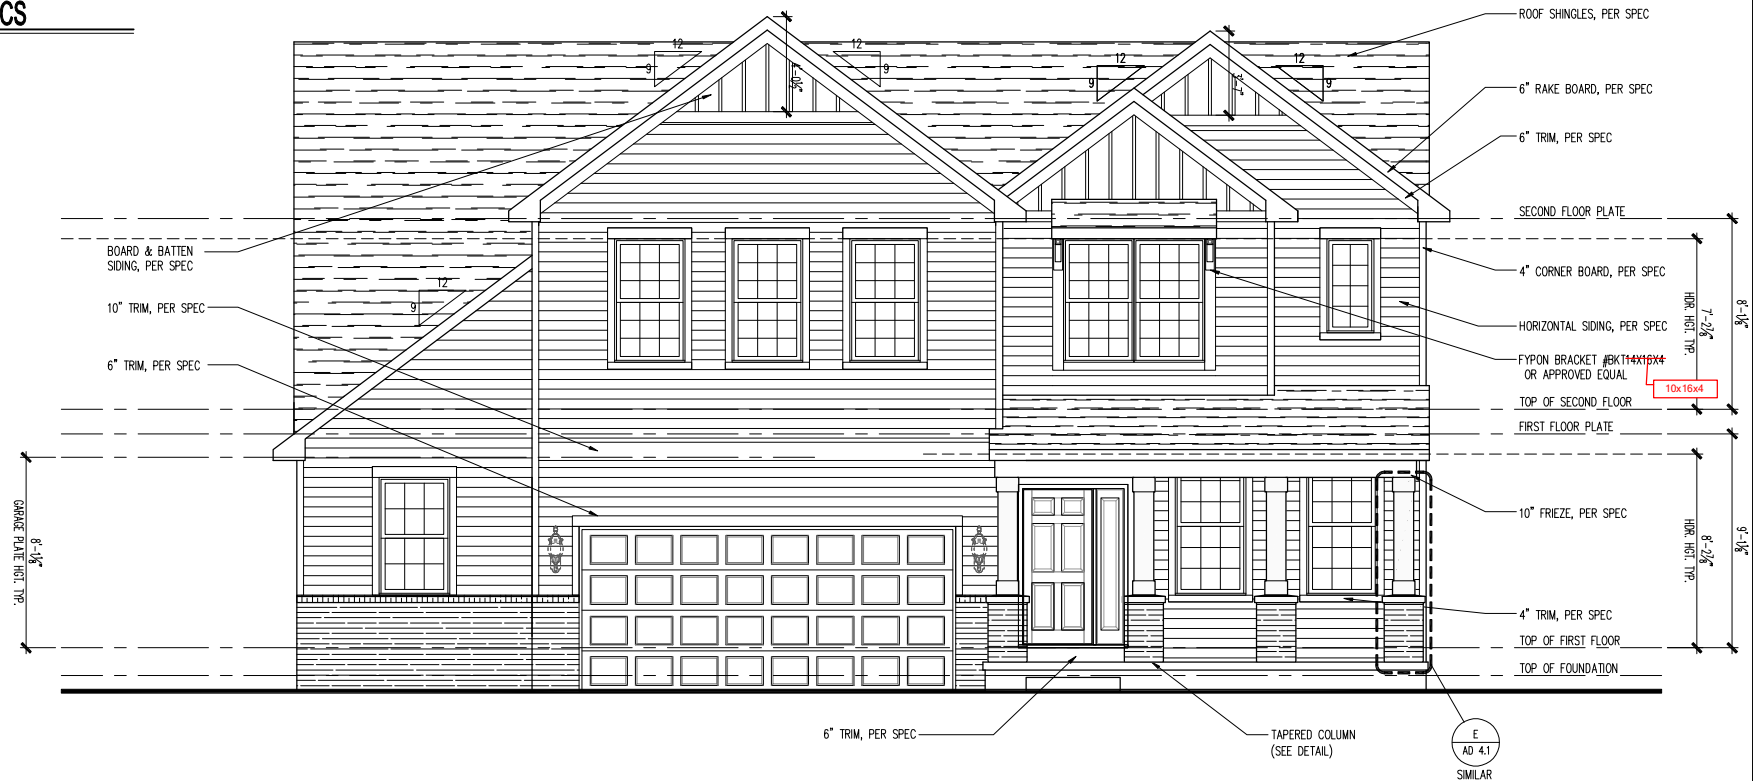


FRONT ELEVATION  
SCALE: 1/4" = 1'-0"

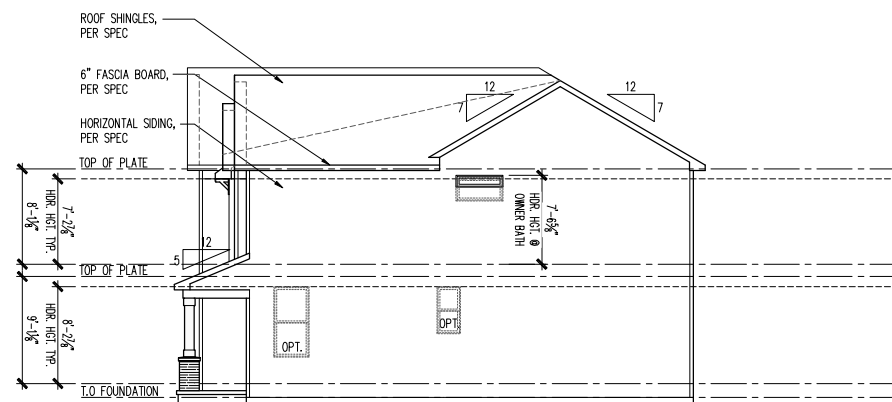

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

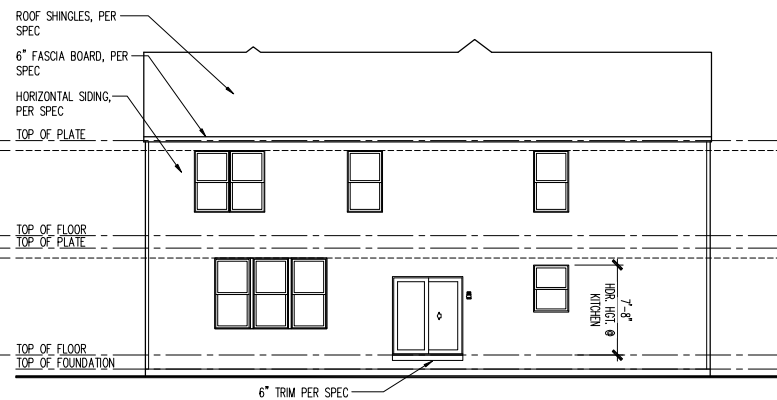

TYPICAL REAR ELEVATION  
SCALE: 1/8" = 1'-0"

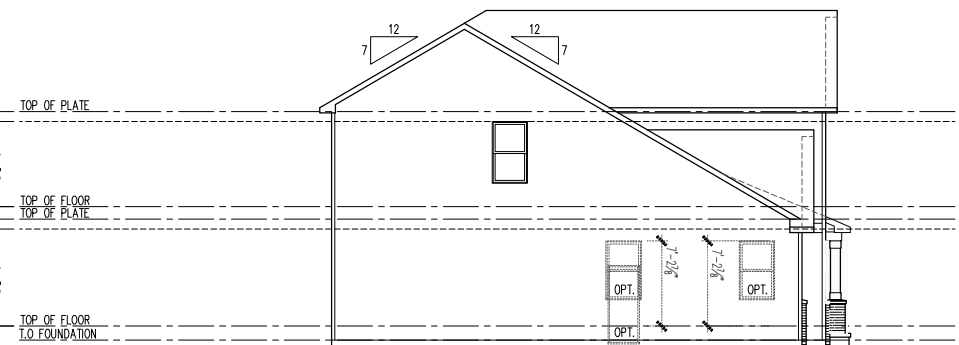

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

(c) Copyright 2019 PulteGroup, Inc.

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
2 Car Front Entry  
Heartland 2G-B

PRODUCT MANAGER  
Rick Starkey  
INITIAL RELEASE  
DATE: 01/18/2019


REV#	DATE/DESCRIPTION
1	01/18/2019 PLAN REFRESH
2	11/27/2019 PCR REVISIONS
3	
4	
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
Single Family

SPECIFICATION LEVEL


PLAN NAME  
Greenfield  
NPC CHILD NUMBER  
1850.302

SHEET  
A3-HR2G-B  
2FB.1

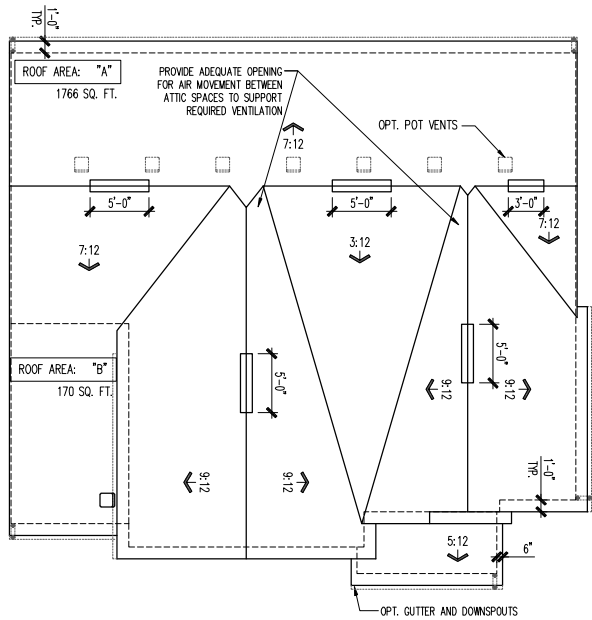

ROOF PLAN  
SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
VENTILATION REQUIREMENTS AND TYPICAL VALUES FOR POT VENT VALUES ARE BASED ON TABLE ABOVE. TO DETERMINE REQUIRED VENTILATION, THE USER IS RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO THE ENTIRE ATTIC. IF THE USER DOES NOT CALCULATE THE REQUIRED VENTILATION, THE USER SHALL USE THE VALUES IN THE FOLLOWING TABLE. IF THE USER DOES NOT CALCULATE THE REQUIRED VENTILATION, THE USER SHALL USE THE VALUES IN THE FOLLOWING TABLE.									
Heartland 2H-B									
ROOF AREA "A"	SQ. FT.	1766	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT.)	POT SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONE VENT (SQ. FT.)	
HIGH-POLE VENT ONLY	5.38	2.84	5.97	49.38	7	0			
AT EAVE	5.38	2.84	5.96	49.38			0	49.38	
TOTAL (sq. ft.)	5.89	5.89	6.02	100.00					
HIGH-POLE VENT ONLY	5.38	2.84	5.98	49.48	0	0	23.00		
AT EAVE	5.38	2.84	5.96	49.38			0	49.38	
TOTAL (sq. ft.)	5.89	5.89	5.93	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"	SQ. FT.	170	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT.)	POT SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONE VENT (SQ. FT.)	
HIGH-POLE VENT ONLY	0.53	0.53	0.42	49.38	1	0			
AT EAVE	0.54	0.53	0.49	49.44			0	7.00	
TOTAL (sq. ft.)	0.57	0.57	0.91	100.00					
HIGH-POLE VENT ONLY	0.53	0.53	0.00	0.0000	0	0	0.00		
AT EAVE	0.54	0.53	0.00	0.0000			0	0.00	
TOTAL (sq. ft.)	0.57	0.57	0.00	0.0000					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

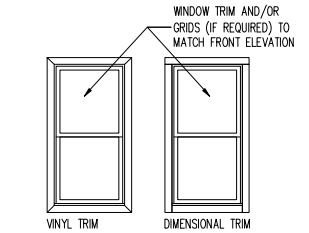

SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS  
SCALE: 1/4" = 1'-0"




FRONT ELEVATION  
SCALE: 1/4" = 1'-0"

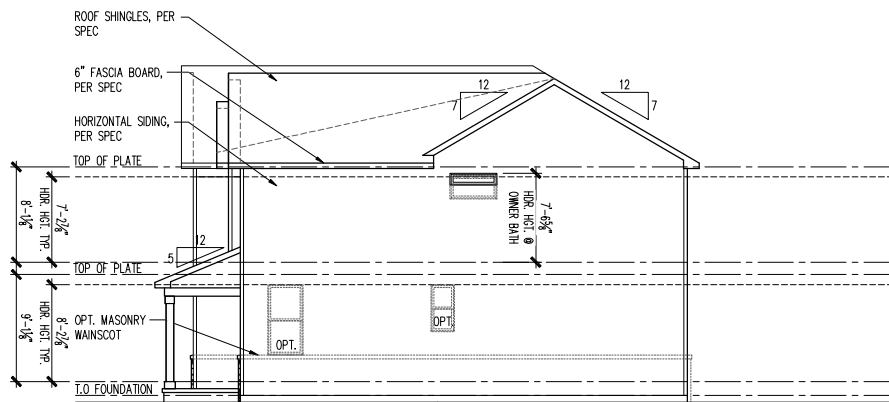

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"



REAR ELEVATION  
SCALE: 1/8" = 1'-0"

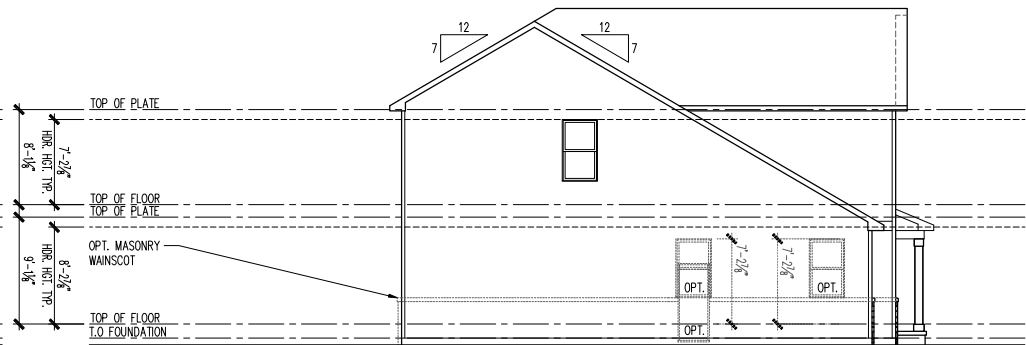

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
2 Car Front Entry  
Heartland 2H-B

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	DATE: 01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	11/27/2019
4	PCR REVISIONS


GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Greenfield  
NPC CHILD NUMBER  
1850.302


SHEET  
A3-HR2H-B  
2FB.1



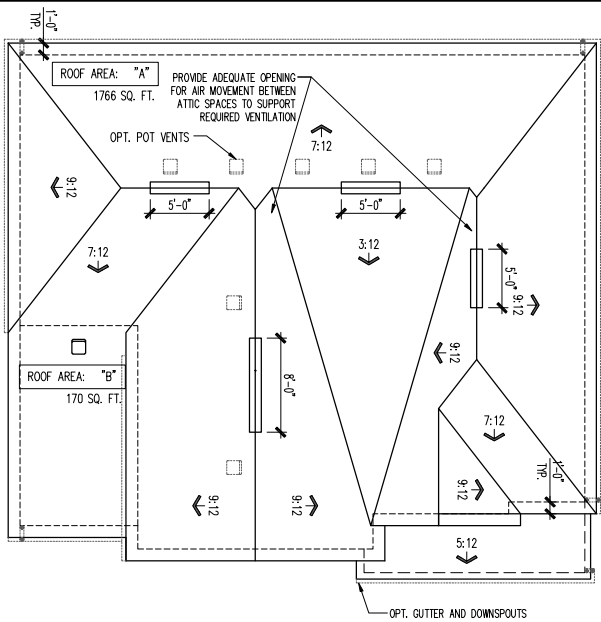


ROOF PLAN  
SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
VENTILATION REQUIREMENTS AND TYPICAL VALUES FOR POT VENT VALUES ARE BASED ON TABLE ABOVE. TO DETERMINE REQUIRED VENTILATION, THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION AS REQUIRED BY THE CODE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION AS REQUIRED BY THE CODE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION AS REQUIRED BY THE CODE.									
Heartland 2J-B									
ROOF AREA "A"	SQ. FT.	1766	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT.)	POT SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONT. VENT (SQ. FT.)	
HIGH-POT VENTS ONLY	5.38	2.84	5.37	49.38	7	0			
AT EAVE	5.38	2.84	5.38	49.38			0	49.38	
TOTAL (sq. ft.)	5.89	5.89	5.02	100.00					
HIGH-POT VENT	5.38	2.84	5.38	49.38	0	0	23.00		
AT EAVE	5.38	2.84	5.38	49.38			0	49.38	
TOTAL (sq. ft.)	5.89	5.89	5.93	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"	SQ. FT.	170	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT.)	POT SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONT. VENT (SQ. FT.)	
HIGH-POT VENTS ONLY	0.35	0.35	0.42	49.38	1	0			
AT EAVE	0.34	0.35	0.49	49.38			0	7.00	
TOTAL (sq. ft.)	0.57	0.57	0.91	100.00					
HIGH-POT VENT	0.35	0.35	0.00	0.00	0	0	0.00		
AT EAVE	0.34	0.35	0.00	0.00			0	0.00	
TOTAL (sq. ft.)	0.57	0.57	0.00	0.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

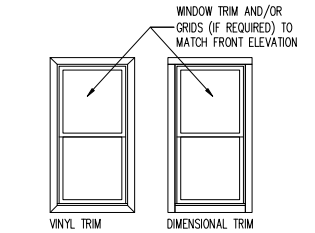


SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS  
SCALE: 1/4" = 1'-0"

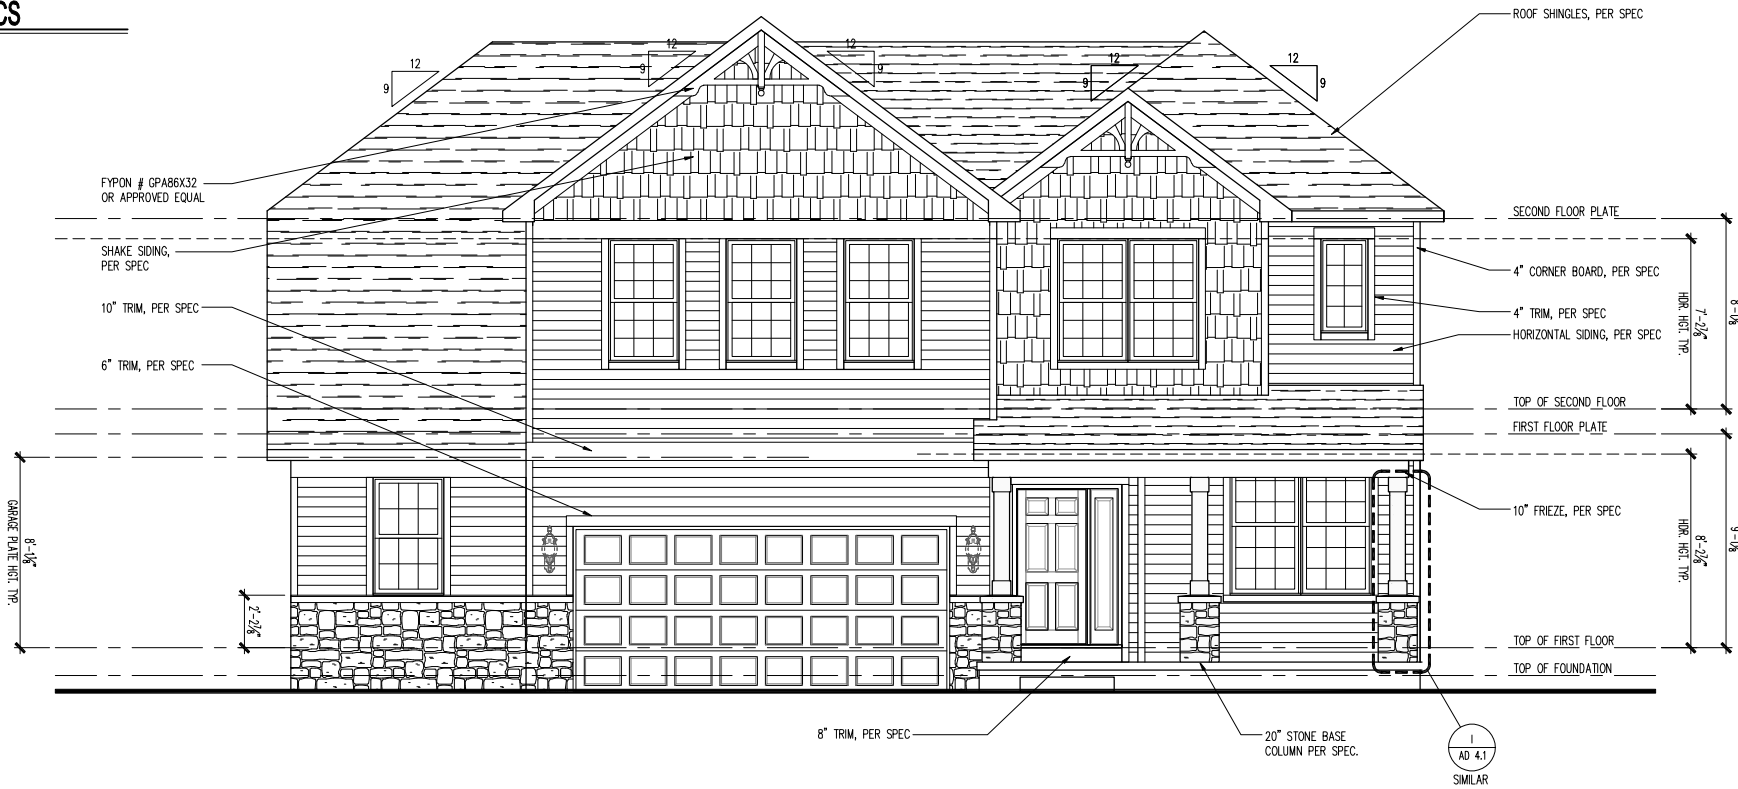


FRONT ELEVATION  
SCALE: 1/4" = 1'-0"

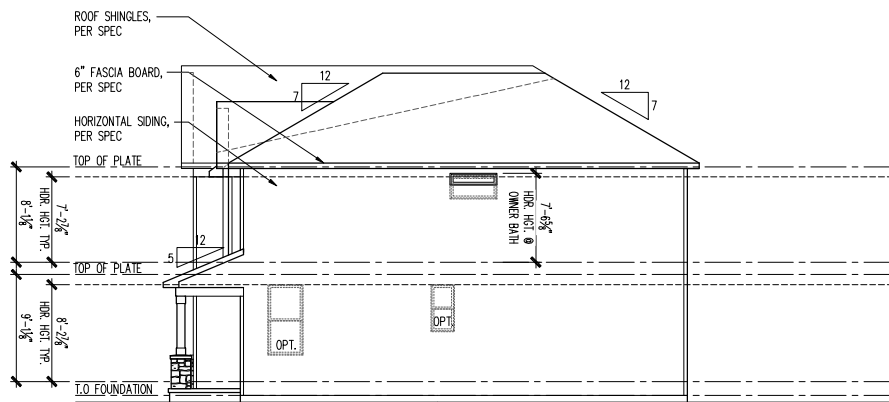

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

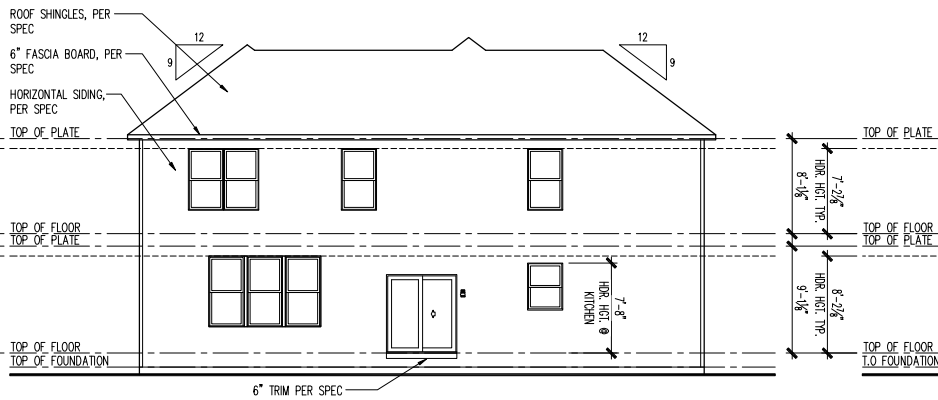

REAR ELEVATION  
SCALE: 1/8" = 1'-0"

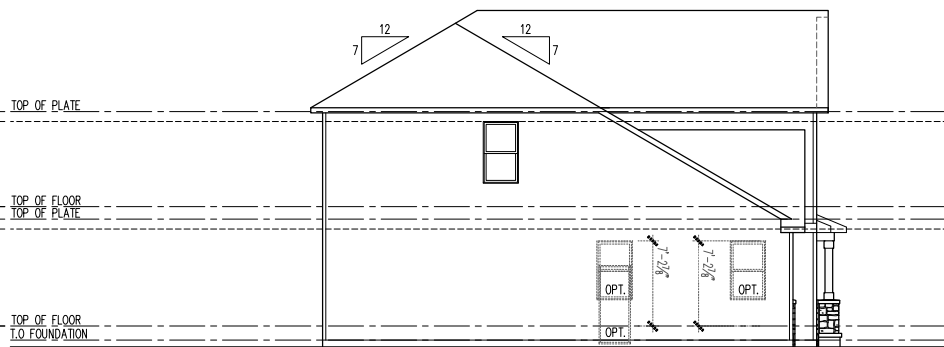

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
2 Car Front Entry  
Heartland 2J-B


PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	01/18/2019
3	11/27/2019
4	PCR REVISIONS

GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Greenfield  
NPC CHILD NUMBER  
1850.302

SHEET  
A3-HR2J-B  
2FB.1

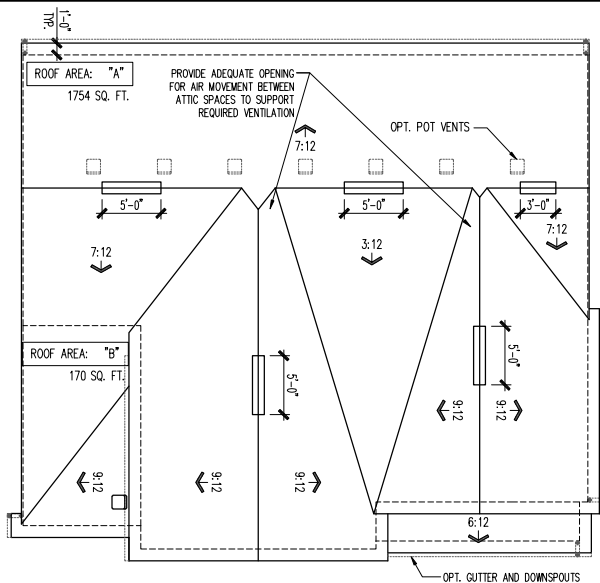


ROOF PLAN  
SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIREMENTS AND TYPICAL VALUES TO BE USED FOR VENT VALUING ARE BASED ON THE FOLLOWING ASSUMPTIONS: 1. VENTILATION IS PROVIDED BY MEANS OF THE VENTS SHOWN IN THIS TABLE. 2. THE VENTS ARE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. 3. THE VENTS ARE MAINTAINED OPEN AT ALL TIMES. 4. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 5. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 6. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 7. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 8. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 9. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS. 10. THE VENTS ARE NOT COVERED BY ANY OTHER MATERIALS.									
Heartland 3M-B									
ROOF AREA "A"		SQ. FT.	1754	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT. LARGE (sq. ft.)	POT. SMALL (sq. ft.)	RIDGE VENT (sq. ft.)	SAVE VENT (sq. ft.)	CONE VENT (sq. ft.)	
HIGH-POT VENT ONLY	3.34	2.92	5.97	49.38	7	0			
AT EAVE	3.31	2.92	3.26	40.79			0	40.00	
TOTAL sq. ft.	5.85	5.85	6.02	100.00					
HIGH-POT VENT	3.34	2.92	2.99	49.46	0	0	23.00		
AT EAVE	3.31	2.92	3.26	51.52			0	40.00	
TOTAL sq. ft.	5.85	5.85	5.93	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"		SQ. FT.	170	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT. LARGE (sq. ft.)	POT. SMALL (sq. ft.)	RIDGE VENT (sq. ft.)	SAVE VENT (sq. ft.)	CONE VENT (sq. ft.)	
HIGH-POT VENT ONLY	0.33	0.33	0.42	49.44	1	0			
AT EAVE	0.34	0.33	0.49	50.44			0	7.00	
TOTAL sq. ft.	0.57	0.57	0.91	100.00					
HIGH-POT VENT	0.33	0.33	0.00	0.00	0	0	0.00		
AT EAVE	0.34	0.33	0.00	0.00			0	0.00	
TOTAL sq. ft.	0.57	0.57	0.00	0.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




NOTE:

"L" FLASHING OVER  
BRICK SILL -  
THRU-WALL  
FLASHING BEHIND  
BRICK WITH WEEP  
HOLES AT 24" ON  
CENTER

FRONT ELEVATION

SCALE: 1/4" = 1'-0"

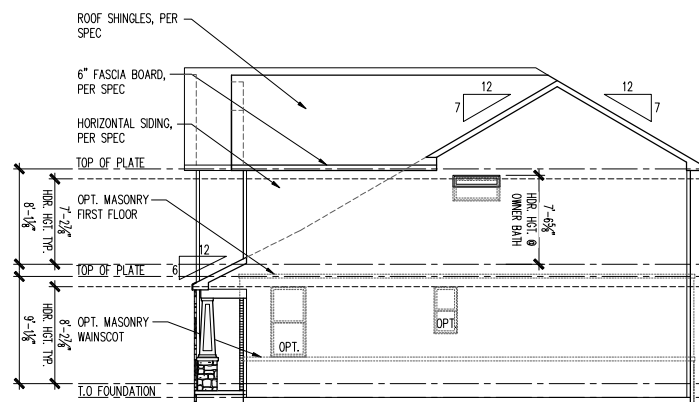


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"



REAR ELEVATION

SCALE: 1/8" = 1'-0"

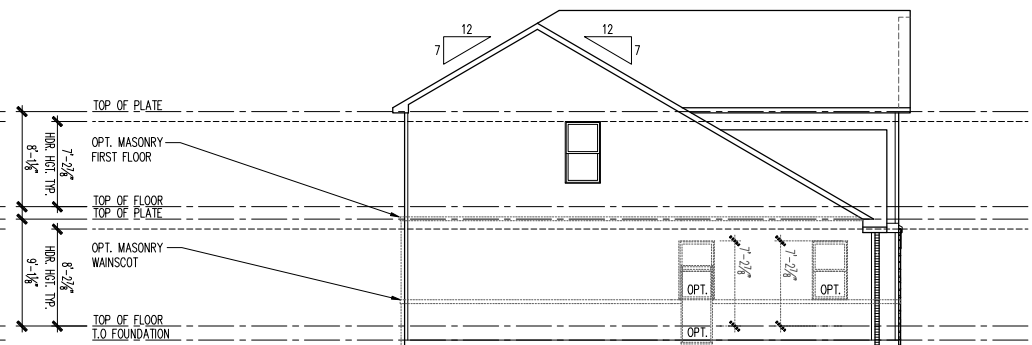

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

(c) Copyright 2019 PulteGroup, Inc.

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry  
Heartland 3M-B

PRODUCT MANAGER  
Rick Starkey  
INITIAL RELEASE  
DATE: 01/18/2019

REV#	DATE/DESCRIPTION
1	01/18/2019 PLAN REFRESH
2	11/27/2019 PCR REVISIONS
3	
4	
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Greenfield  
NPC CHILD NUMBER  
1850.302

SHEET  
A3-HR3M-B  
2FB.1



WINDOW TRIM AND/OR GRIDS (IF REQUIRED) TO MATCH FRONT ELEVATION

VINYL TRIM


DIMENSIONAL TRIM

**SIDE AND REAR WINDOWS PER COMMUNITY SPECS**

SCALE: 1/4" = 1'-0"



**RIGHT ELEVATION**  
SCALE: 1/8" = 1'-0"



SCALE:  $1/8" = 1'-0"$

[illegible]

SCALE:  $1/8" = 1'-0"$


SCALE:  $1/4" = 1'-0"$

SCALE:  $1/4" = 1'-0"$

SCALE:  $1/8" = 1'-0"$


SCALE: 1/8" = 1'-0"



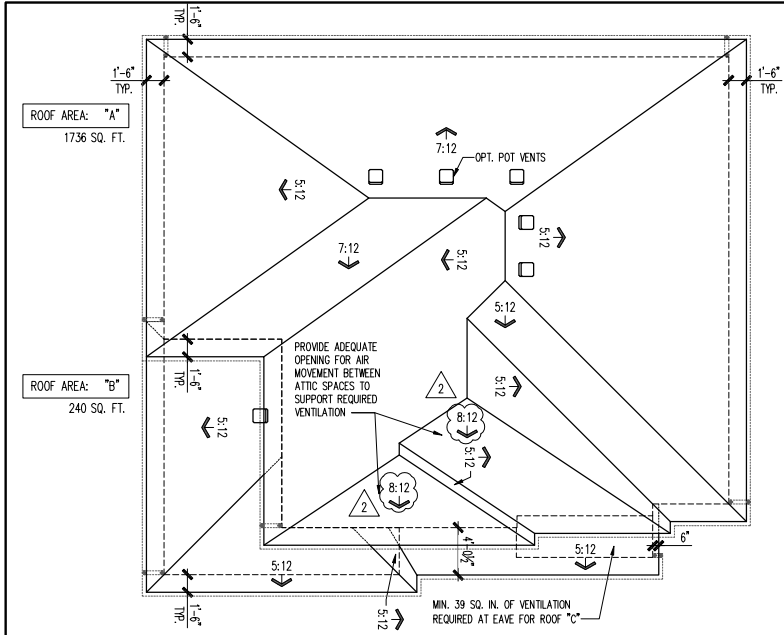

ROOF PLAN  
SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIREMENTS AND TYPICAL VALUES TO BE USED IN PERCENT VENT VALUE SHEET. VENT VALUE SHEET IS TABLE ABOVE. CONTRACTOR INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO ENTIRE ATTIC. REQUIREMENTS: 1. PERCENT OF TOTAL SUPPLY VENTILATION AT 30-40% OF TOTAL AND RISE AT 40-100% OF TOTAL. 2. PERCENT OF TOTAL SUPPLY VENTILATION AT 30-40% OF TOTAL AND RISE AT 40-100% OF TOTAL. 3. PERCENT OF TOTAL SUPPLY VENTILATION AT 30-40% OF TOTAL AND RISE AT 40-100% OF TOTAL.									
Prairie 2M-B									
ROOF AREA "A"		SQ. FT. FIG	1736	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLY	POT. LARGE (SQ. FT.)	POT. SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONE VENT (SQ. FT.)	CONE VENT (SQ. FT.)
HIGH-POLE VENT ONLY	2.31	2.31	0.13	43.75	0	0			43.75
AT EAVE	2.47	2.47	0.14	46.00			0	46.00	
TOTAL (sq. ft.)	5.79	5.79	0.27	89.75					89.75
HIGH-POLE VENT ONLY	2.31	2.31	0.00	0.00	0	0	0.00		
AT EAVE	2.47	2.47	0.00	0.00			0	0.00	
TOTAL (sq. ft.)	5.79	5.79	0.00	0.00					0.00
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"		SQ. FT. FIG	240	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLY	POT. LARGE (SQ. FT.)	POT. SMALL (SQ. FT.)	RIDGE VENT (SQ. FT.)	SAVE VENT (SQ. FT.)	CONE VENT (SQ. FT.)	CONE VENT (SQ. FT.)
HIGH-POLE VENT ONLY	0.23	0.40	0.42	85.41	1	0			85.41
AT EAVE	0.48	0.40	0.42	85.41			0	85.41	
TOTAL (sq. ft.)	0.80	0.80	0.84	170.82					170.82
HIGH-POLE VENT ONLY	0.23	0.40	0.00	0.00	0	0	0.00		
AT EAVE	0.48	0.40	0.00	0.00			0	0.00	
TOTAL (sq. ft.)	0.80	0.80	0.00	0.00					0.00
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

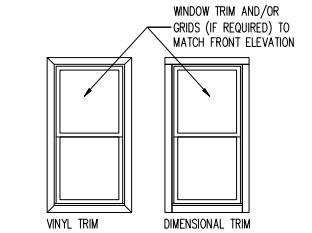


SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS  
SCALE: 1/4" = 1'-0"




FRONT ELEVATION  
SCALE: 1/4" = 1'-0"


NOTE:  
"L" FLASHING OVER  
BRICK SILL -  
THRU-WALL  
FLASHING BEHIND  
BRICK WITH WEEP  
HOLES AT 24" ON  
CENTER

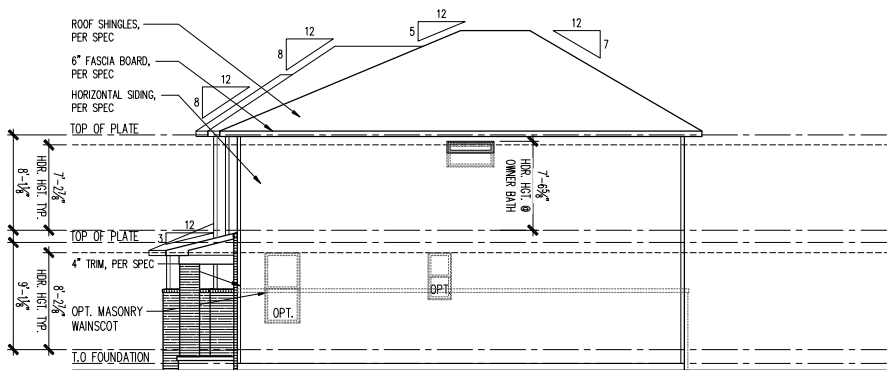

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

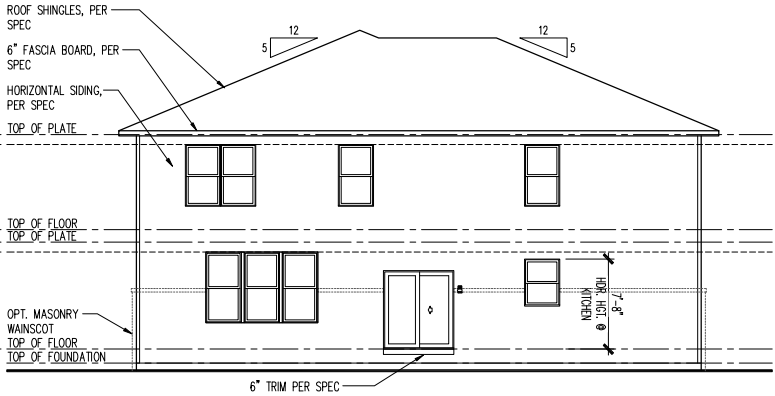


REAR ELEVATION  
SCALE: 1/8" = 1'-0"

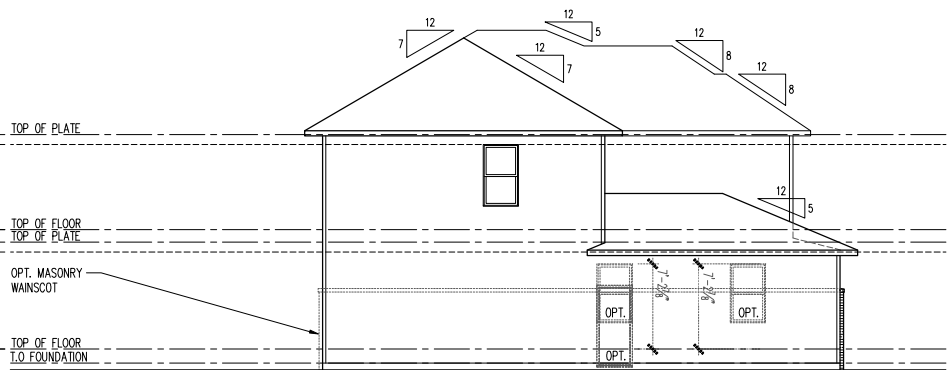

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

# HILLTOP

4-7 Bedrooms | 2.5-5 Bathrooms | 2,899+ sq. ft.  
Spacious, Walk-In Pantry | Everyday Entry® | Large Walk-In Closets

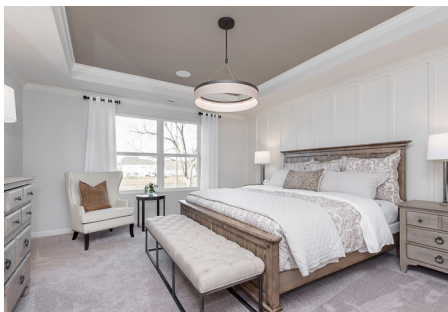




# Hilltop Home Exteriors






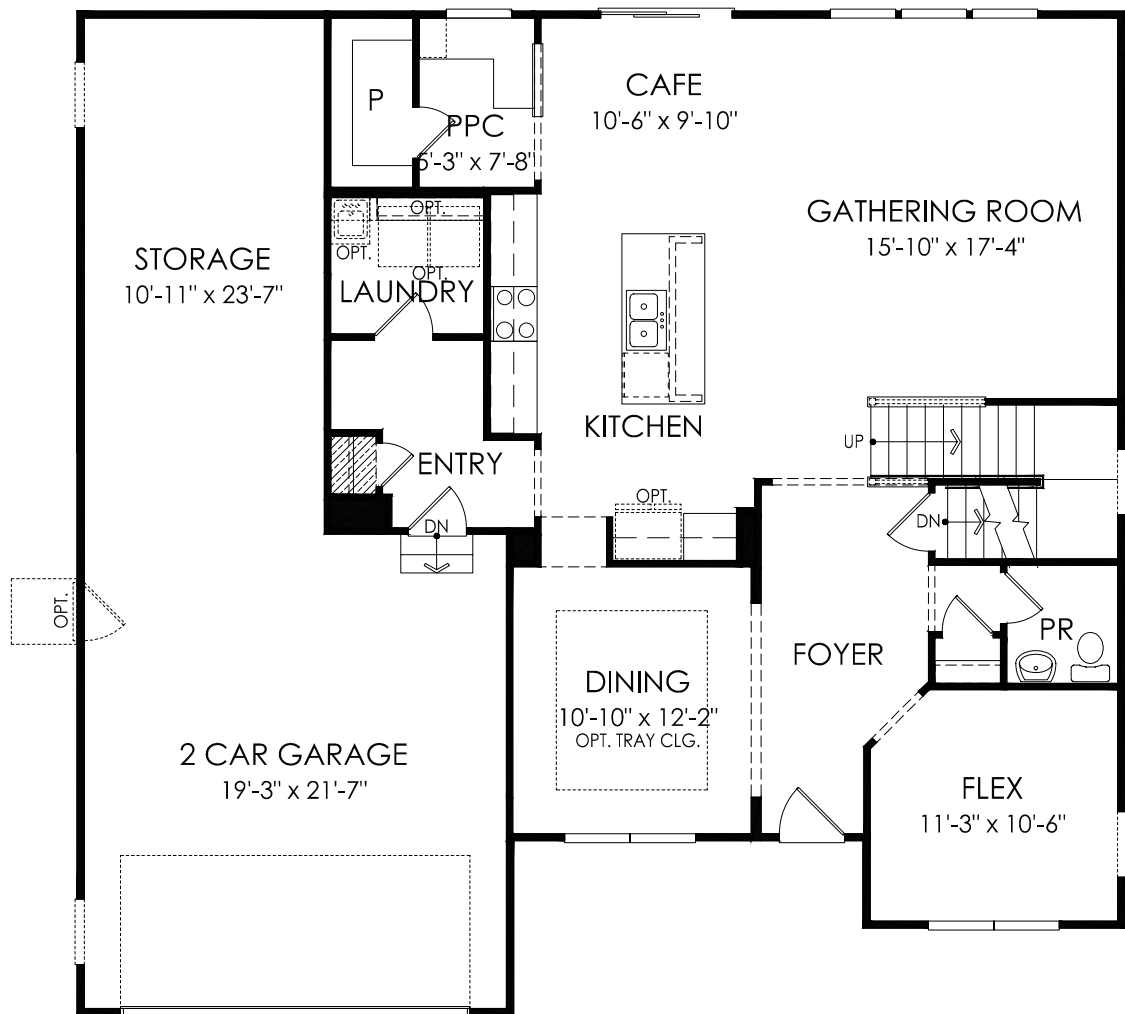

## AVAILABLE OPTIONS

Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on [Pulte.com](https://www.pulte.com).

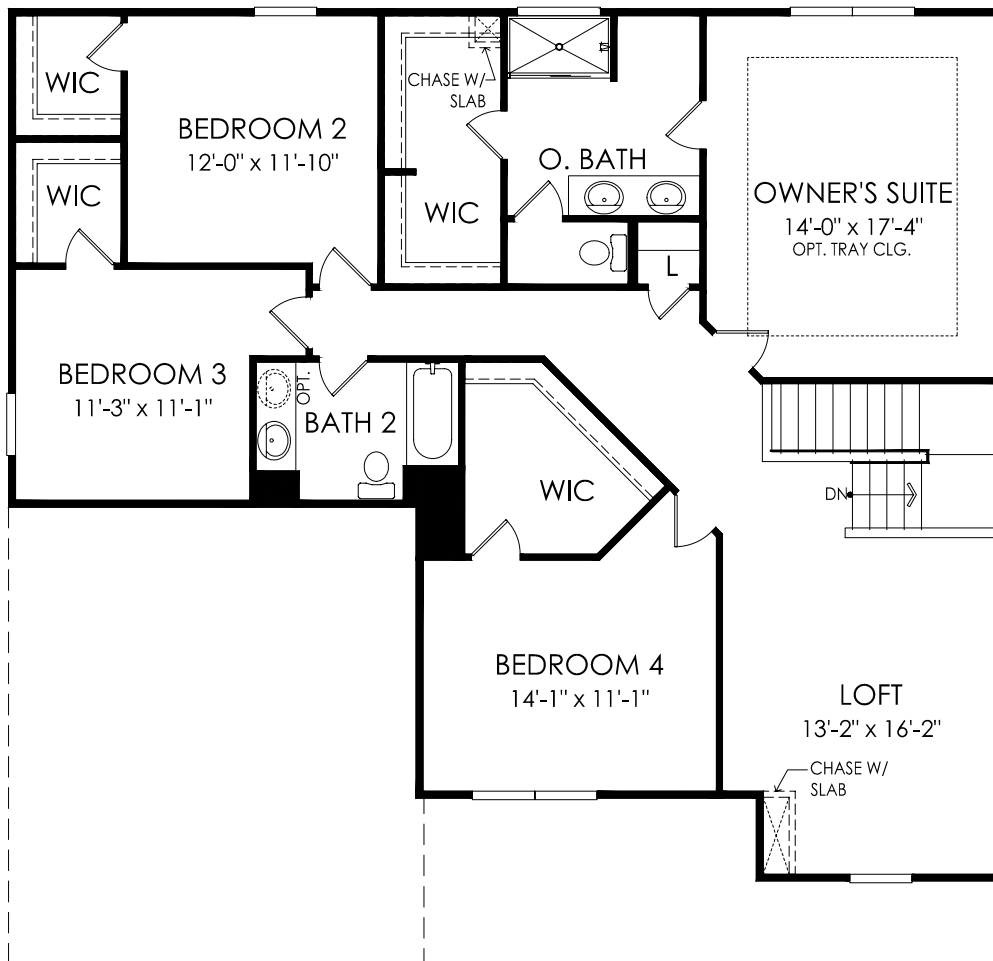


FLOORPLAN NOTES

GENERAL SPECIFICATIONS

1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
2. ALL NON-BEARING WALLS TO BE 2x4 STUDS AT 24" O.C. KITCHEN AND PULTE PLANNING CENTER WALLS, WHERE CABINETS ARE TO BE HUNG, SHALL BE FRAMED AT 16" O.C.
3. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
4. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
5. PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OR STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
6. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
7. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE 1/2" MAX. SHEATHING WITH TAPED JOINTS AS DRAFT STOP WITH BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS ADJACENT TO TUBS AND SHOWERS.
9. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
10. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
11. BASEMENTS, HABITABLE ATTICS AND ALL SLEEPING ROOMS MUST HAVE AT LEAST ONE EMERGENCY ESCAPE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. THE EMERGENCY ESCAPE MUST HAVE A 5.7 S/CLEAR OPENING AND A SILL HEIGHT OF NO MORE THAN 44" ABOVE FINISHED FLOOR. ESCAPE WINDOWS AT GRADE LEVEL MUST HAVE A MIN. OF 5.0 S/C OF OPEN AREA. REQUIRED CLEAR OPENINGS SHALL BE A MINIMUM OF 24" HIGH AND 20" WIDE. EMERGENCY ESCAPES WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GRADE MUST HAVE A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
12. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

Standard in Brownstone, Greystone, Hunters Run, Blue Ridge, Wood Hollow, Lochaven, Westchester, Westmoor, Oakcrest Communities

Standard in Brownstone, Greystone, Hunters Run, Blue Ridge, Wood Hollow, Lochaven, Westchester, Westmoor, Oakcrest Communities

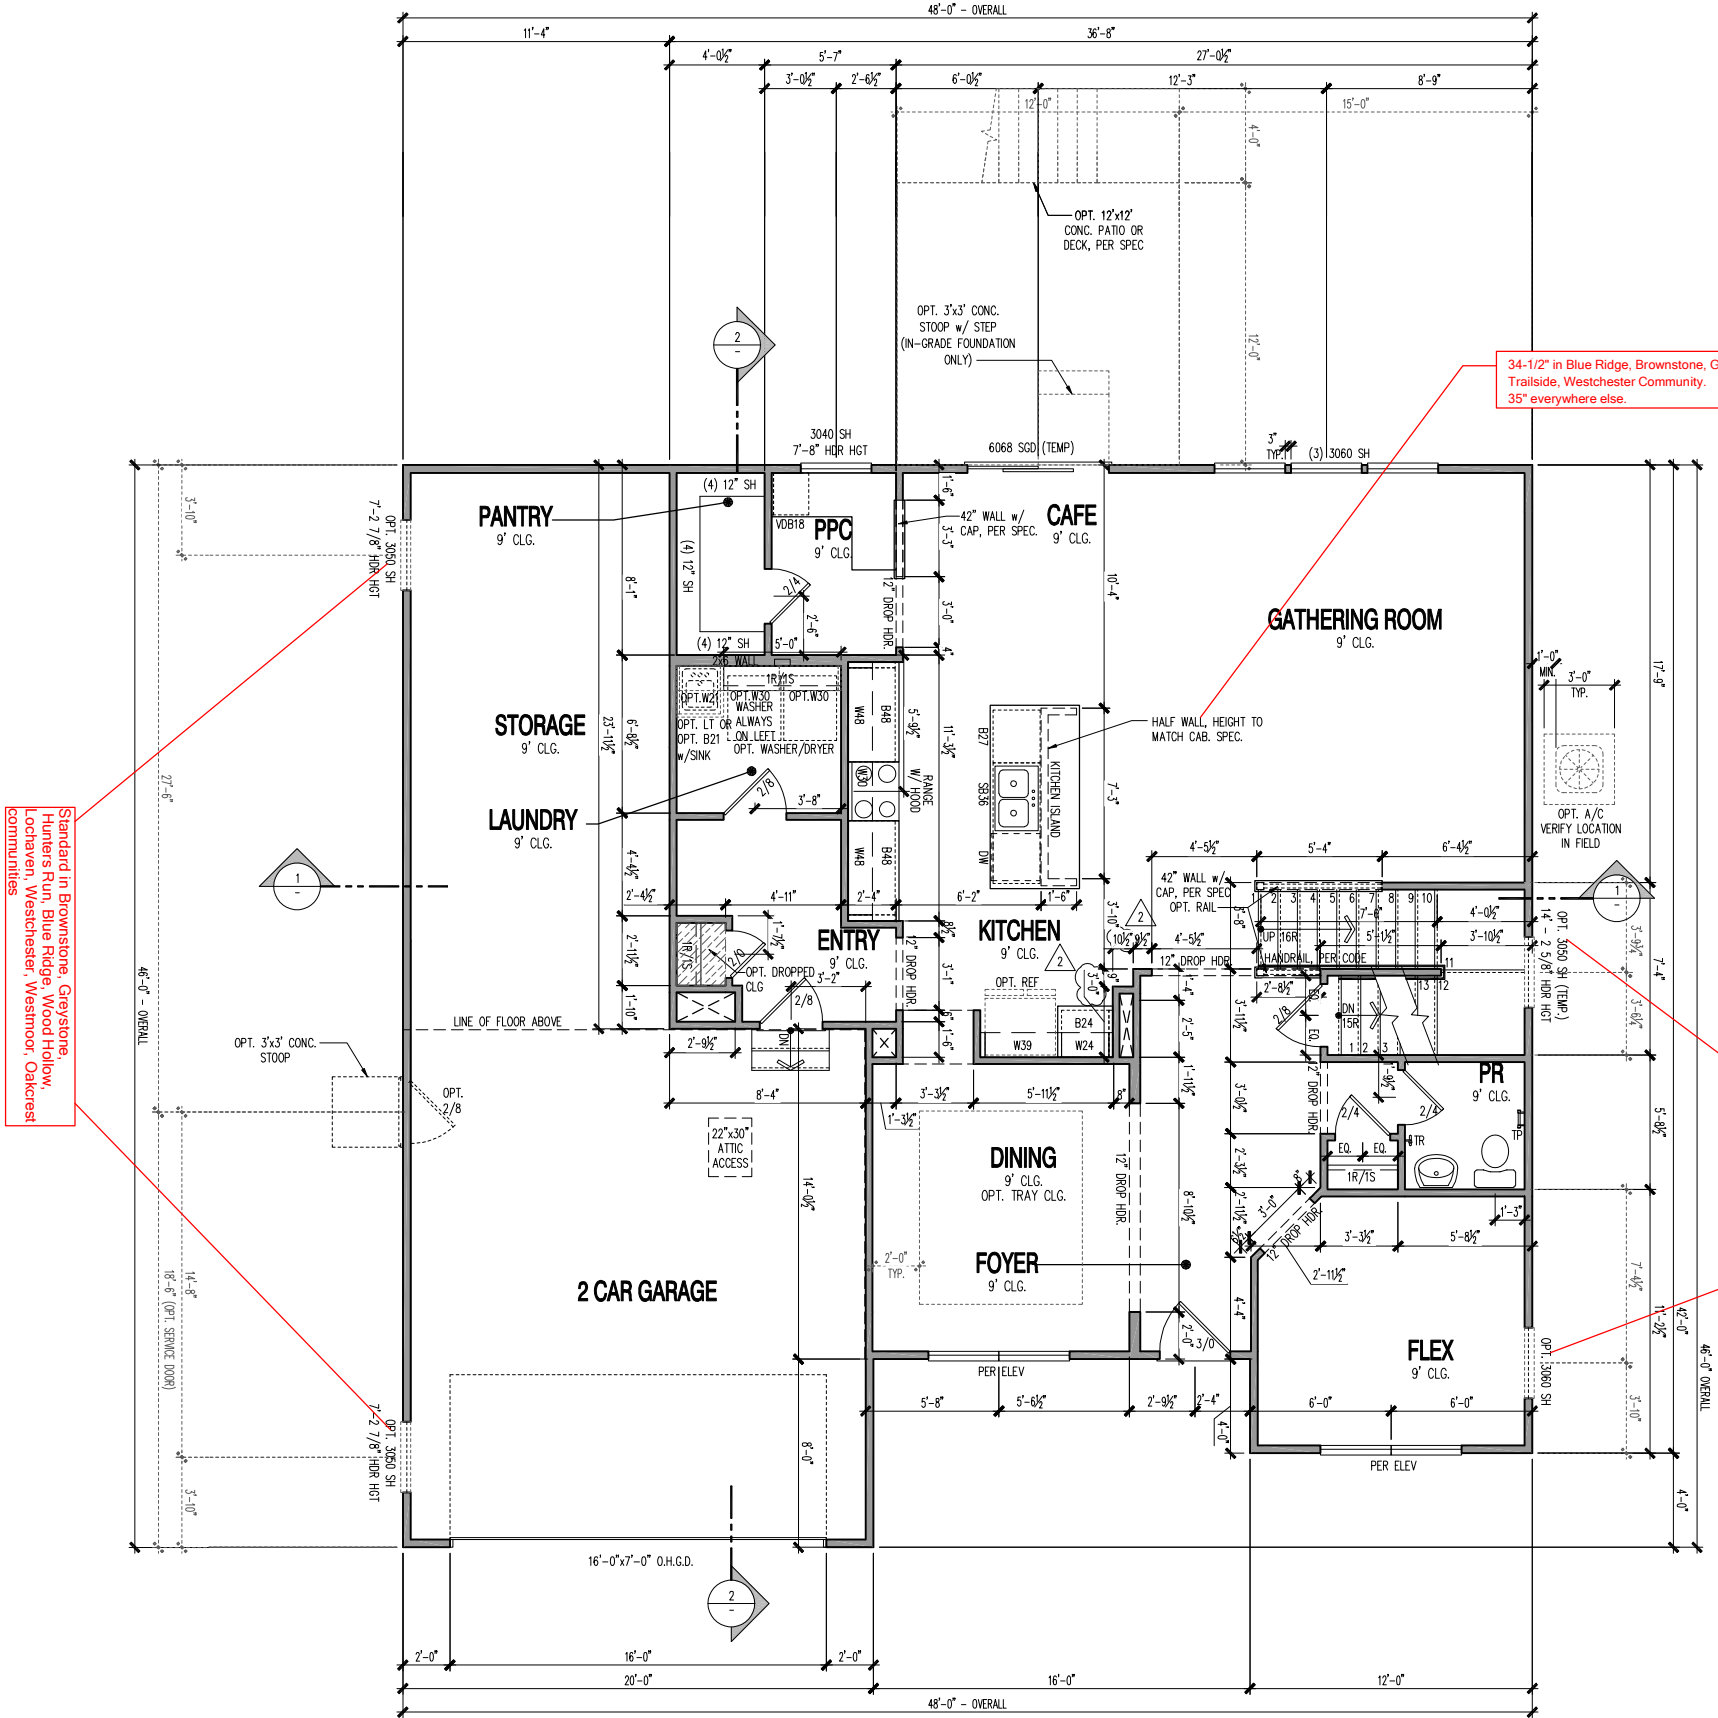

FIRST FLOOR PLAN - 4' EXTERIOR WALLS

SCALE: 1/4" = 1'-0"


PRODUCT MANAGER Rick Starkey	INITIAL RELEASE DATE: 1/18/2019
REV#	DATE/DESCRIPTION
1	1/18/2019
2	PLAN REVISIONS
3	2/15/2019
4	PLAN UPDATES
5	11/27/2019
6	PCR REVISIONS
7	
8	
9	
10	



FLOORPLAN NOTES

GENERAL SPECIFICATIONS

- ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
- ALL NON-BEARING WALLS TO BE 2x4 STUDS AT 24" O.C. KITCHEN AND PULTE PLANNING CENTER WALLS, WHERE CABINETS ARE TO BE HUNG, SHALL BE FRAMED AT 16" O.C.
- PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OR STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE 1/2" MAX. SHEATHING WITH TAPED JOINTS AS DRAFT STOP WITH BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS ADJACENT TO TUBS AND SHOWERS.
- ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
- ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
- BASEMENTS, HABITABLE ATTICS AND ALL SLEEPING ROOMS MUST HAVE AT LEAST ONE EMERGENCY ESCAPE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. THE EMERGENCY ESCAPE MUST HAVE A 5.7" STOLEAR OPENING AND A SILL HEIGHT OF NO MORE THAN 44" ABOVE FINISHED FLOOR. ESCAPE WINDOWS AT GRADE LEVEL MUST HAVE A MIN. OF 5.0 SF OF OPEN AREA. REQUIRED CLEAR OPENINGS SHALL BE A MINIMUM OF 24" HIGH AND 20" WIDE. EMERGENCY ESCAPES WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GRADE MUST HAVE A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
- FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

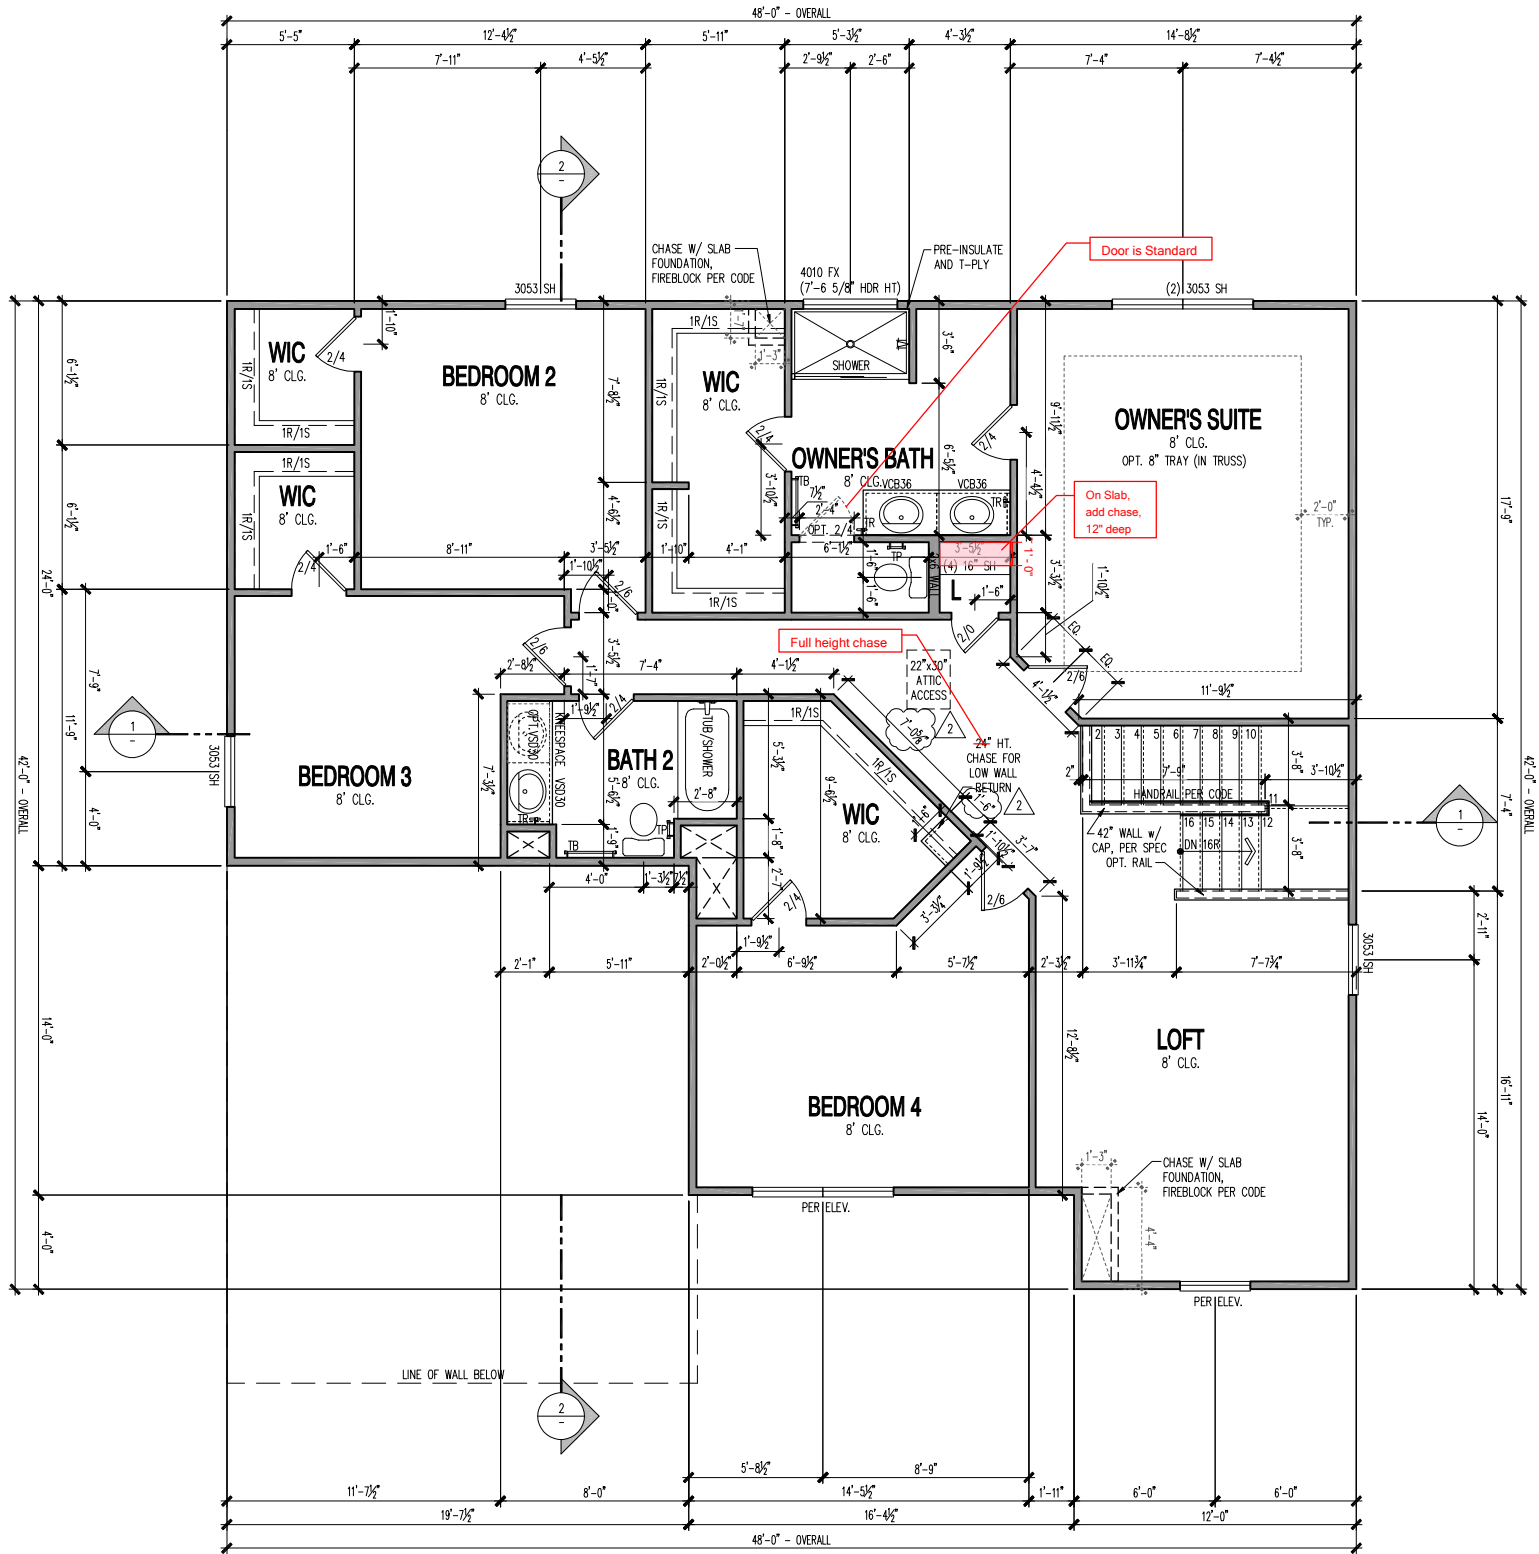

SECOND FLOOR PLAN - 4" EXTERIOR WALLS

SCALE: 1/4" = 1'-0"

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	1/18/2019
REV#	DATE/DESCRIPTION
△	1/18/2019
△	PLAN REVISIONS
△	2/15/2019
△	PLAN UPDATES
△	11/27/2019
△	PCR REVISIONS
△	
△	
△	
△	

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	1/18/2019
REV#	DATE/DESCRIPTION
1	1/18/2019
2	PLAN REVISIONS
3	2/15/2019
4	PLAN UPDATES
5	11/27/2019
6	PCR REVISIONS


GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Hilltop  
NPC CHILD NUMBER  
1851.302

SHEET  
A3-CR2G  
2FB.1


(c) Copyright 2019 PulteGroup, Inc.

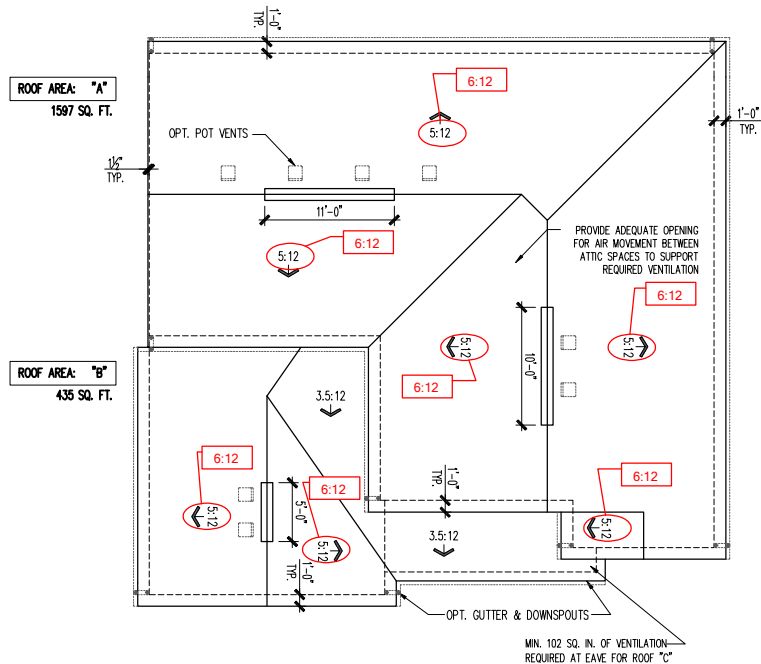

### ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE										
VENTILATION REQUIRED WHEN SUPPLIED IS BASED ON POT VENT VALUES AND ROOF VENT VALUES SHOWN IN TABLE ABOVE. ** CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS. A SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION IS 50-50% OF TOTAL AND ROOF AT 40-50% OF TOTAL REQUIRED VENTILATION.										
Craftsman 2G										
ROOF AREA "A"	SQ. FTG	1997	AT / NEAR RIDGE			AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE BALANCE	POE SMALL BALANCE	RIDGE VENT BALANCE	EAVE VENT BALANCE	CONT. VENT BALANCE		
				61.00	40.00	18.00	28.00	10.00		
WIND-UP VENTS ONLY	5.13 - 5.44	5.44	47.78	4	0					
AT BATH	5.19 - 5.44	5.78	62.32					0	40.00	
TOTAL 1999	5.32 - 5.32	5.32	100.00							
WIND-UP VENTS ONLY	5.13 - 5.44	5.44	48.39	0	0	31.00				
AT BATH	5.19 - 5.44	5.78	51.61				0	40.00		
TOTAL 1999	5.32 - 5.32	5.40	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE						
Craftsman 2G										
ROOF AREA "B"	SQ. FTG	435	AT / NEAR RIDGE			AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE BALANCE	POE SMALL BALANCE	RIDGE VENT BALANCE	EAVE VENT BALANCE	CONT. VENT BALANCE		
				61.00	40.00	18.00	28.00	10.00		
WIND-UP VENTS ONLY	0.88 - 0.73	0.88	46.56	2	0					
AT BATH	0.87 - 0.73	0.87	83.44				0	14.00		
TOTAL 1999	1.45 - 1.45	1.82	100.00							
WIND-UP VENTS ONLY	0.88 - 0.73	0.88	49.84	0	0	8.00				
AT BATH	0.87 - 0.73	0.88	87.14				0	15.00		
TOTAL 1999	1.45 - 1.45	1.46	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE						

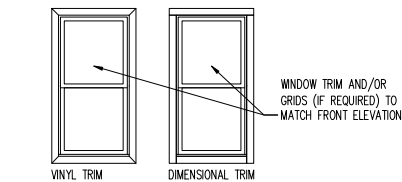


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

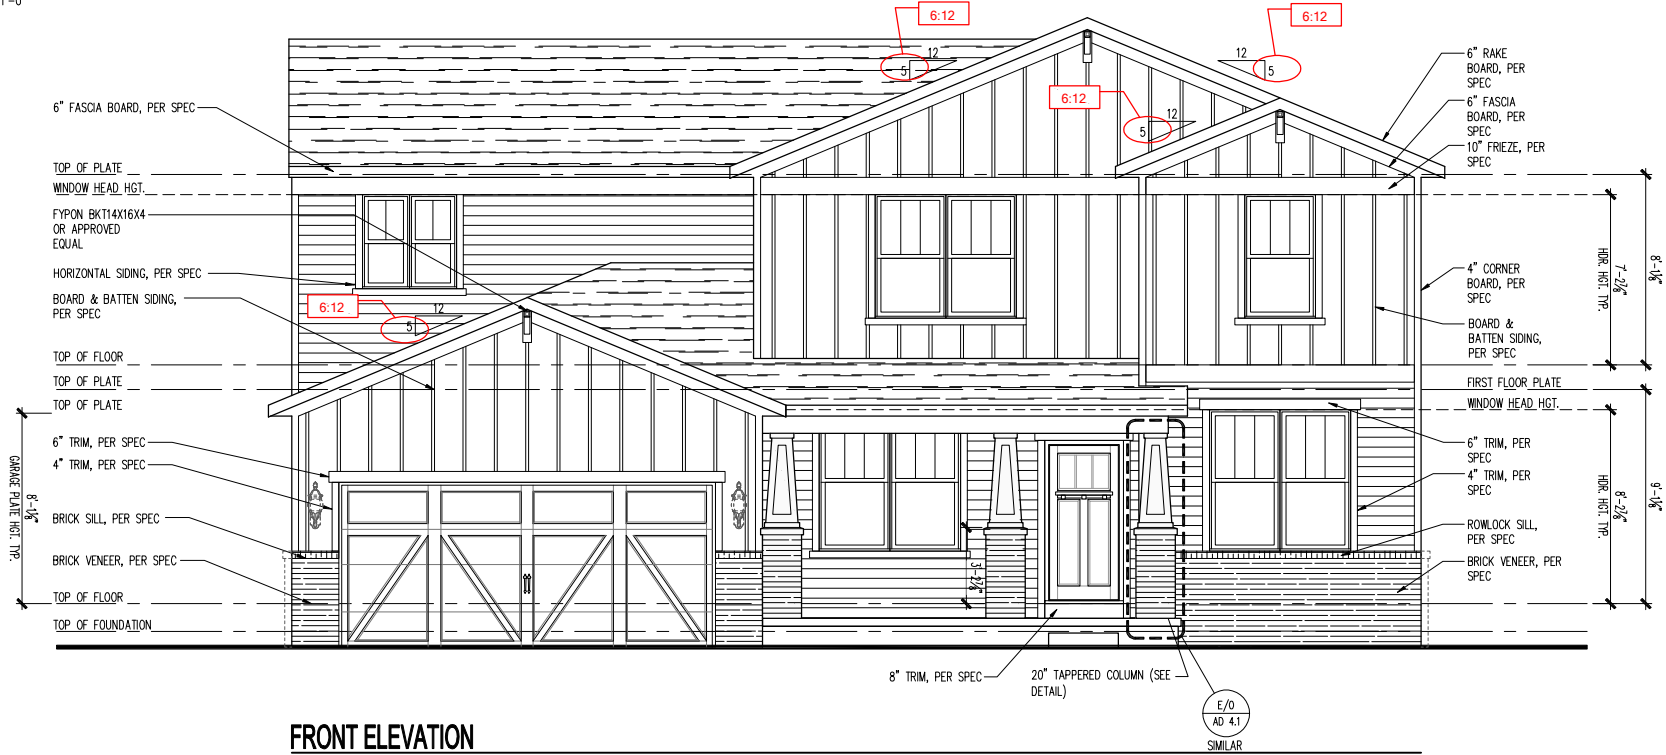


### FRONT ELEVATION

SCALE: 1/4" = 1'-0"

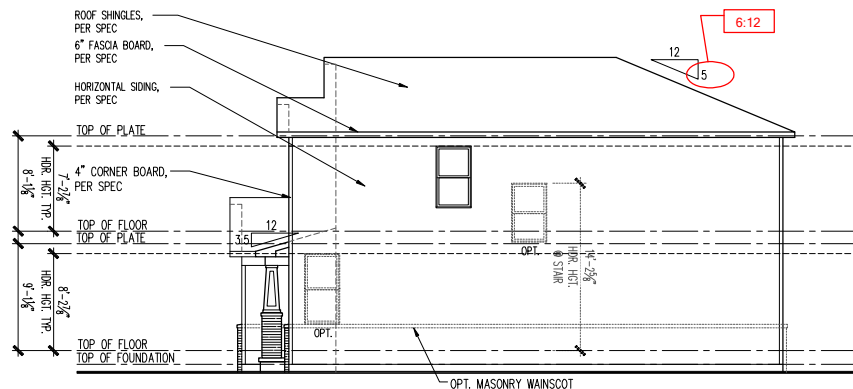


### RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

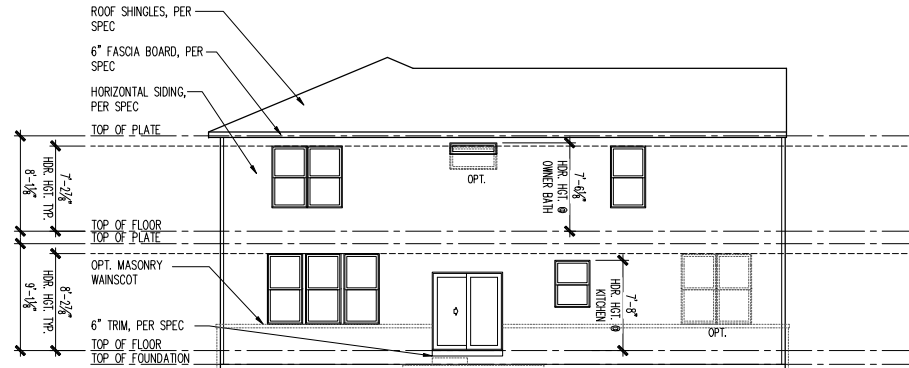

### REAR ELEVATION


SCALE: 1/8" = 1'-0"

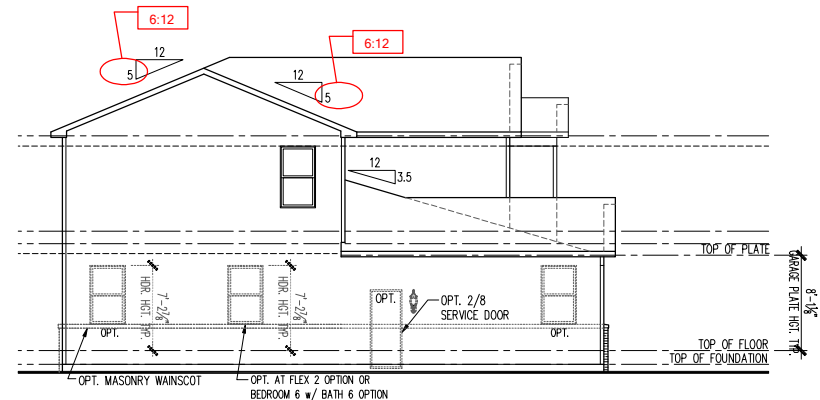






### LEFT ELEVATION

SCALE: 1/8" = 1'-0"






SCALE:  $1/8" = 1'-0"$






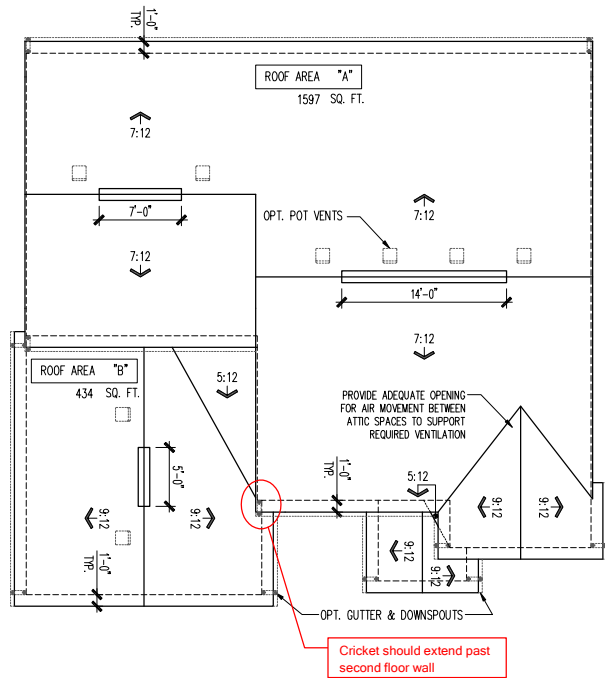


ROOF PLAN  
 SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUED AND ROOF VENT VALUES SHOWN IN TABLE ABOVE. * CONTRACTORS RETAINING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS. A SCHEDULE HAS BEEN CALCULATED ASSUMING EACH VENTILATOR IS 50% OF TOTAL AND ROOF IS AT 40% OF TOTAL REQUIRED VENTILATION.									
Heartland 2G									
ROOF AREA "A"	SQ. FTG	1597	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE BALANCE	POT SMALL BALANCE	RIDGE VENT BALANCE	EAVE VENT BALANCE	CONC. VENT BALANCE	
WIND-UP VENTS ONLY	5.13	5.44	5.44	47.78	6	0			
AT BATH	5.19	5.44	5.78	63.33				0	40.00
TOTAL 1944	5.32	5.32	5.32	100.00					
WIND-UP ROOF VENTS	5.13	5.44	5.45	48.9	0	0	31.00		40.00
AT BATH	5.19	5.44	5.78	51.61				0	40.00
TOTAL 1944	5.32	5.32	5.40	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"	SQ. FTG	434	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE BALANCE	POT SMALL BALANCE	RIDGE VENT BALANCE	EAVE VENT BALANCE	CONC. VENT BALANCE	
WIND-UP VENTS ONLY	0.88	0.73	0.83	46.86	2	0			
AT BATH	0.87	0.73	0.77	63.44				0	14.00
TOTAL 1944	1.45	1.45	1.82	100.00					
WIND-UP ROOF VENTS	0.88	0.73	0.83	43.84	0	0	8.00		15.00
AT BATH	0.87	0.73	0.80	57.14				0	15.00
TOTAL 1944	1.45	1.45	1.46	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

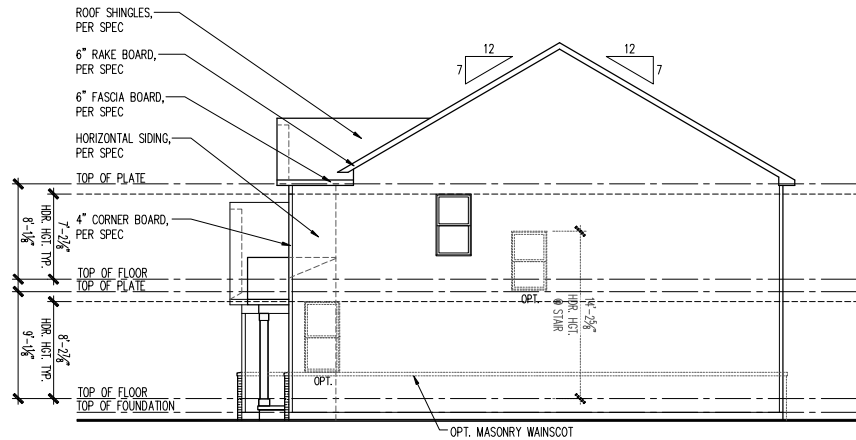


RIGHT ELEVATION  
 SCALE: 1/8" = 1'-0"

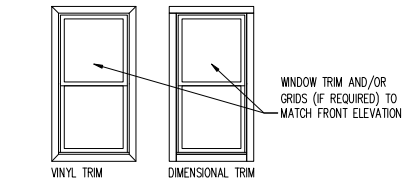


SIDE AND REAR WINDOWS PER  
 COMMUNITY SPECS  
 SCALE: 1/4" = 1'-0"



FRONT ELEVATION  
 SCALE: 1/4" = 1'-0"

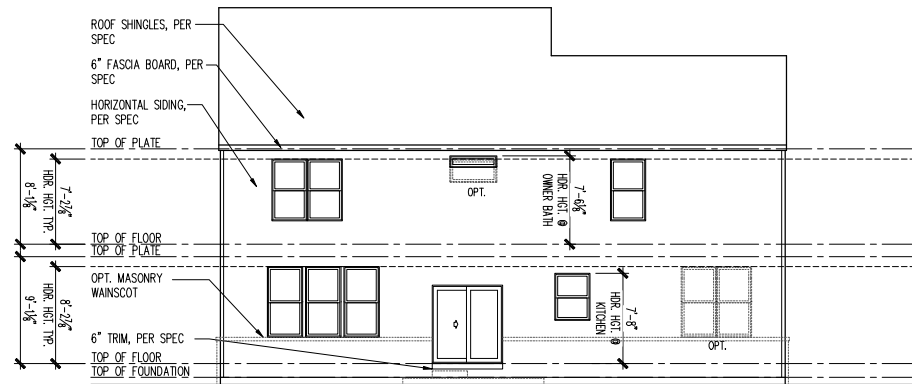


REAR ELEVATION  
 SCALE: 1/8" = 1'-0"

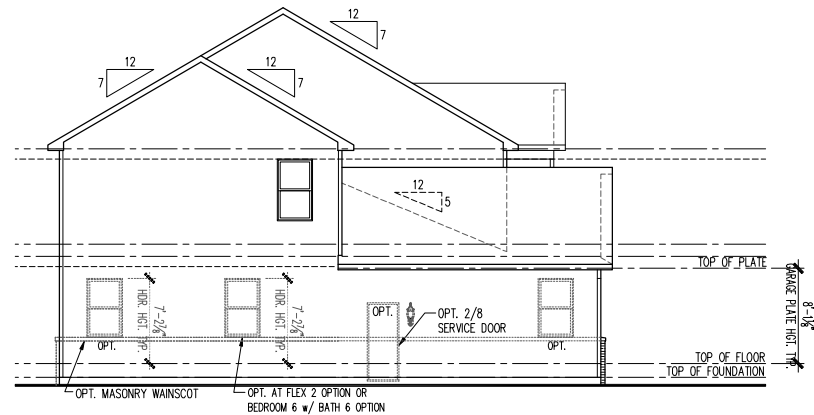

LEFT ELEVATION  
 SCALE: 1/8" = 1'-0"


PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 1/18/2019	
REV#	DATE/DESCRIPTION
1	1/18/2019
2	PLAN REVISIONS
3	2/15/2019
4	PLAN UPDATES
5	11/27/2019
6	PCR REVISIONS
7	
8	
9	
10	

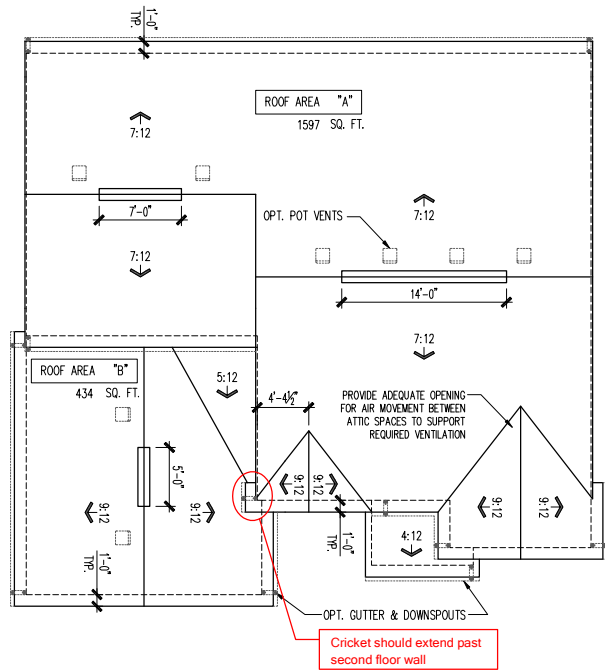

ROOF PLAN

SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE										
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUED AND ROOF VENT VALUED SHOWN IN TABLE ABOVE. * CONTRACTORS RETAINING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS. A SCHEDULE HAS BEEN CALCULATED ASSUMING EACH VENTILATOR IS 50% OF TOTAL AND ROOF AT 40% OF TOTAL REQUIRED VENTILATION.										
Heartland 2H										
ROOF AREA "A"	SQ. FT.	1597	AT / NEAR RIDGE				AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE BALANCE	POT SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE	CONC. VENT BALANCE	CONC. VENT BALANCE
WIND-UP VENT ONLY	5.15	5.44	5.44	47.78	6	0				
AT BATH	5.19	5.44	5.78	63.33				0	40.00	
TOTAL 1944	5.32	5.32	5.32	100.00						
WIND-UP VENT ONLY	5.15	5.44	5.44	47.78	0	0	31.00			
AT BATH	5.19	5.44	5.78	63.33				0	40.00	
TOTAL 1944	5.32	5.32	5.40	100.00						
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										
ROOF AREA "B"	SQ. FT.	434	AT / NEAR RIDGE				AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE BALANCE	POT SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE	CONC. VENT BALANCE	CONC. VENT BALANCE
WIND-UP VENT ONLY	0.88	0.73	0.83	48.84	2	0				
AT BATH	0.87	0.73	0.77	63.44				0	14.00	
TOTAL 1944	1.45	1.45	1.82	100.00						
WIND-UP VENT ONLY	0.88	0.73	0.83	48.84	0	0	8.00			
AT BATH	0.87	0.73	0.83	61.14				0	15.00	
TOTAL 1944	1.45	1.45	1.46	100.00						
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										

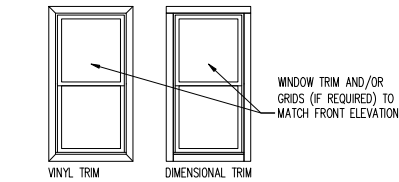


SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




FRONT ELEVATION

SCALE: 1/4" = 1'-0"

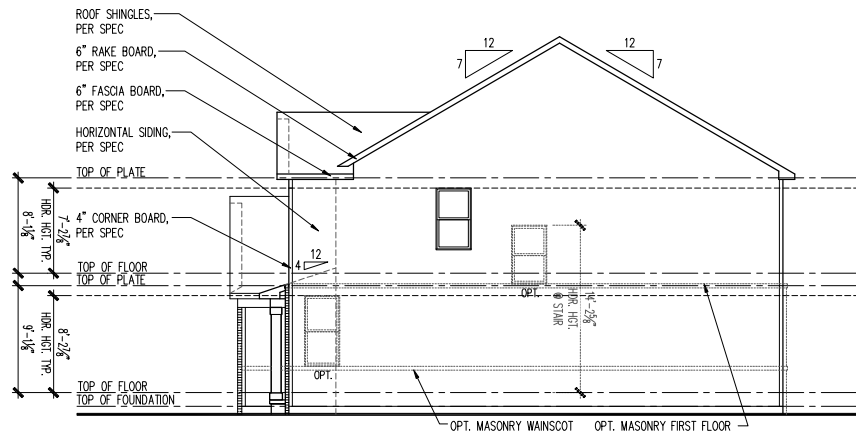


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

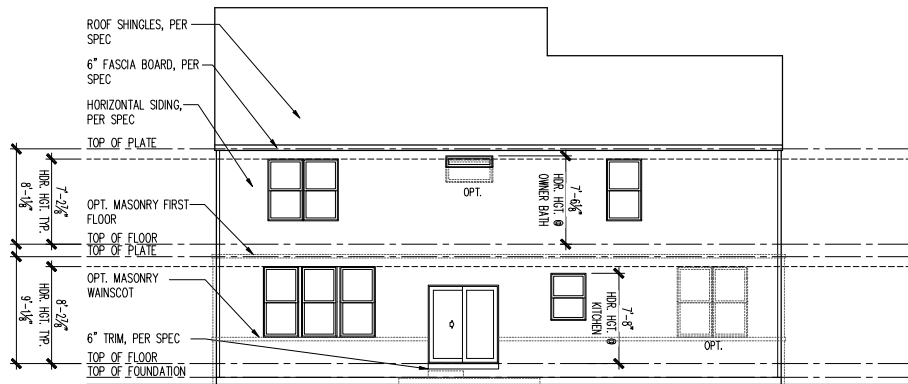

REAR ELEVATION


SCALE: 1/8" = 1'-0"

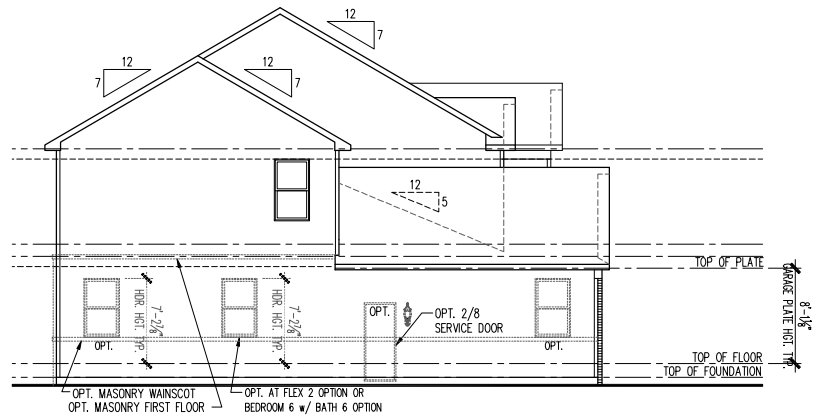

LEFT ELEVATION

SCALE: 1/8" = 1'-0"


PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	1/18/2019
REV#	DATE/DESCRIPTION
1	1/18/2019
2	PLAN REVISIONS
3	2/15/2019
4	PLAN UPDATES
5	11/27/2019
6	PCR REVISIONS
7	
8	
9	
10	

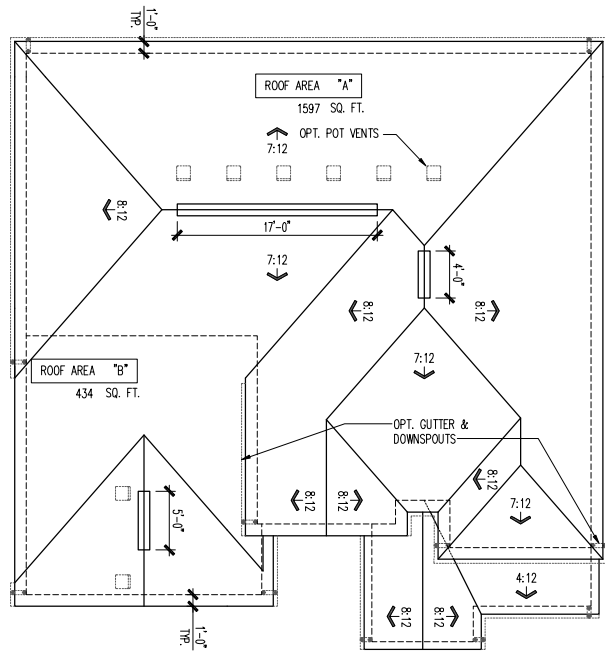

### ROOF PLAN

SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
Heartland 2i									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RODGE VENT BALANCE	SAVE VENT BALANCE	CONC. VENT BALANCE	
WIND-UP VENT ONLY	5.15	5.44	5.44	47.28	4	0			
AT BATH	5.19	5.44	5.78	63.33			0	40.00	
TOTAL 1994	5.32	5.32	5.32	100.00					
WIND-UP VENT ONLY	5.15	5.44	5.44	42.99	0	0	31.00		
AT BATH	5.19	5.44	5.78	51.61			0	40.00	
TOTAL 1994	5.32	5.32	5.40	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RODGE VENT BALANCE	SAVE VENT BALANCE	CONC. VENT BALANCE	
WIND-UP VENT ONLY	0.88	0.73	0.88	48.84	2	0			
AT BATH	0.87	0.73	0.77	63.44			0	14.00	
TOTAL 1994	1.45	1.45	1.82	100.00					
WIND-UP VENT ONLY	0.88	0.73	0.88	42.84	0	0	8.00		
AT BATH	0.87	0.73	0.88	51.14			0	15.00	
TOTAL 1994	1.45	1.45	1.46	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RODGE VENT BALANCE	SAVE VENT BALANCE	CONC. VENT BALANCE	
WIND-UP VENT ONLY	0.88	0.73	0.88	48.84	2	0			
AT BATH	0.87	0.73	0.77	63.44			0	14.00	
TOTAL 1994	1.45	1.45	1.82	100.00					
WIND-UP VENT ONLY	0.88	0.73	0.88	42.84	0	0	8.00		
AT BATH	0.87	0.73	0.88	51.14			0	15.00	
TOTAL 1994	1.45	1.45	1.46	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

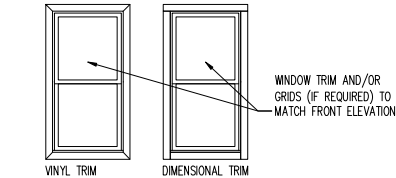


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




### FRONT ELEVATION

SCALE: 1/4" = 1'-0"

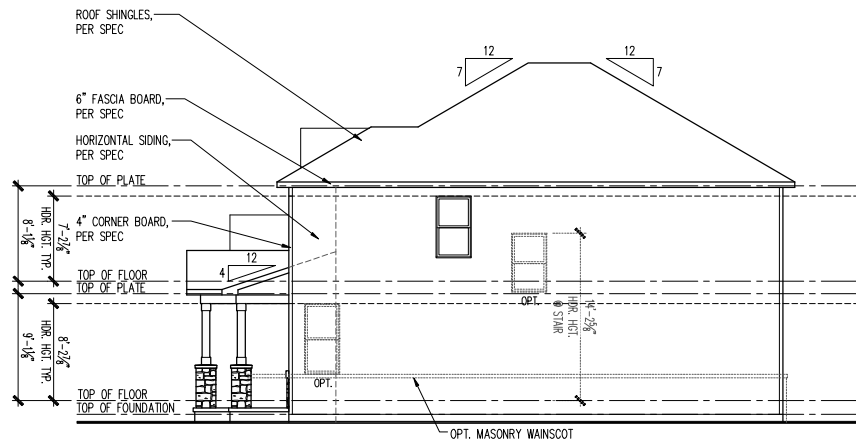


### RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

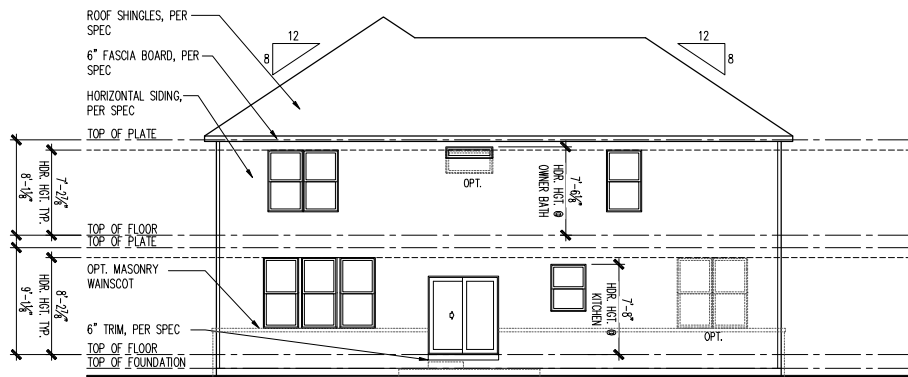

### REAR ELEVATION

SCALE: 1/8" = 1'-0"

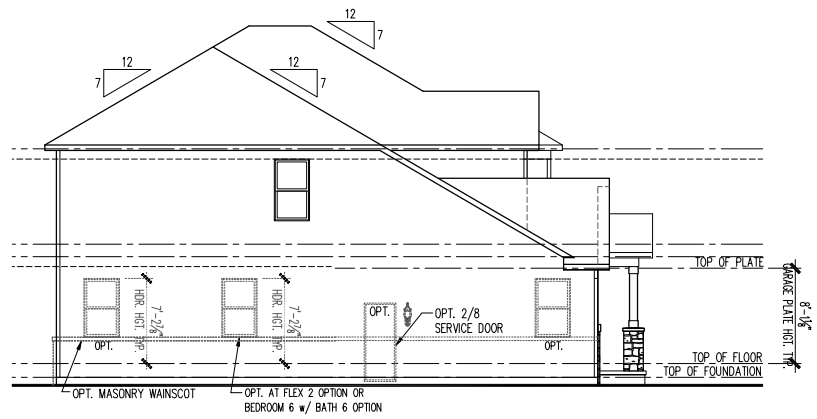

### LEFT ELEVATION

SCALE: 1/8" = 1'-0"

PLOTTED: November 5, 2019 / Annie Lee / A3-HR2I 2FB.LWG

**Midwest Zone Office**  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



**Front, Side and Rear Elevations**  
**2 Car Front Entry**  
**Heartland 2i**

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	1/18/2019
REV#	DATE/DESCRIPTION
1	1/18/2019
2	2/15/2019
3	11/27/2019
4	
5	
6	
7	
8	
9	
10	

**GARAGE HANDING**  
**Single Family**


**SPECIFICATION LEVEL**

**PLAN NAME**  
**Hilltop**  
NPC CHILD NUMBER  
1851.302

**SHEET**  
**A3-HR2I**  
**2FB.1**






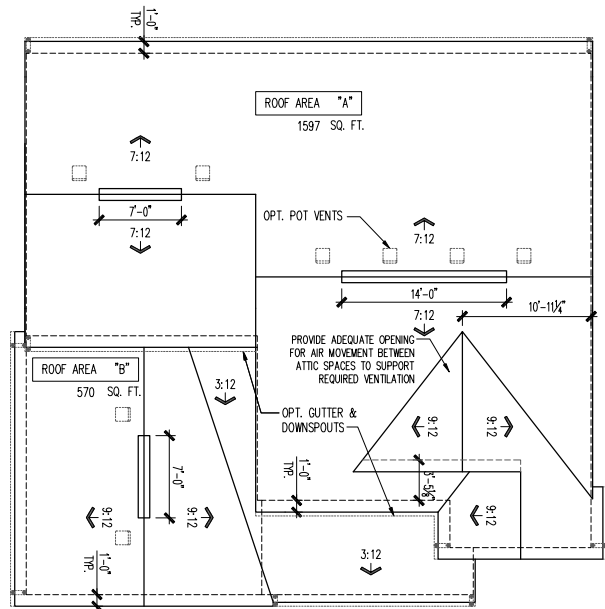

### ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE										
Heartland 3S										
ROOF AREA "A"	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE		
HEARTLAND 3S	513	544	5.54	47.28	6	0				
AT BATH	5.19	5.44	5.78	62.32				0	40.00	
TOTAL 1944	5.32	5.32	5.32	100.00						
HEARTLAND 3S	513	544	5.54	47.28	0	0	31.00			
AT BATH	5.19	5.44	5.78	51.61				0	40.00	
TOTAL 1944	5.32	5.32	5.40	100.00						
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										
ROOF AREA "B"	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE		
HEARTLAND 3S	513	544	5.54	47.28	2	0				
AT BATH	1.54	0.98	1.11	64.74				0	16.00	
TOTAL 1944	1.90	1.90	1.96	100.00						
HEARTLAND 3S	513	544	5.54	47.28	0	0	7.00			
AT BATH	1.54	0.98	1.04	64.36				0	16.00	
TOTAL 1944	1.90	1.90	1.92	100.00						
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										

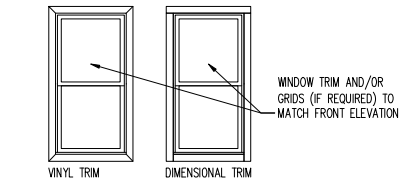


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

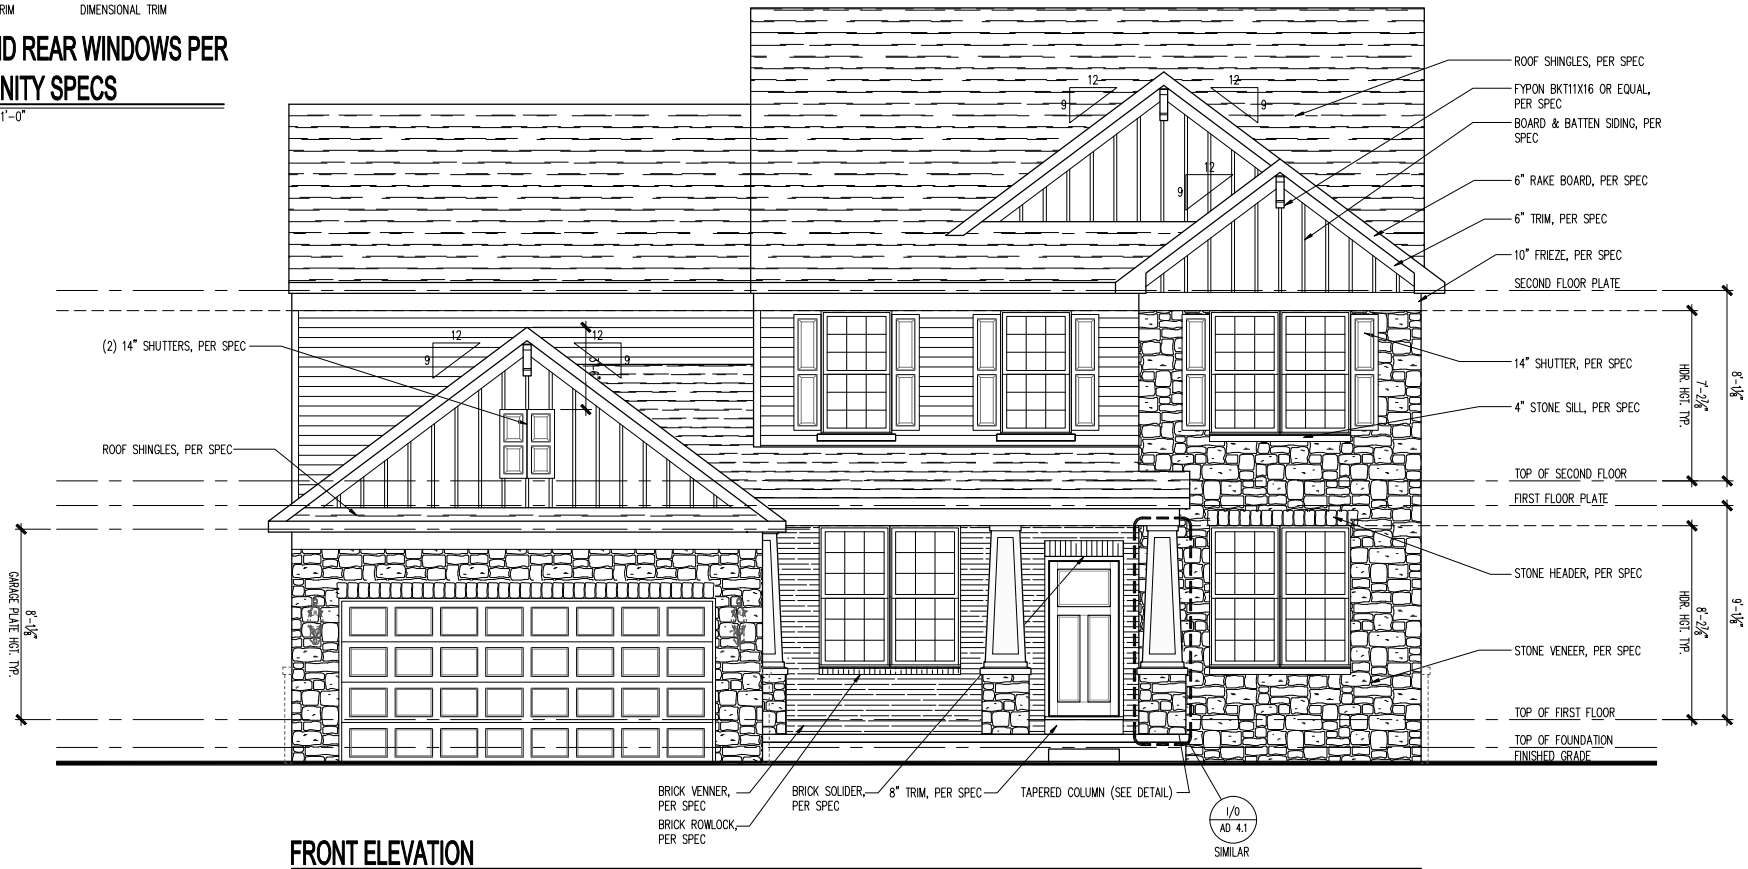


### FRONT ELEVATION

SCALE: 1/4" = 1'-0"

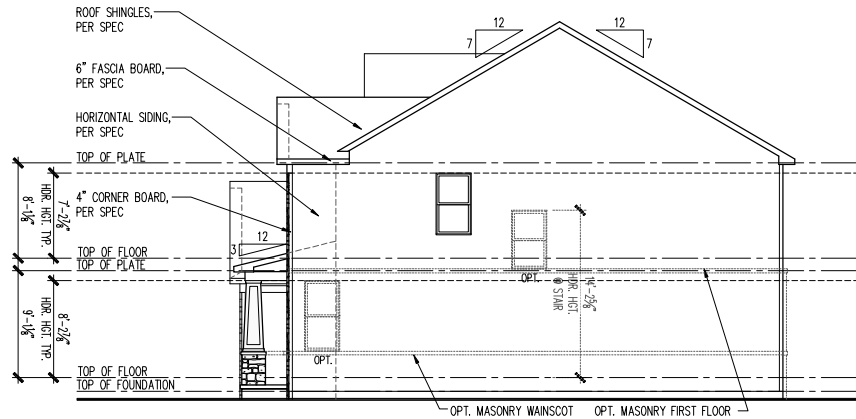


### RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

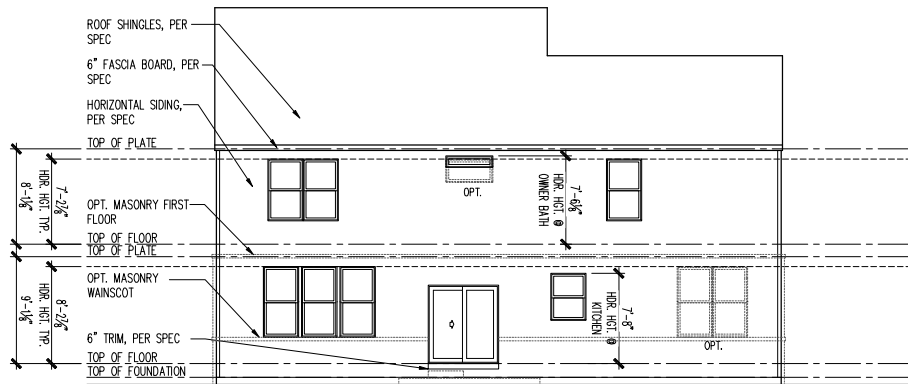

### REAR ELEVATION

SCALE: 1/8" = 1'-0"

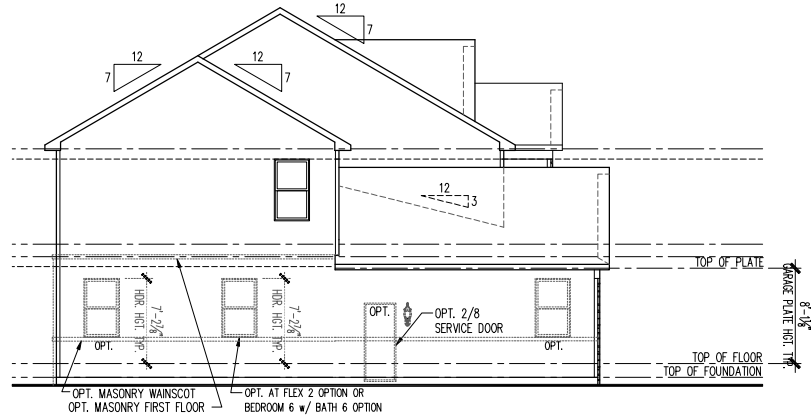

### LEFT ELEVATION

SCALE: 1/8" = 1'-0"

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
2 Car Front Entry  
Heartland 3S


PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	1/18/2019
REV#	DATE/DESCRIPTION
1	1/18/2019
2	2/15/2019
3	11/27/2019
4	
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
Single Family

SPECIFICATION LEVEL

PLAN NAME  
Hilltop  
NPC CHILD NUMBER  
1851.302


SHEET  
A3-HR3S  
2FB.1

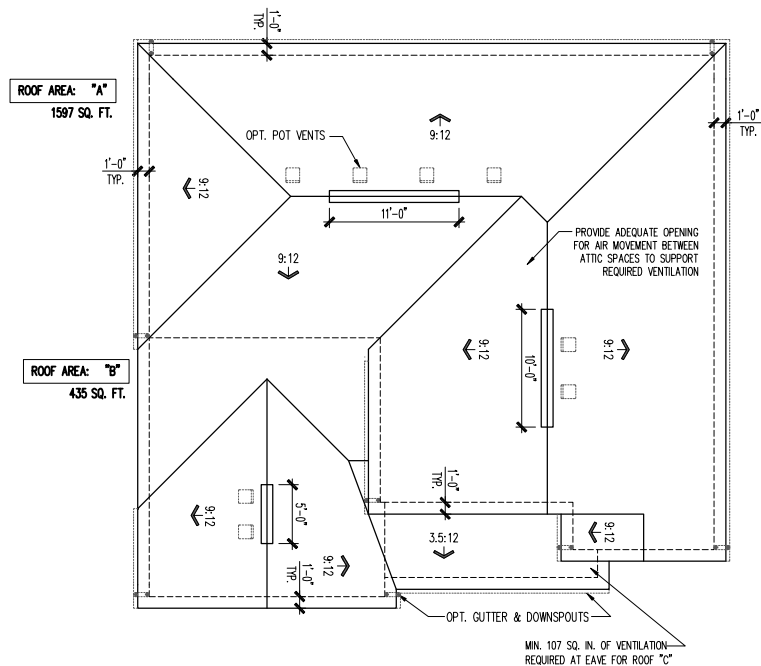

### ROOF PLAN

SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND ROOF VENT VALUES SHOWN IN TABLE ABOVE. * CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS. A SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION IS 50% OF TOTAL AND RIDGE AT 40% OF TOTAL REQUIRED VENTILATION.									
Northern Craftsman 2G									
ROOF AREA "A"	SQ. FTG	1597	AT / NEAR RIDGE				AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE	
WIND-UP VENTS ONLY	5.13	5.44	5.44	47.76	6	0			
AT BATH	5.19	5.44	5.76	63.33			0	40.00	
TOTAL 1944	5.32	5.32	5.32	100.00					
WIND-UP VENTS ONLY	5.13	5.44	5.44	47.76	0	0	51.00		
AT BATH	5.19	5.44	5.76	51.61			0	40.00	
TOTAL 1944	5.32	5.32	5.40	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									
ROOF AREA "B"	SQ. FTG	435	AT / NEAR RIDGE				AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOR LARGE BALANCE	FOR SMALL BALANCE	RIDGE VENT BALANCE	SAVE VENT BALANCE	CONT. VENT BALANCE	
WIND-UP VENTS ONLY	0.88	0.73	0.83	46.86	2	0			
AT BATH	0.87	0.73	0.77	63.44			0	14.00	
TOTAL 1944	1.45	1.45	1.82	100.00					
WIND-UP VENTS ONLY	0.88	0.73	0.83	46.86	0	0	8.00		
AT BATH	0.87	0.73	0.83	51.14			0	15.00	
TOTAL 1944	1.45	1.45	1.46	100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE									

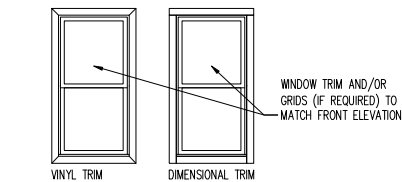


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




### FRONT ELEVATION

SCALE: 1/4" = 1'-0"

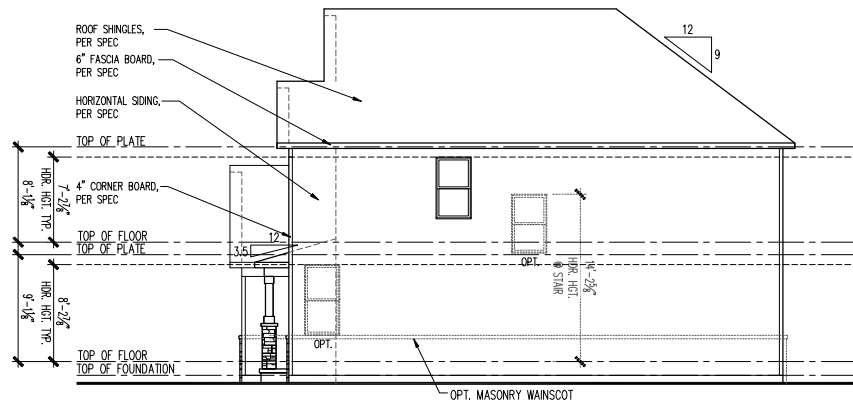


### RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

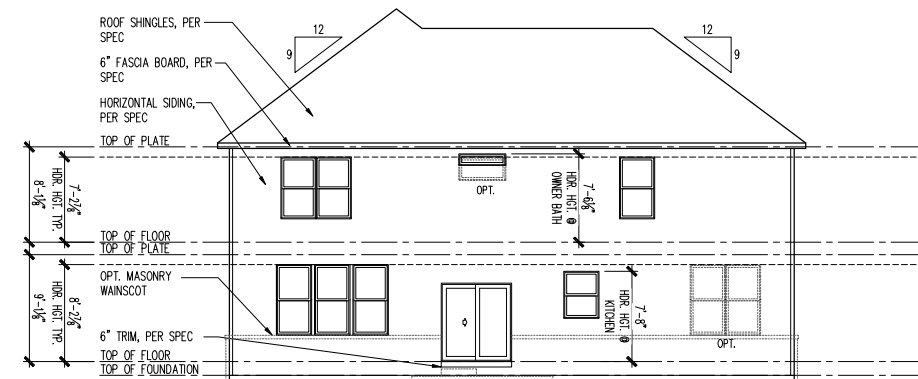

### REAR ELEVATION

SCALE: 1/8" = 1'-0"

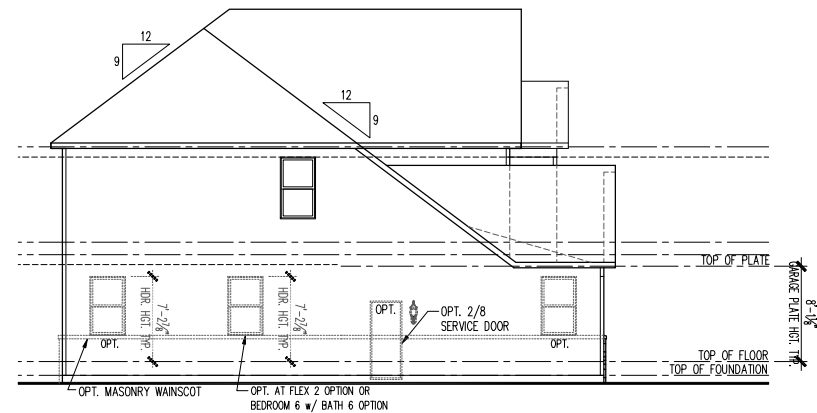

### LEFT ELEVATION

SCALE: 1/8" = 1'-0"





# RIVERTON


4-6 Bedrooms | 2.5-4 Bathrooms | 3,126+ sq. ft.  
Garage with Storage Bay | Pulte Planning Center® | Spacious Loft






## Riverton Home Exteriors



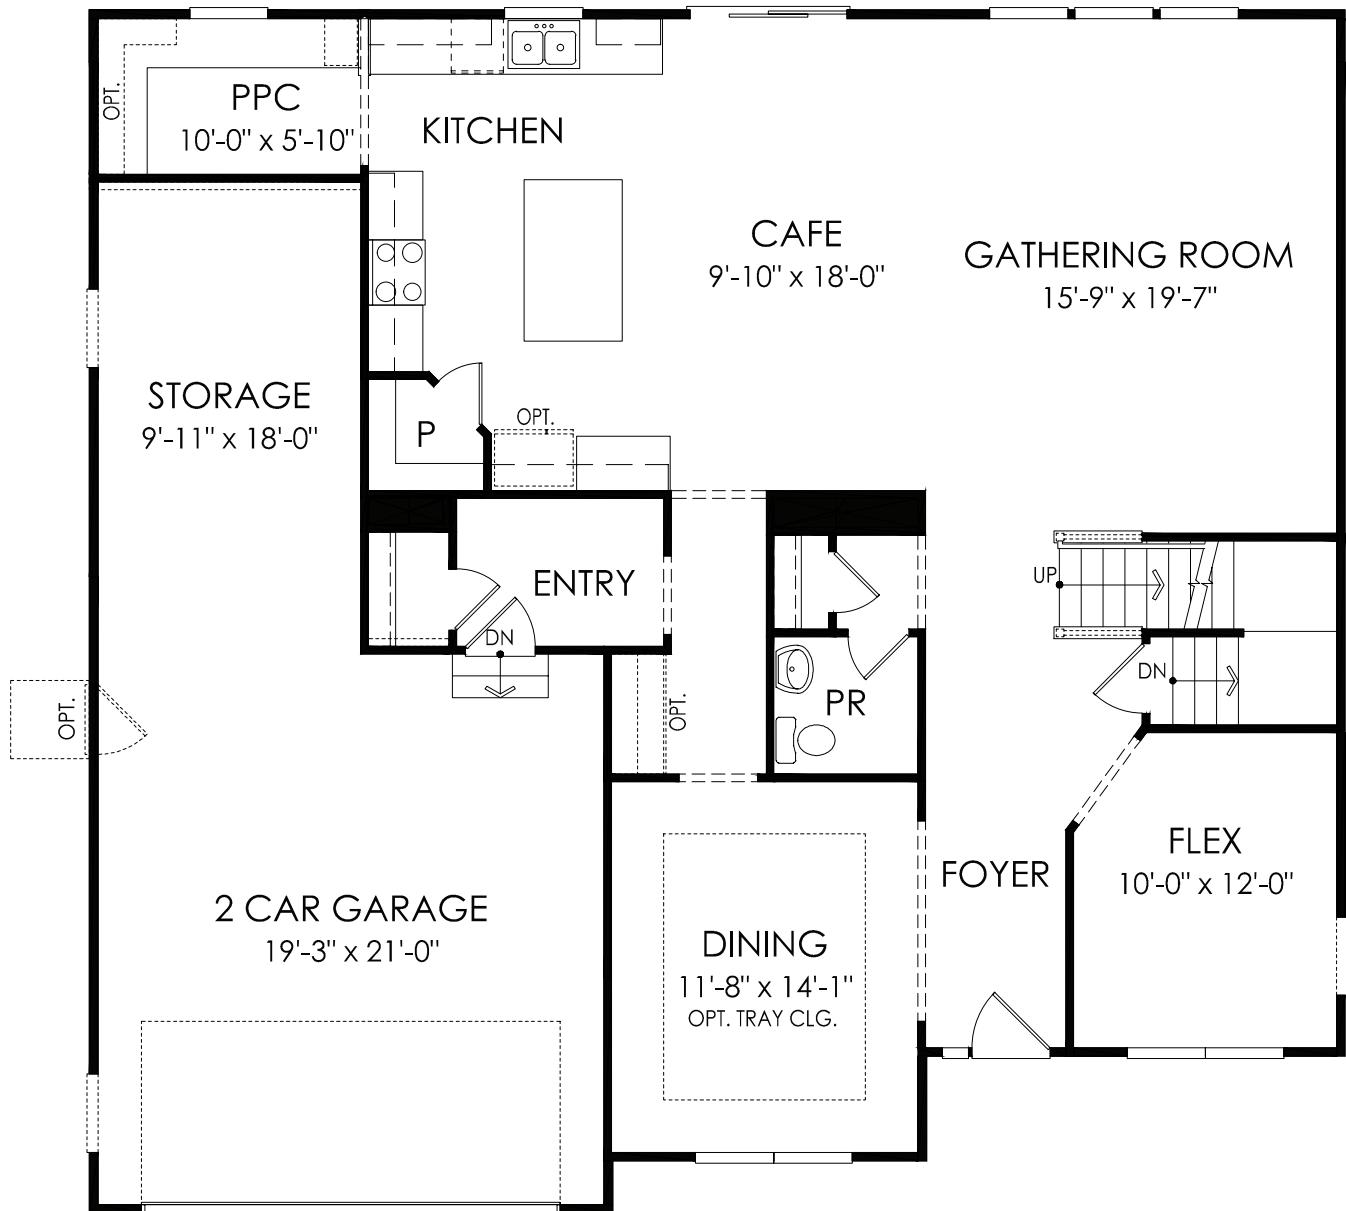

## AVAILABLE OPTIONS

Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on [Pulte.com](https://www.pulte.com).

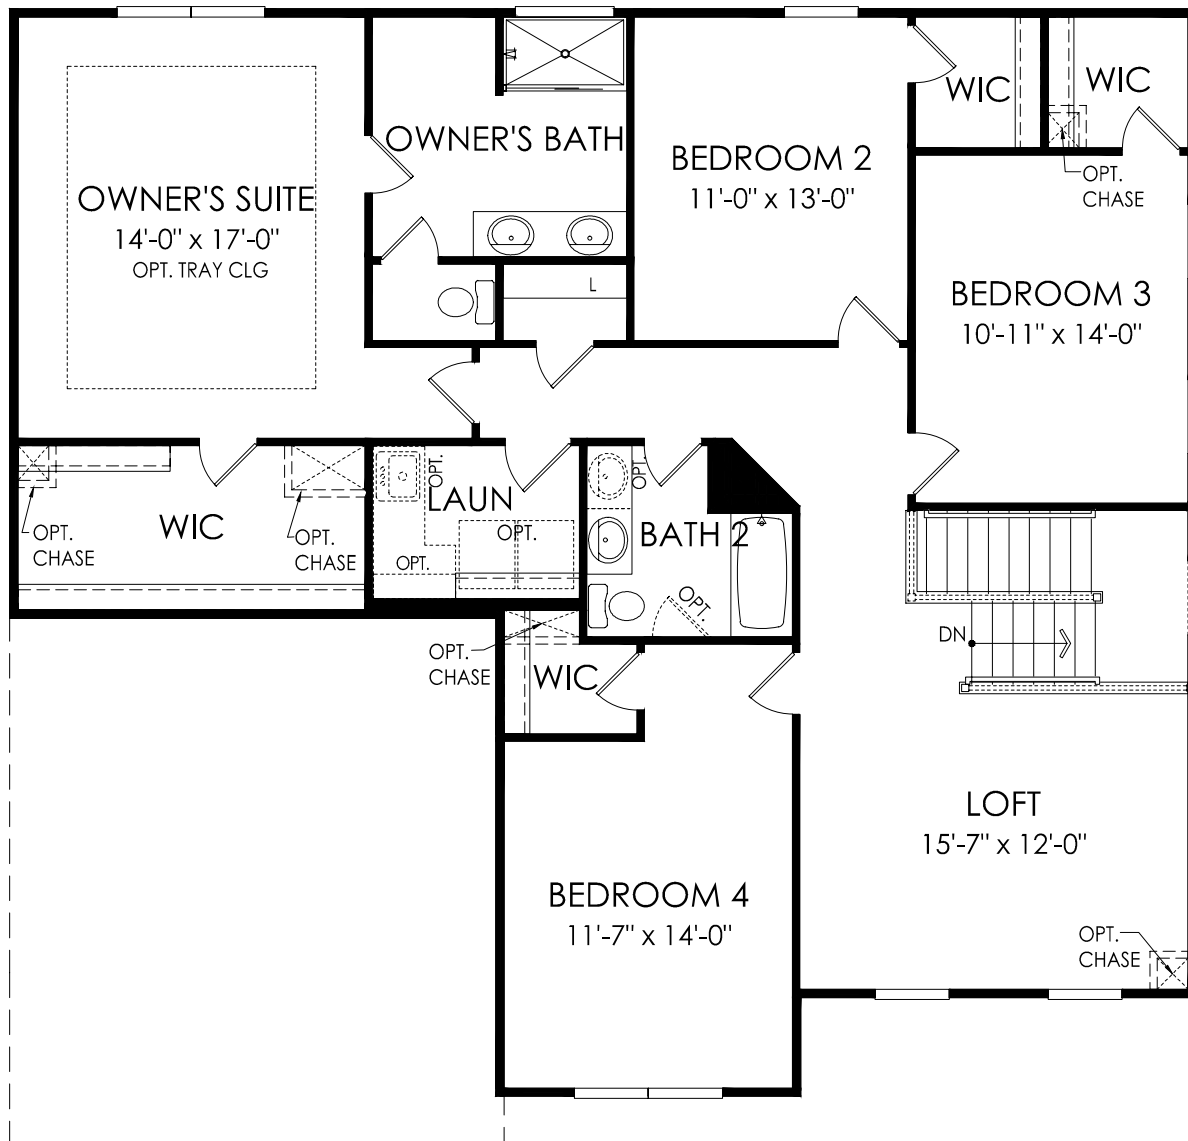




FLOORPLAN NOTES

GENERAL SPECIFICATIONS

1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
2. ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED
3. ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE
4. ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
5. PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
6. PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
7. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
9. PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
10. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
11. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
12. PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
13. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
14. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
15. BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-FLOOR WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
16. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

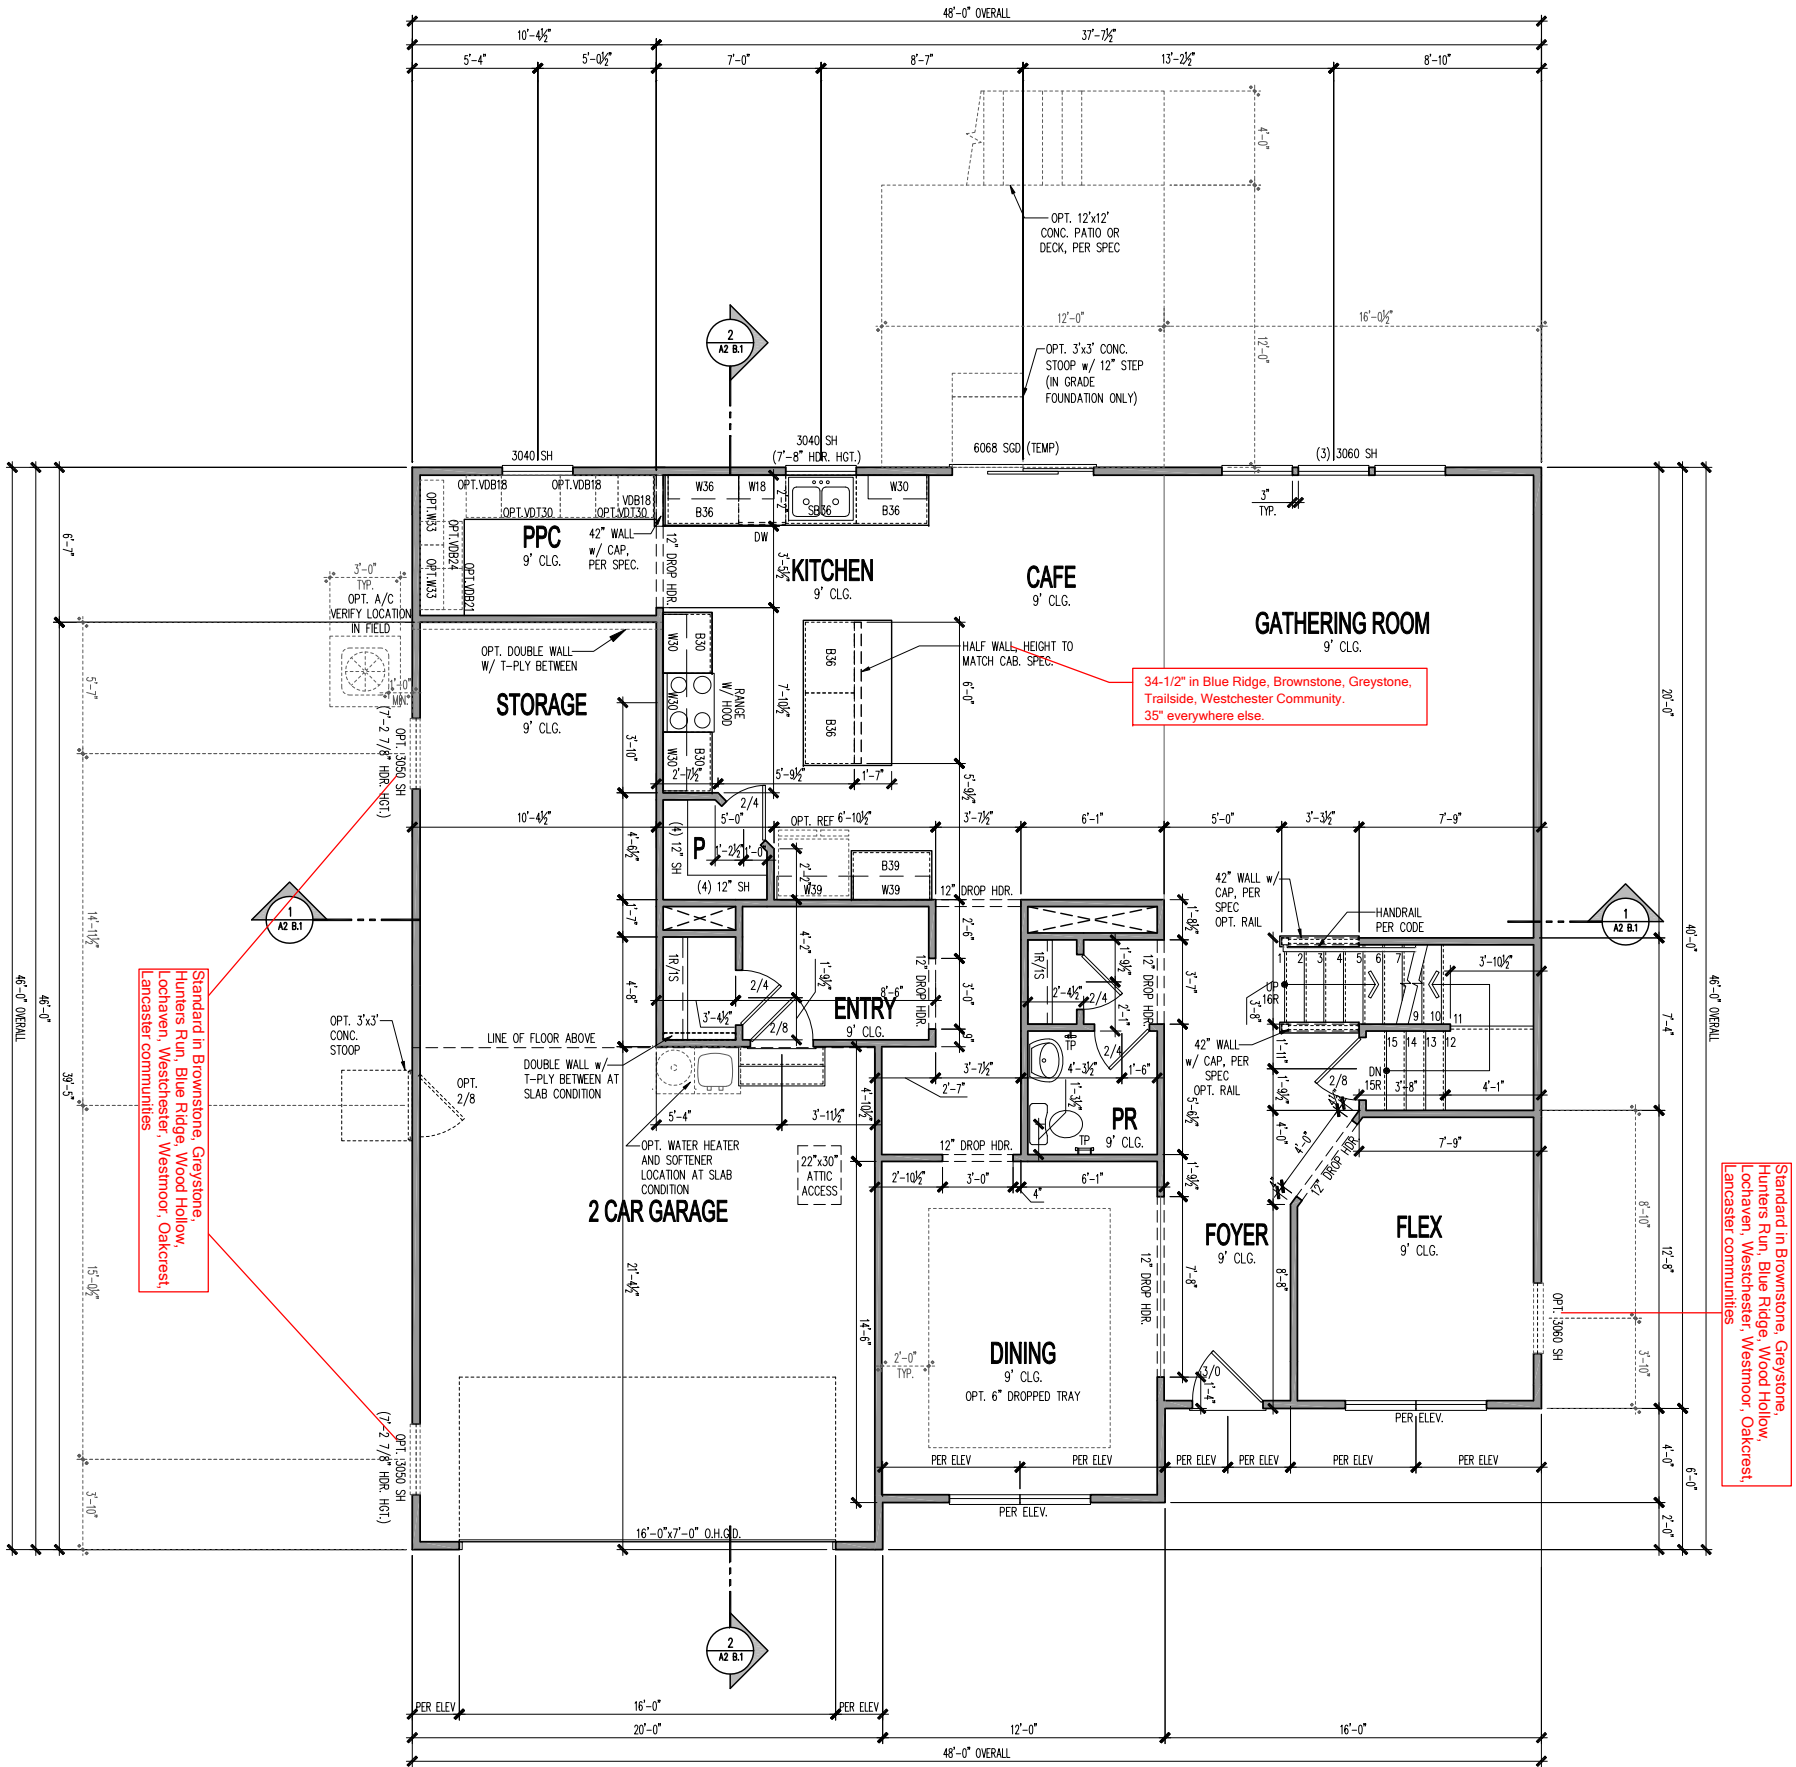

FIRST FLOOR PLAN - 4" EXTERIOR WALLS

SCALE: 1/4" = 1'-0"

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PLAN REFRESH
3	04/16/2019
4	PLAN REVISIONS
5	11/27/2019
6	PCR REVISIONS
7	
8	
9	
10	

GARAGE HANDING
LEFT


SPECIFICATION LEVEL
1

PLAN NAME
Riverton
NPC CHILD NUMBER
1853.302

SHEET
A1
4-1.1




PLOTTED: November 8, 2019 / A3-CR2G 2FB.DWG  
 / Annie Lee

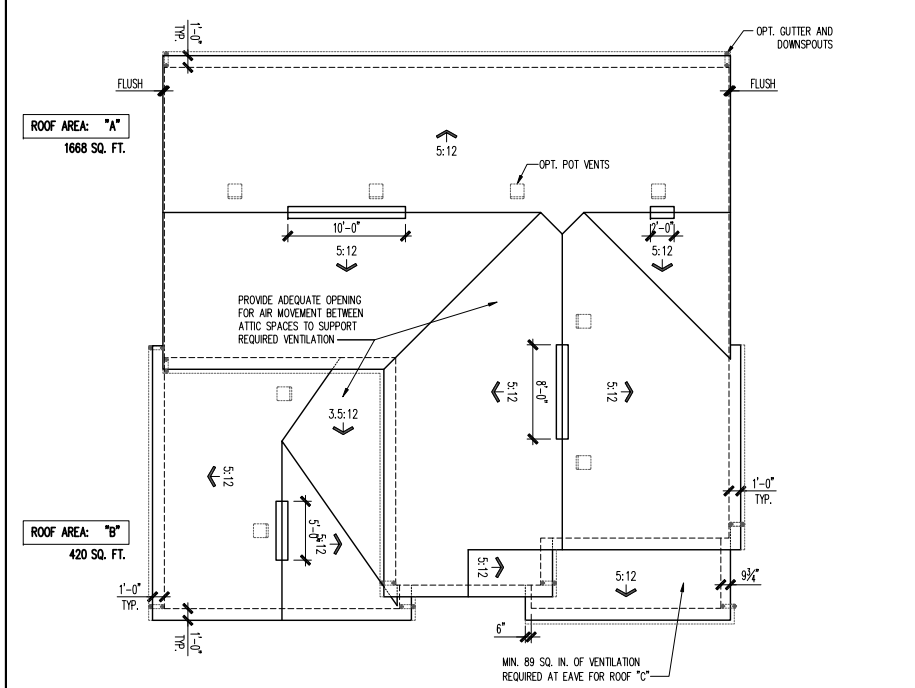


ROOF PLAN  
 SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
Craftsman 2G									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND ROOF VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINGENCY RESERVATION IS RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS.									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50'-0" OF TOTAL AND ROOF AT 40'-0" OF TOTAL REQUIRED VENTILATION.									
ROOF AREA "A"		SQ. FTG		1668		AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	ROOF VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONF. VENT (SQ. FT. RANGE)	
ROOF POT VENT ONLY	3.23 - 2.79	3.24	45.41	6	0				
AT EAVE	3.34 - 2.79	3.35	94.59				0	44.00	
TOTAL	5.56	5.56	5.40	100.00					
ROOF POT VENT ONLY	3.23 - 2.79	3.25	45.00	0	0	20.00			
AT EAVE	3.34 - 2.79	3.35	85.00				0	44.00	
TOTAL	5.56	5.56	5.56	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AVAILABLE				
ROOF AREA "B"		SQ. FTG		420		AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	ROOF VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONF. VENT (SQ. FT. RANGE)	
ROOF POT VENT ONLY	0.54 - 0.70	0.65	20.41	2	0				
AT EAVE	0.54 - 0.70	0.63	49.29				0	12.00	
TOTAL	1.40	1.40	1.48	100.00					
ROOF POT VENT ONLY	0.54 - 0.70	0.63	42.86	0	0	6.00			
AT EAVE	0.54 - 0.70	0.63	37.14				0	12.00	
TOTAL	1.40	1.40	1.44	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AVAILABLE				

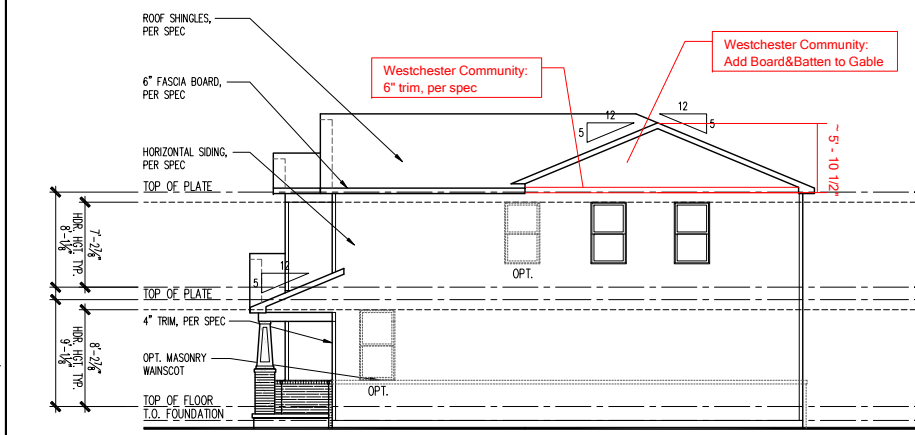


RIGHT ELEVATION  
 SCALE: 1/8" = 1'-0"

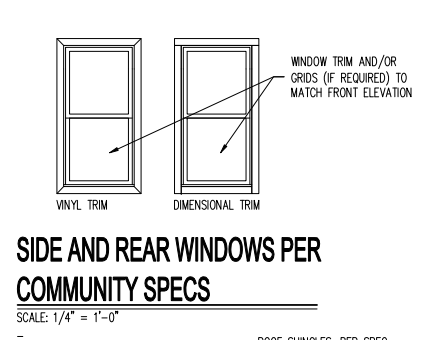

FRONT ELEVATION  
 SCALE: 1/4" = 1'-0"

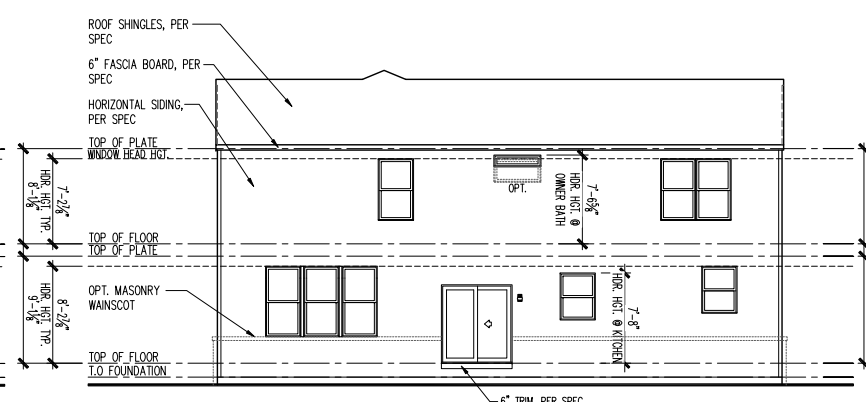

REAR ELEVATION  
 SCALE: 1/8" = 1'-0"

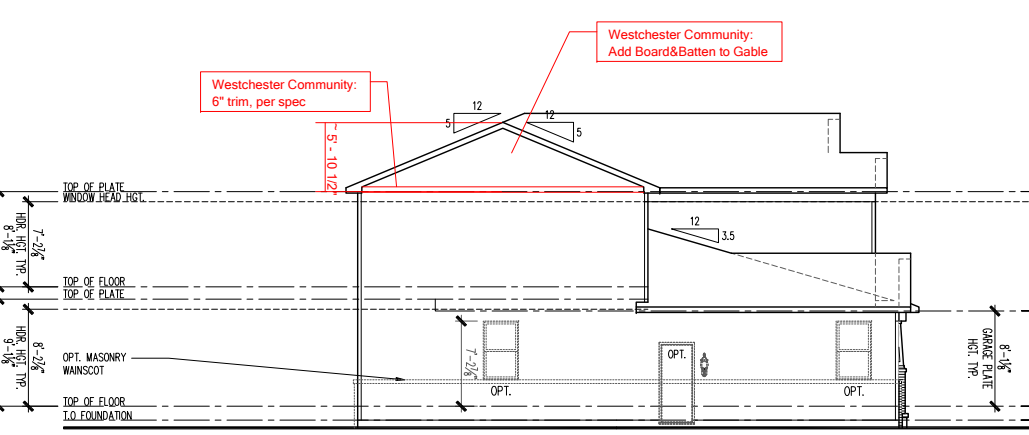

LEFT ELEVATION  
 SCALE: 1/8" = 1'-0"

(c) Copyright 2019, PulteGroup, Inc.

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
 2 Car Front Entry  
 Craftsman 2G

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	04/16/2019
3	11/27/2019
4	
5	
6	
7	
8	
9	
10	


GARAGE HANDING  
 LEFT

SPECIFICATION LEVEL

PLAN NAME  
 Riverton  
 NPC CHILD NUMBER  
 1853.302


SHEET  
 A3-CR2G  
 2FB.1

PLOTTED: November 8, 2019 / A3-EC2G 2FB.DWG / Annie Lee

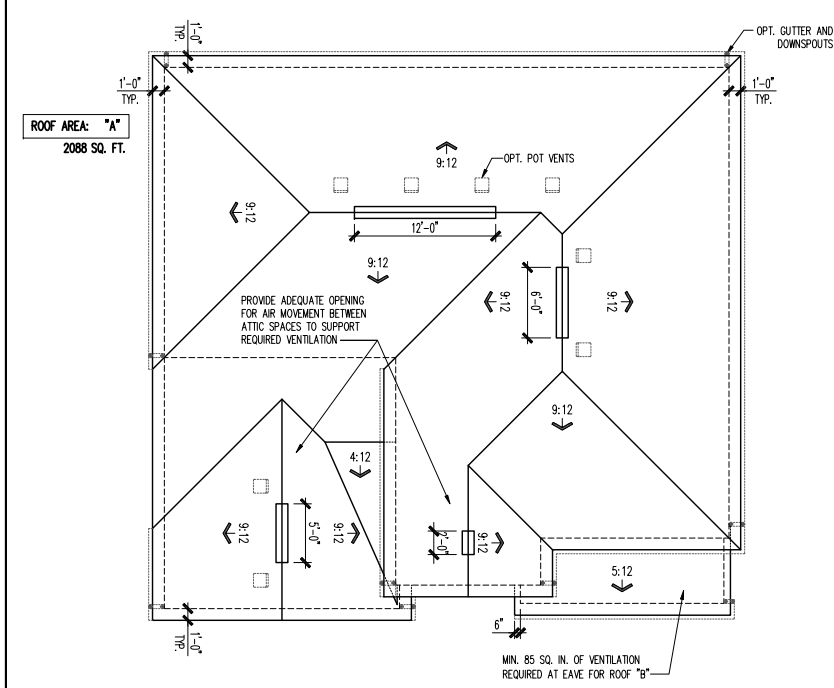


ROOF PLAN  
 SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
Euro Country 2G									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINGENCY RESERVING EVALUATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-SIZE OF TOTAL AND RIDGE AT 40-SIZE OF TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FTG	2088	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SAL. IN. MIN)	POT SMALL (SAL. IN. MIN)	RIDGE VENT (SAL. IN. MIN)	SAVE VENT (SAL. IN. MIN)	CONT. VENT (SAL. IN. MIN)		
ROOF-POT VENT ONLY	3.78	3.40	3.39	44.54	0	0			
AT EAVE	4.18	3.40	3.39	35.44		0	56.00		
TOTAL	6.94	6.94	7.28	100.00					
ROOF-RIDGE VENT	3.78	3.40	3.15	44.50	0	0	25.00		
AT EAVE	4.18	3.40	3.39	35.45		0	56.00		
TOTAL	6.94	6.94	7.01	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

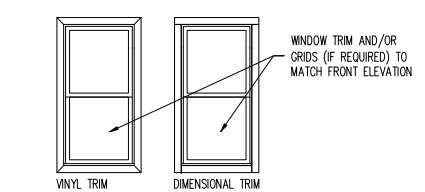


SIDE AND REAR WINDOWS PER  
 COMMUNITY SPECS  
 SCALE: 1/4" = 1'-0"

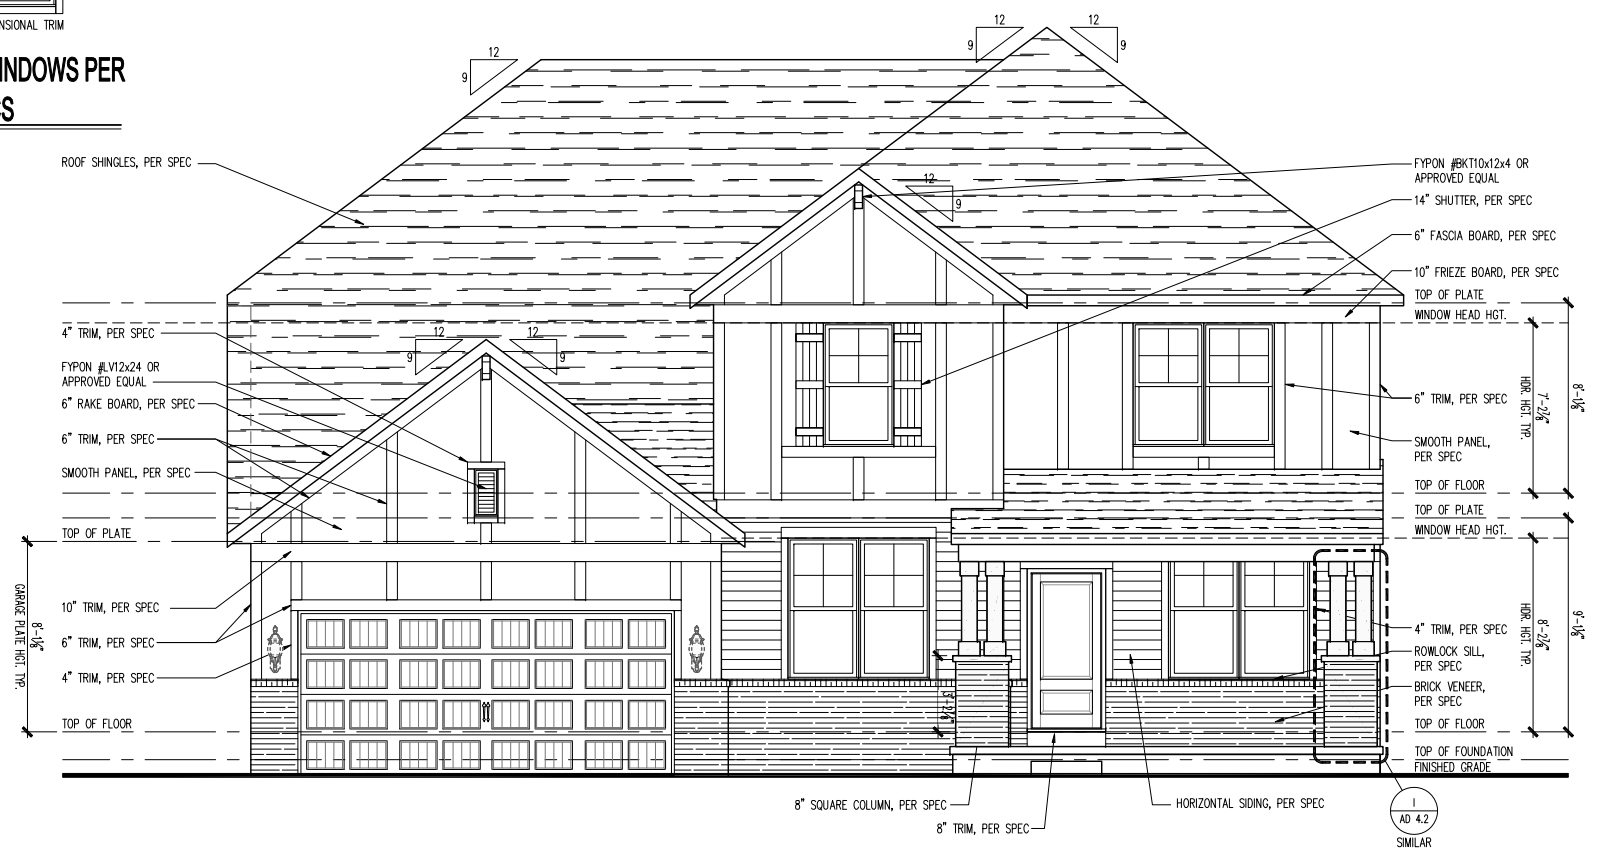


FRONT ELEVATION  
 SCALE: 1/4" = 1'-0"

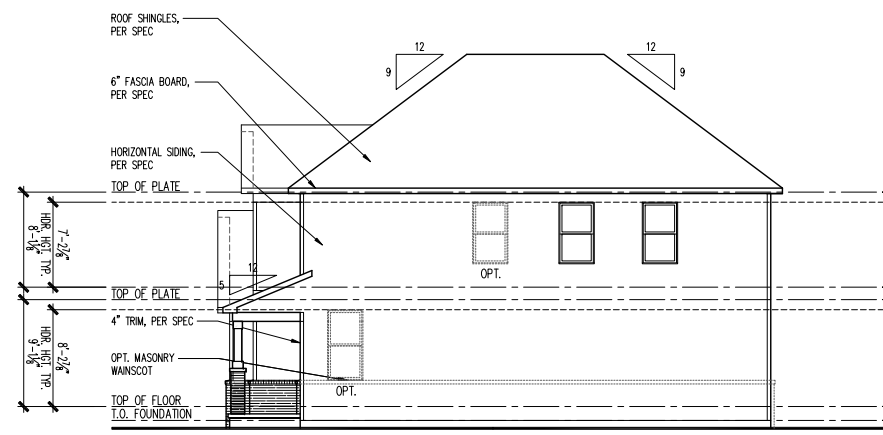

RIGHT ELEVATION  
 SCALE: 1/8" = 1'-0"

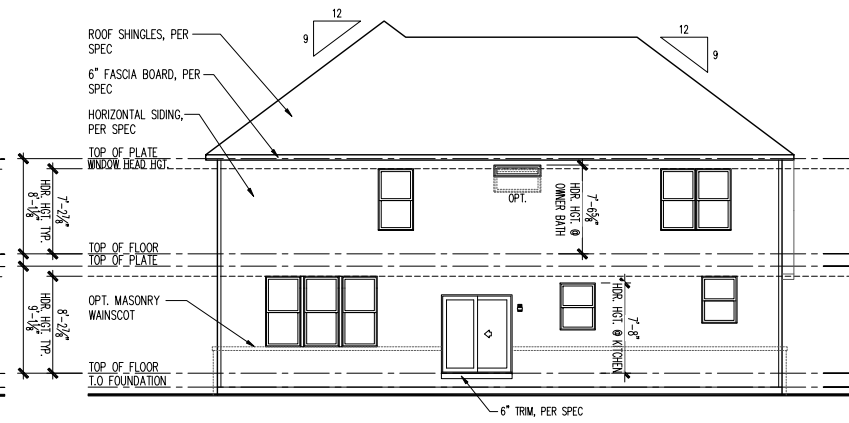

REAR ELEVATION  
 SCALE: 1/8" = 1'-0"

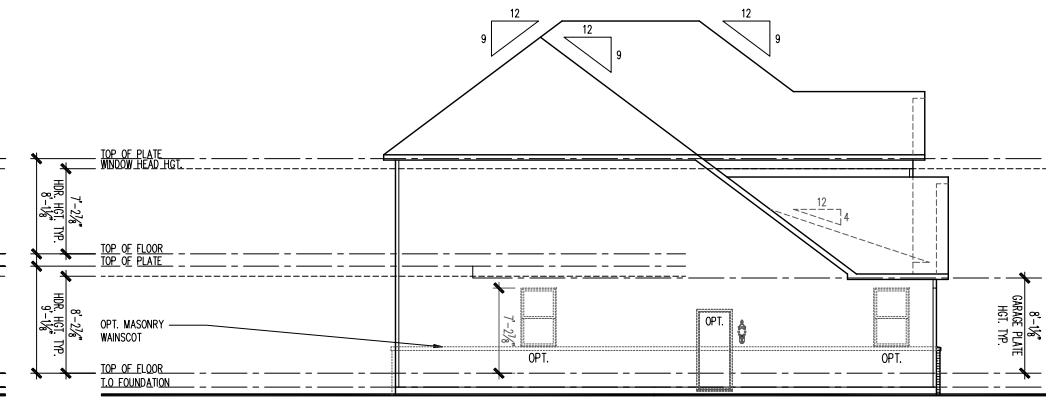

LEFT ELEVATION  
 SCALE: 1/8" = 1'-0"

(c) Copyright 2019, PutteGroup, Inc.

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
 2 Car Front Entry  
 Euro Country 2G

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	01/18/2019
3	04/16/2019
4	11/27/2019
5	11/27/2019
6	11/27/2019
7	11/27/2019
8	11/27/2019
9	11/27/2019
10	11/27/2019

GARAGE HANDING  
 LEFT

SPECIFICATION LEVEL

PLAN NAME  
 Riverton  
 NPC CHILD NUMBER  
 1853.302


SHEET  
 A3-EC2G  
 2FB.1

<b>BASE HOUSE - HEATED</b>	
FIRST FLOOR	1480
SECOND FLOOR	1646
<b>TOTAL BASE HEATED</b>	<b>3126</b>
<b>BASE HOUSE - UNDER ROOF</b>	
GARAGE - 2 CAR FRONT ENTRY	608
BASEMENT	1385
<b>TOTAL BASE UNDER ROOF</b>	<b>2088</b>
<b>BASE OPTIONS - HEATED</b>	
SUNROOM	144
GATHERING ROOM EXTENSION	66
SUNROOM w/ GATHERING RM. EXT.	209
CAFE BAY 2	N/A
<b>FINISHED BASEMENT OPTIONS</b>	
FINISHED BASEMENT	747
FINISHED BASEMENT w/ CRAWL	N/A
BATH 7 OPTION	44
BEDROOM 7 OPTION	133
ADDITIONAL AREA w/ SUNROOM	129
ADDITIONAL AREA w/ GATHERING RM. EXTENSION	61
ADD. AREA w/ SUNROOM & GATHERING RM. EXTENSION	192
ADDITIONAL AREA w/ CAFE BAY 2	N/A
MECHANICAL AND STORAGE	638
<b>BASE OPTIONS</b>	
BASEMENT / SUNROOM	1529
BASEMENT / GATHERING RM. EXTENSION	1451
BASEMENT / SUNROOM / GATHERING RM. EXTENSION	1594
BASEMENT / CAFE BAY 2	N/A
COVERED PORCH	N/A
SCREENED PORCH	N/A
2 CAR SIDE ENTRY GARAGE	608
3 CAR FRONT ENTRY GARAGE	808
3 CAR SIDE ENTRY GARAGE	N/A
2 CAR COURTYARD ENTRY	N/A
BASEMENT	N/A
CRAWL	N/A
WOOD DECK	144
CONCRETE PATIO	144
OTHER	0


ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1480
ADDITIONAL 2ND FLOOR - HEATED	0
TOTAL 2ND FLOOR	1646
TOTAL ELEV. HEATED	3126
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	608
ADDITIONAL BASEMENT	0
TOTAL BASEMENT	1385
FRONT PORCH	100
TOTAL ELEV. FOOTPRINT	2188

ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
BEDROOM 4	187.32	14.99	7.49	11.7	5.0


➡ REFER TO LIGHT & VENT SCHEDULE ON COVER SHT. FOR INFORMATION NOT SHOWN HERE.

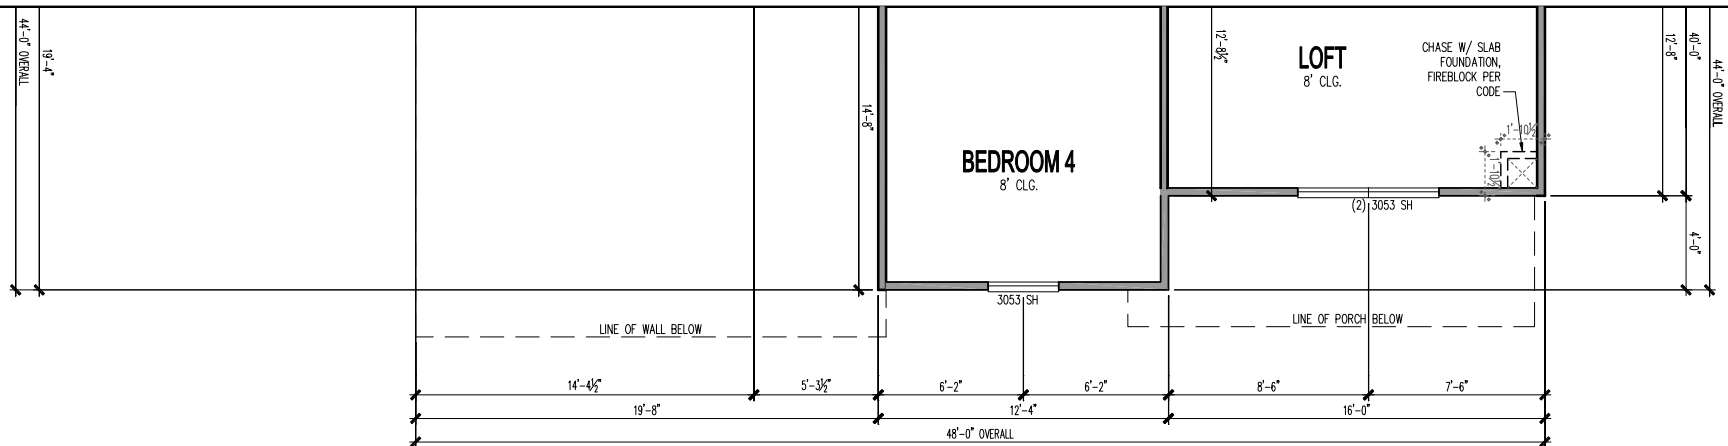

SCALE: 1/4" = 1'-0"  
SEE BASE PLANS FOR INFORMATION NOT SHOWN

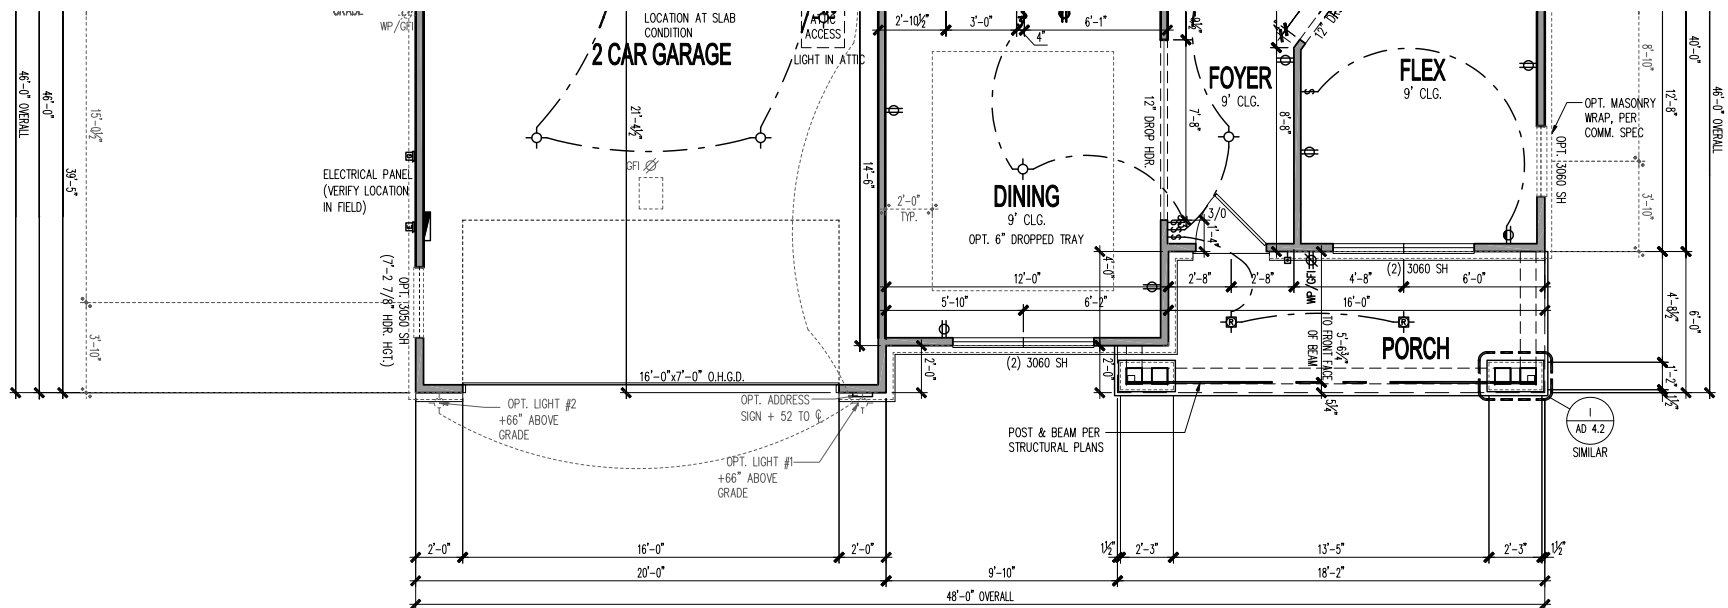

SCALE: 1/4" = 1'-0"  
SEE BASE PLANS FOR INFORMATION NOT SHOWN

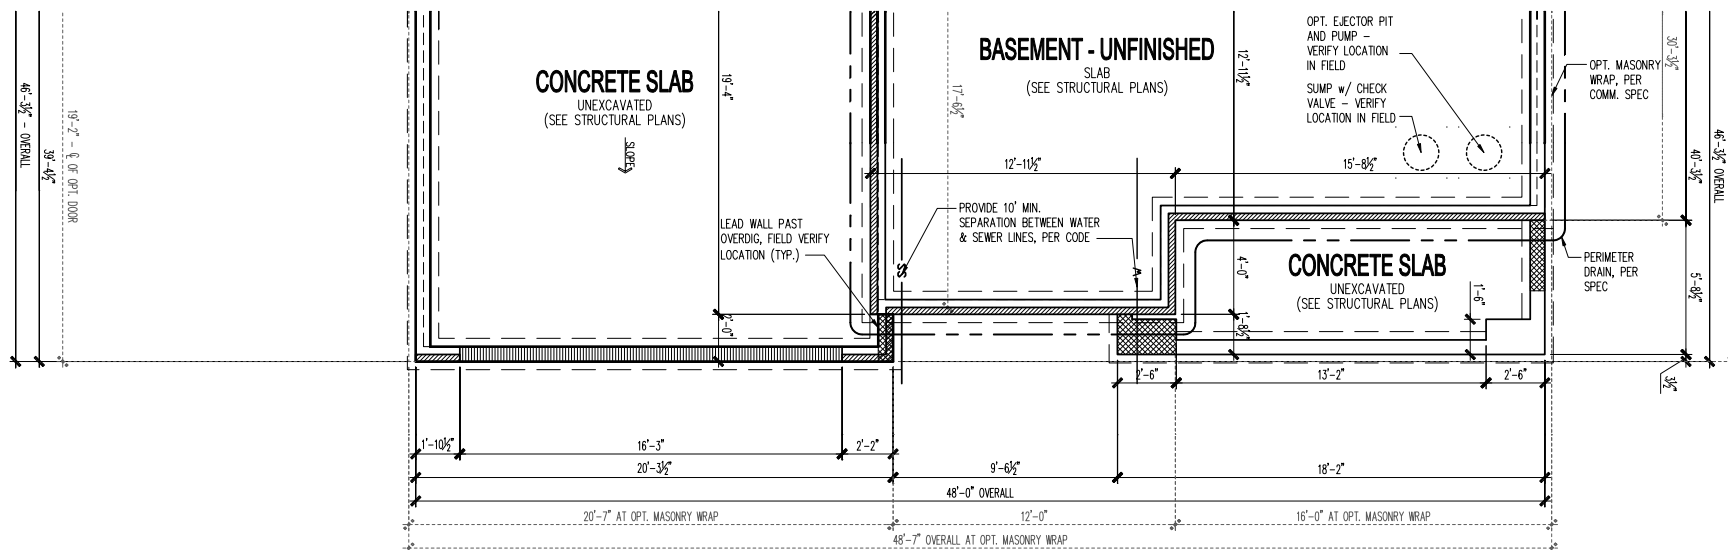

SCALE: 1/4" = 1'-0"  
SEE BASE PLANS FOR INFORMATION NOT SHOWN

(c) Copyright 2019 PulteGroup, Inc.

**Midwest Zone Office**  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



## Partial Plans and General Notes

2 Car Front Entry  
Euro Country 2G

PRODUCT MANAGER  
Rick Starkey  
INITIAL RELEASE  
DATE: 01/18/2019

<b>REV#</b>	<b>DATE / DESCRIPTION</b>
	01/18/2019 PLAN REFRESH
	04/16/2019 PLAN REVISIONS
	11/27/2019 PCR REVISIONS
	" "
	" "
	" "
	" "
	" "


**GARAGE HANDING  
LEFT**

SPECIFICATION LEVEL	DESCRIPTION
1	Basic
2	Intermediate
3	Advanced
4	Expert
5	Master
6	Grandmaster
7	Legend
8	Immortal
9	Divine
10	Godlike
11	Unstoppable
12	Invincible
13	Invulnerable
14	Invulnerable
15	Invulnerable
16	Invulnerable
17	Invulnerable
18	Invulnerable
19	Invulnerable
20	Invulnerable
21	Invulnerable
22	Invulnerable
23	Invulnerable
24	Invulnerable
25	Invulnerable
26	Invulnerable
27	Invulnerable
28	Invulnerable
29	Invulnerable
30	Invulnerable
31	Invulnerable
32	Invulnerable
33	Invulnerable
34	Invulnerable
35	Invulnerable
36	Invulnerable
37	Invulnerable
38	Invulnerable
39	Invulnerable
40	Invulnerable
41	Invulnerable
42	Invulnerable
43	Invulnerable
44	Invulnerable
45	Invulnerable
46	Invulnerable
47	Invulnerable
48	Invulnerable
49	Invulnerable
50	Invulnerable
51	Invulnerable
52	Invulnerable
53	Invulnerable
54	Invulnerable
55	Invulnerable
56	Invulnerable
57	Invulnerable
58	Invulnerable
59	Invulnerable
60	Invulnerable
61	Invulnerable
62	Invulnerable
63	Invulnerable
64	Invulnerable
65	Invulnerable
66	Invulnerable
67	Invulnerable
68	Invulnerable
69	Invulnerable
70	Invulnerable
71	Invulnerable
72	Invulnerable
73	Invulnerable
74	Invulnerable
75	Invulnerable
76	Invulnerable
77	Invulnerable
78	Invulnerable
79	Invulnerable
80	Invulnerable
81	Invulnerable
82	Invulnerable
83	Invulnerable
84	Invulnerable
85	Invulnerable
86	Invulnerable
87	Invulnerable
88	Invulnerable
89	Invulnerable
90	Invulnerable
91	Invulnerable
92	Invulnerable
93	Invulnerable
94	Invulnerable
95	Invulnerable
96	Invulnerable
97	Invulnerable
98	Invulnerable
99	Invulnerable
100	Invulnerable

PLAN NAME	<b>Riverton</b>
NPC CHILD NUMBER	<b>1853.302</b>


SHEET  
A3-EC2G  
2FB4.2

PLOTTED: November 8, 2019 / A3-EC2H 2FB.DWG  
 / Annie Lee

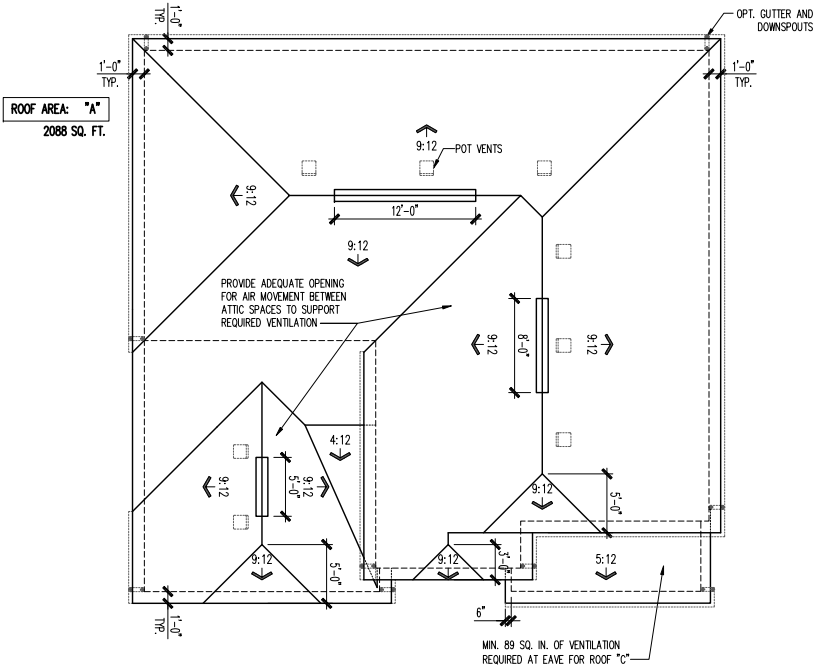


ROOF PLAN  
 SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
Euro Country 2H									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINGENCY RESERVING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VALUES USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50'-0" OF TOTAL AND RIDGE AT 40'-0" OF TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FTG	2088	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. FT. MIN)	POT SMALL (SQ. FT. MIN)	RIDGE VENT (SQ. FT. MIN)	SAVE VENT (SQ. FT. MIN)	CONF. VENT (SQ. FT. MIN)		
HIGH-POT VENT ONLY	3.78	3.48	3.39	44.94	0	0			
AT EAVE	4.18	3.48	3.39	25.44		0	56.00		
TOTAL	6.94	6.94	7.28	100.00					
HIGH RIDGE VENT	3.78	3.48	3.13	44.93	0	0	25.00		
AT EAVE	4.18	3.48	3.39	85.45		0	56.00		
TOTAL	6.94	6.94	7.01	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

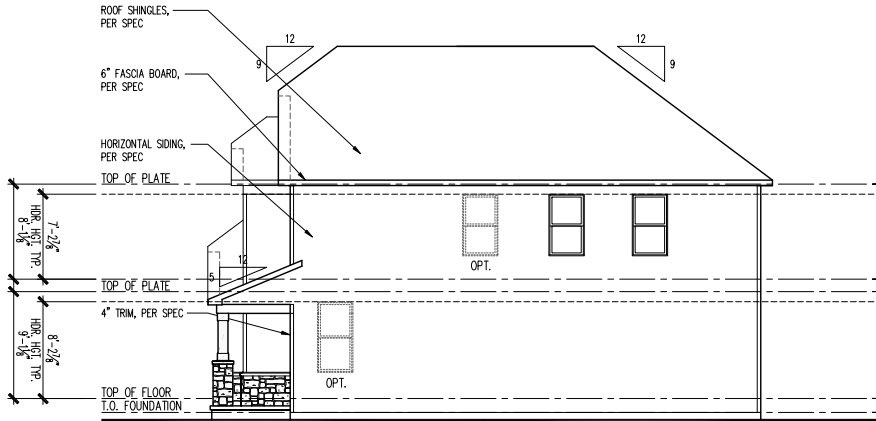


RIGHT ELEVATION  
 SCALE: 1/8" = 1'-0"

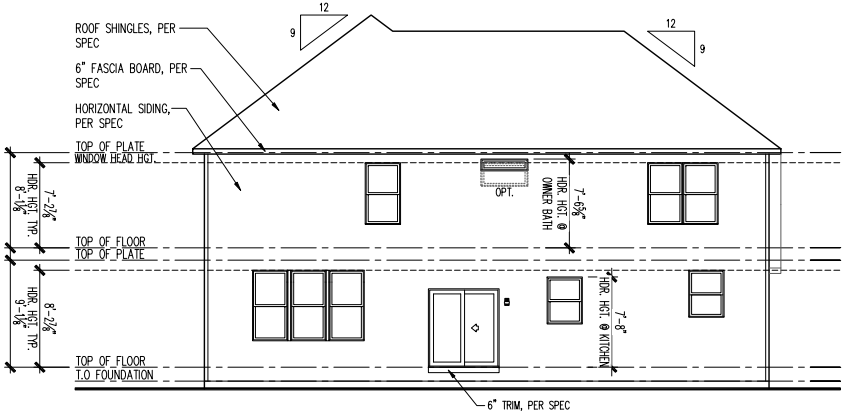


REAR ELEVATION  
 SCALE: 1/8" = 1'-0"

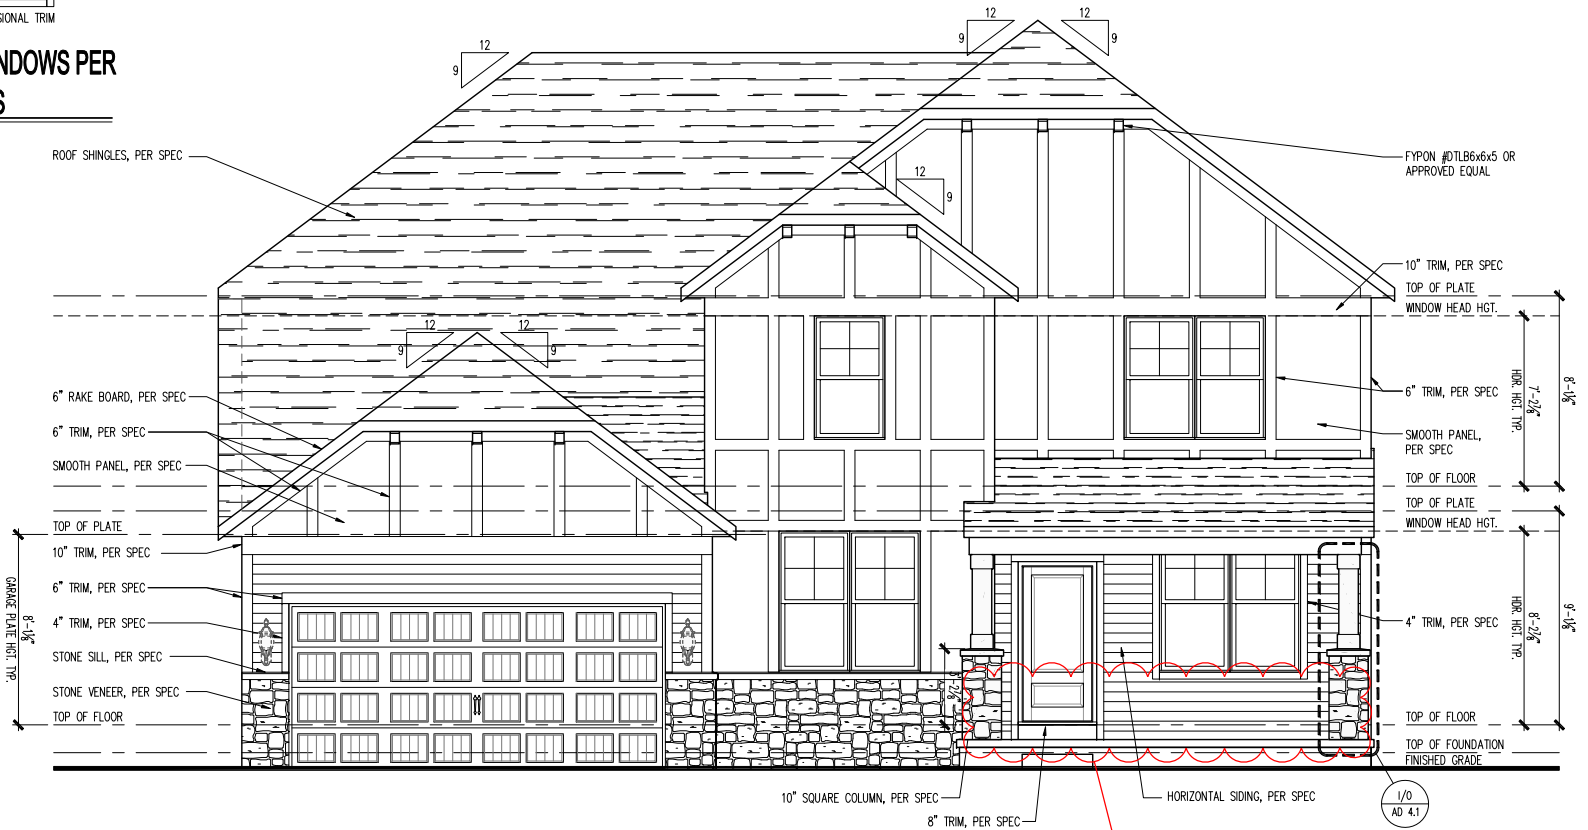

FRONT ELEVATION  
 SCALE: 1/4" = 1'-0"

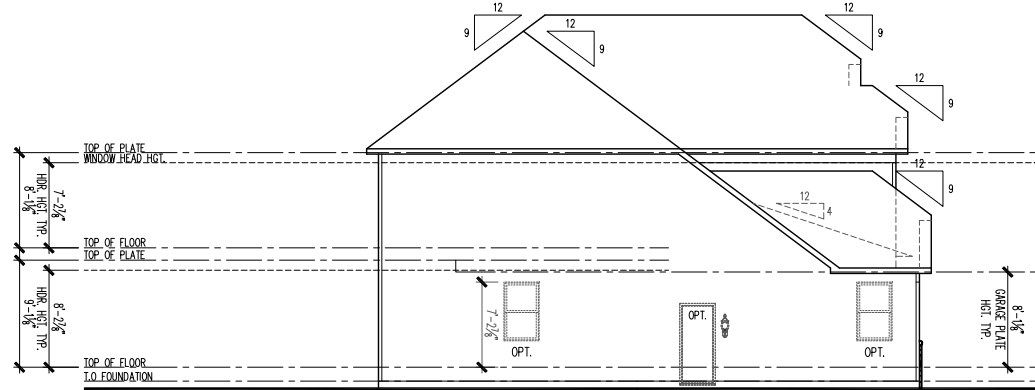

LEFT ELEVATION  
 SCALE: 1/8" = 1'-0"

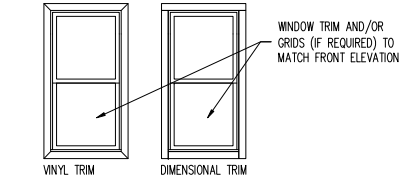

SIDE AND REAR WINDOWS PER  
 COMMUNITY SPECS  
 SCALE: 1/4" = 1'-0"

(c) Copyright 2019, PutteGroup, Inc.

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry  
 Euro Country 2H

PRODUCT MANAGER  
 Rick Starkey  
 INITIAL RELEASE  
 DATE: 01/18/2019

REV#	DATE/DESCRIPTION
1	01/18/2019 PLAN REFRESH
2	04/16/2019 PLAN REVISIONS
3	11/27/2019 PCR REVISIONS
4	
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
 LEFT

SPECIFICATION LEVEL

PLAN NAME  
 Riverton  
 NPC CHILD NUMBER  
 1853.302

SHEET  
 A3-EC2H  
 2FB.1






SCHEDULE of AREAS	
BASE HOUSE - HEATED	
FIRST FLOOR	1480
SECOND FLOOR	1646
TOTAL BASE HEATED	3126
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	608
BASEMENT	1385
TOTAL BASE UNDER ROOF	2088
BASE OPTIONS - HEATED	
SUNROOM	144
GATHERING ROOM EXTENSION	66
SUNROOM w/ GATHERING RM. EXT.	209
CAFE BAY 2	N/A
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	747
FINISHED BASEMENT w/ CRAWL	N/A
BATH 7 OPTION	44
BEDROOM 7 OPTION	133
ADDITIONAL AREA w/ SUNROOM	129
ADDITIONAL AREA w/ GATHERING RM. EXTENSION	61
ADD. AREA w/ SUNROOM & GATHERING RM. EXTENSION	192
ADDITIONAL AREA w/ CAFE BAY 2	N/A
MECHANICAL and STORAGE	638
BASE OPTIONS	
BASEMENT / SUNROOM	1529
BASEMENT / GATHERING RM. EXTENSION	1451
BASEMENT / SUNROOM / GATHERING RM. EXTENSION	1594
BASEMENT / CAFE BAY 2	N/A
COVERED PORCH	N/A
SCREENED PORCH	N/A
2 CAR SIDE ENTRY GARAGE	608
3 CAR FRONT ENTRY GARAGE	808
3 CAR SIDE ENTRY GARAGE	N/A
2 CAR COURTYARD ENTRY	N/A
BASEMENT	N/A
CRAWL	N/A
WOOD DECK	144
CONCRETE PATIO	144
OTHER	0

ELEVATION EC2H	
ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1480
ADDITIONAL 2ND FLOOR - HEATED	0
TOTAL 2ND FLOOR	1646
TOTAL ELEV. HEATED	3126
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	608
ADDITIONAL BASEMENT	0
TOTAL BASEMENT	1385
FRONT PORCH	111
TOTAL ELEV. FOOTPRINT	2199

LIGHT & VENT SCHEDULE					
ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
BEDROOM 4	187.32	14.99	7.49	11.7	5.0

\*\* REFER TO LIGHT & VENT SCHEDULE ON COVER SHT. FOR INFORMATION NOT SHOWN HERE.

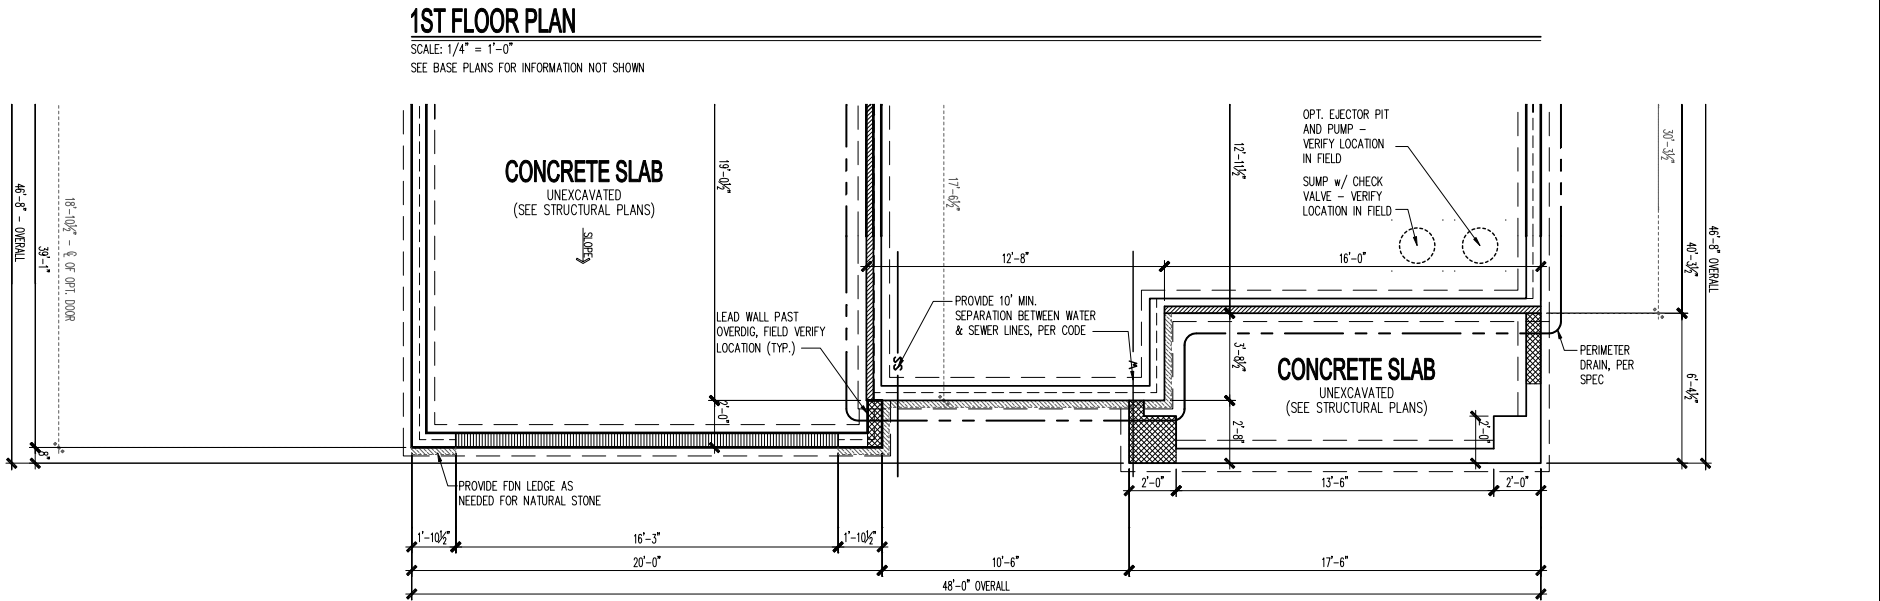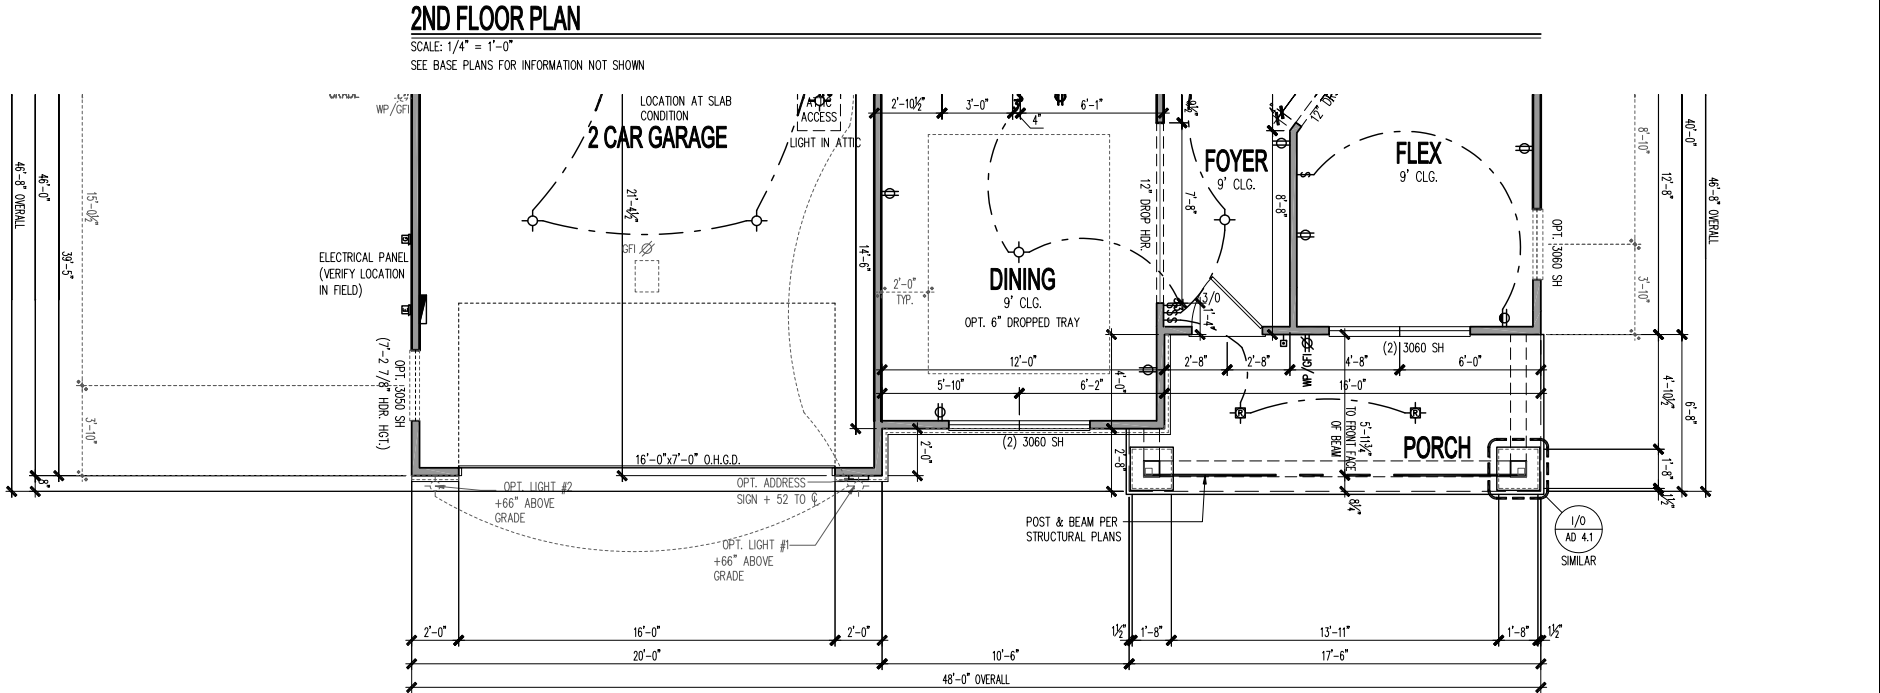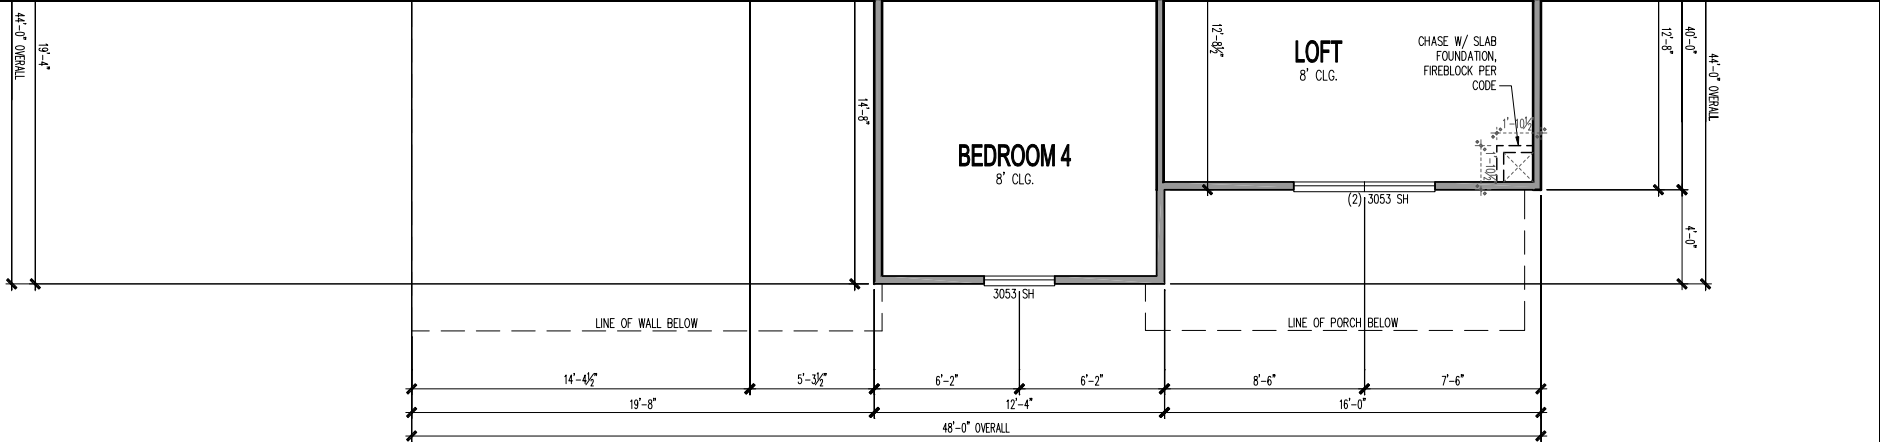

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Partial Plans and General Notes  
2 Car Front Entry  
Euro Country 2H

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019 PLAN REFRESH
2	04/16/2019 PLAN REVISIONS
3	11/27/2019 PCR REVISIONS
4	
5	
6	
7	
8	

GARAGE HANDING  
LEFT

SPECIFICATION LEVEL  
1

PLAN NAME  
Riverton  
NPC CHILD NUMBER  
1853.302

SHEET  
A3-EC2H  
2FB4.2



## ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT CALC

VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT TYPES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.  
\* CORRECTION FACTORS ARE REQUIRED FOR TEMPERATURES FOR TEMPERING THE VENTS USED. SEE W-900 SUPPLEMENT TO MEET CODE REQUIREMENTS.  
\* SCHEDULE WAS BEEN CALCULATED ASSUME VENTILATION AT 50-FPM OR THEREIN AS INDICATED AT 40-FPM OF TOTAL REQUIRED VENTILATION.

Heartland 2G

ROOF AREA "A"		SQ FT FTHS	AT / NEAR RIDGE		AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT SUPPLIED	POT LARGE PCH PANELS	POT SMALL PCH PANELS	RIDGE VENT (SQ.FT./LIN.)	SAVE VENT (SQ.FT./LIN.)	CORR. VENT (SQ.FT./LIN.)
				61.00	40.00	18.00	28.00	10.00
HIGH-POT VENT ONLY	3.76 - 3.40	3.39	44.13	0	0			
AT/EAVE	4.18 - 2.48	3.94	92.58				0	0/00
TOTAL sq.ft.	6.94	6.94	7.35 / 100.00					
HIGH-RIDGE VENT	3.76 - 3.40	3.76	48.45	0	0	20.00		
AT/EAVE	4.18 - 2.48	3.94	91.20				0	0/00
TOTAL sq.ft.	6.94	6.94	7.71 / 100.00					
ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE								

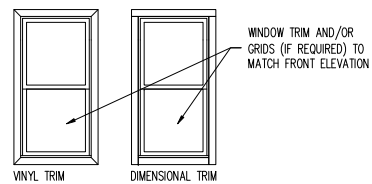


### SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




**FRONT ELEVATION**

SCALE:  $1/4" = 1'-0"$

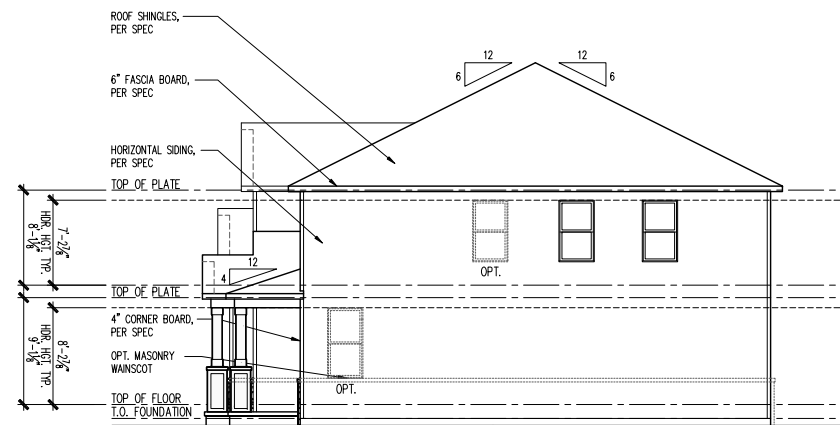


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

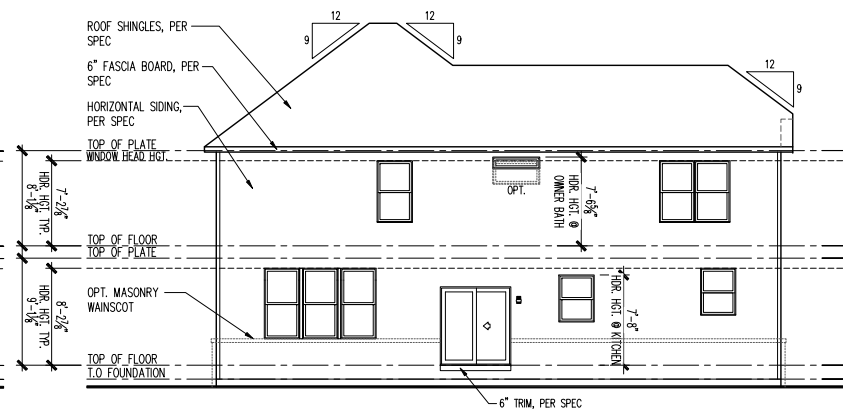

### REAR ELEVATION

SCALE:  $1/8" = 1'-0"$



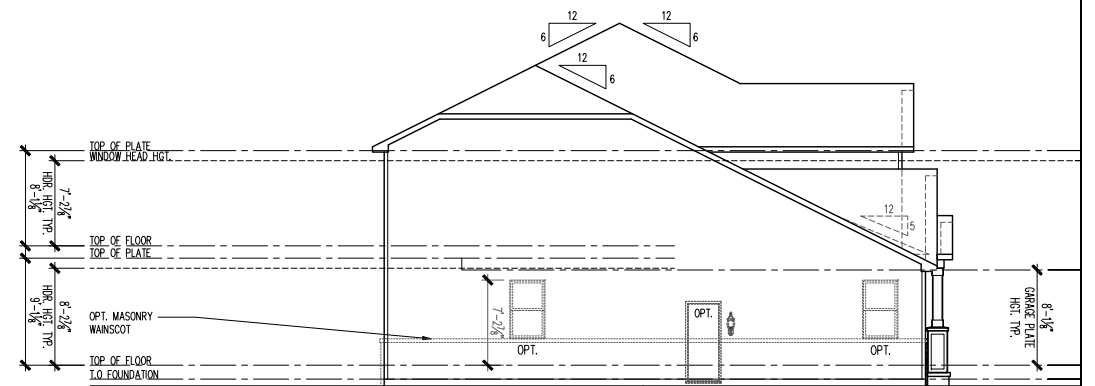


LEFT ELEVATION

SCALE: 1/8" = 1'-0"

SCHEDULE of AREAS	
BASE HOUSE - HEATED	
FIRST FLOOR	1480
SECOND FLOOR	1646
TOTAL BASE HEATED	3126
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	608
BASEMENT	1385
TOTAL BASE UNDER ROOF	2088
BASE OPTIONS - HEATED	
SUNROOM	144
GATHERING ROOM EXTENSION	66
SUNROOM w/ GATHERING RM. EXT.	209
CAFE BAY 2	N/A
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	747
FINISHED BASEMENT w/ CRAWL	N/A
BATH 7 OPTION	44
BEDROOM 7 OPTION	133
ADDITIONAL AREA w/ SUNROOM	129
ADDITIONAL AREA w/ GATHERING RM. EXTENSION	61
ADD. AREA w/ SUNROOM & GATHERING RM. EXTENSION	192
ADDITIONAL AREA w/ CAFE BAY 2	N/A
MECHANICAL and STORAGE	638
BASE OPTIONS	
BASEMENT / SUNROOM	1529
BASEMENT / GATHERING RM. EXTENSION	1451
BASEMENT / SUNROOM / GATHERING RM. EXTENSION	1594
BASEMENT / CAFE BAY 2	N/A
COVERED PORCH	N/A
SCREENED PORCH	N/A
2 CAR SIDE ENTRY GARAGE	608
3 CAR FRONT ENTRY GARAGE	808
3 CAR SIDE ENTRY GARAGE	N/A
2 CAR COURTYARD ENTRY	N/A
BASEMENT	N/A
CRAWL	N/A
WOOD DECK	144
CONCRETE PATIO	144
OTHER	0

ELEVATION HR2G	
ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1480
ADDITIONAL 2ND FLOOR - HEATED	0
TOTAL 2ND FLOOR	1646
TOTAL ELEV. HEATED	3126
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	608
ADDITIONAL BASEMENT	0
TOTAL BASEMENT	1385
FRONT PORCH	115
TOTAL ELEV. FOOTPRINT	2203

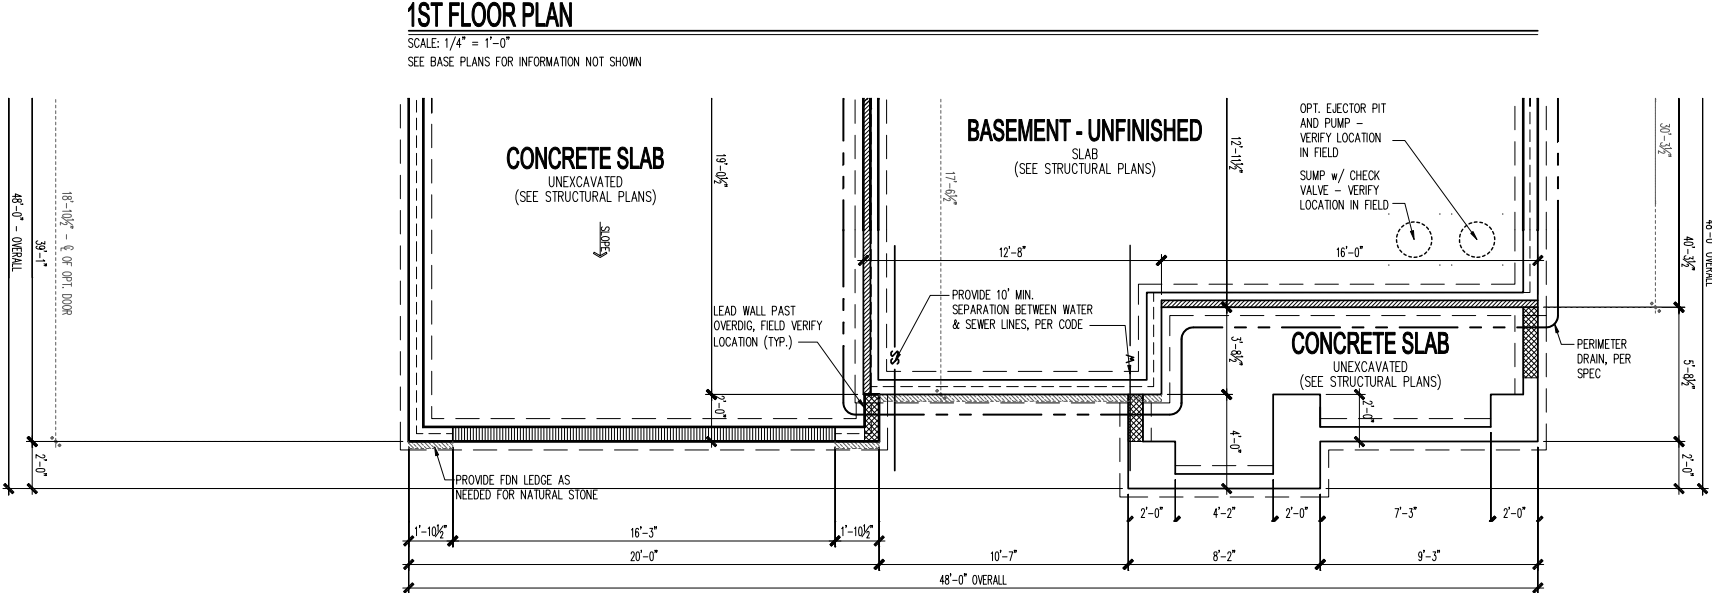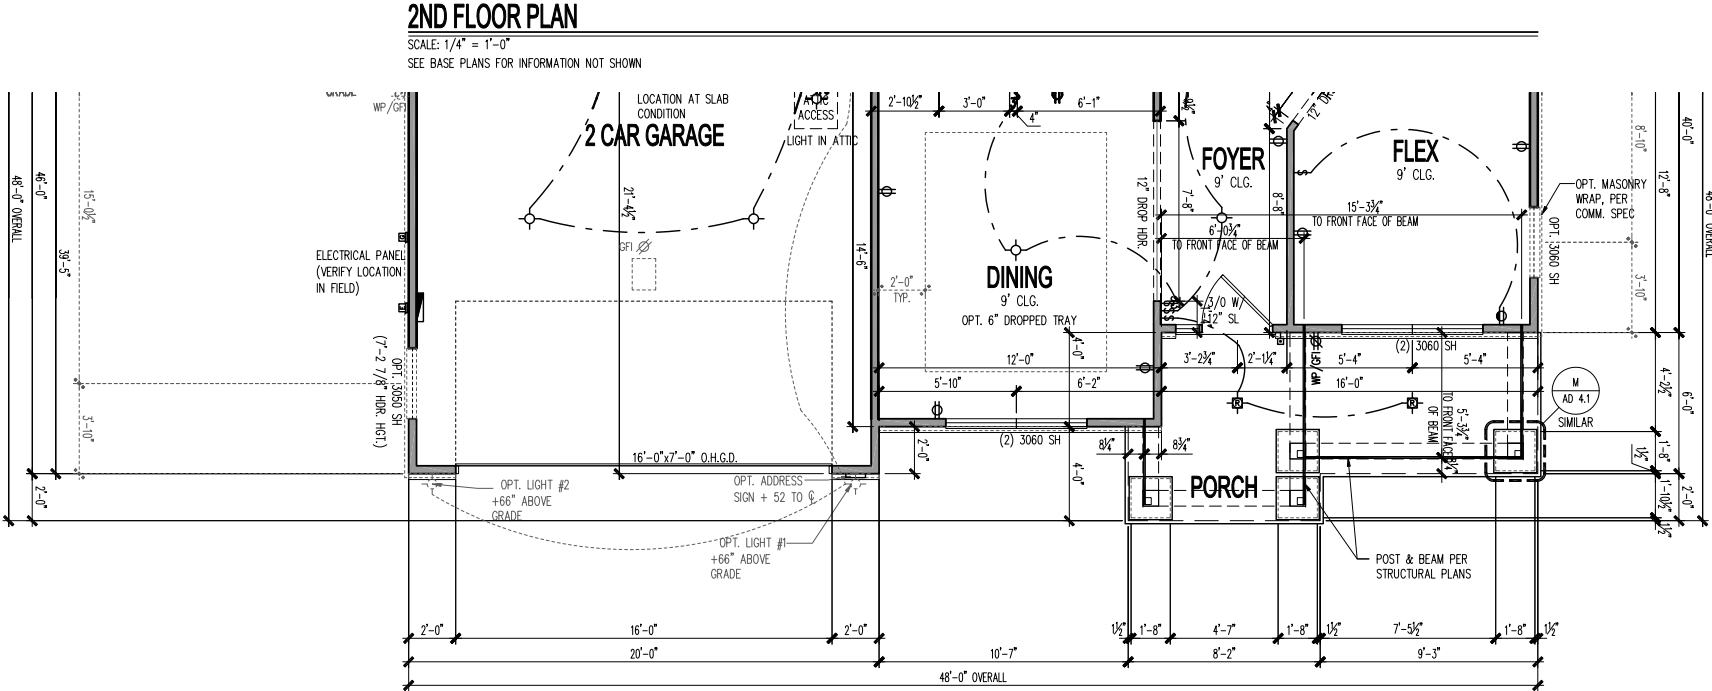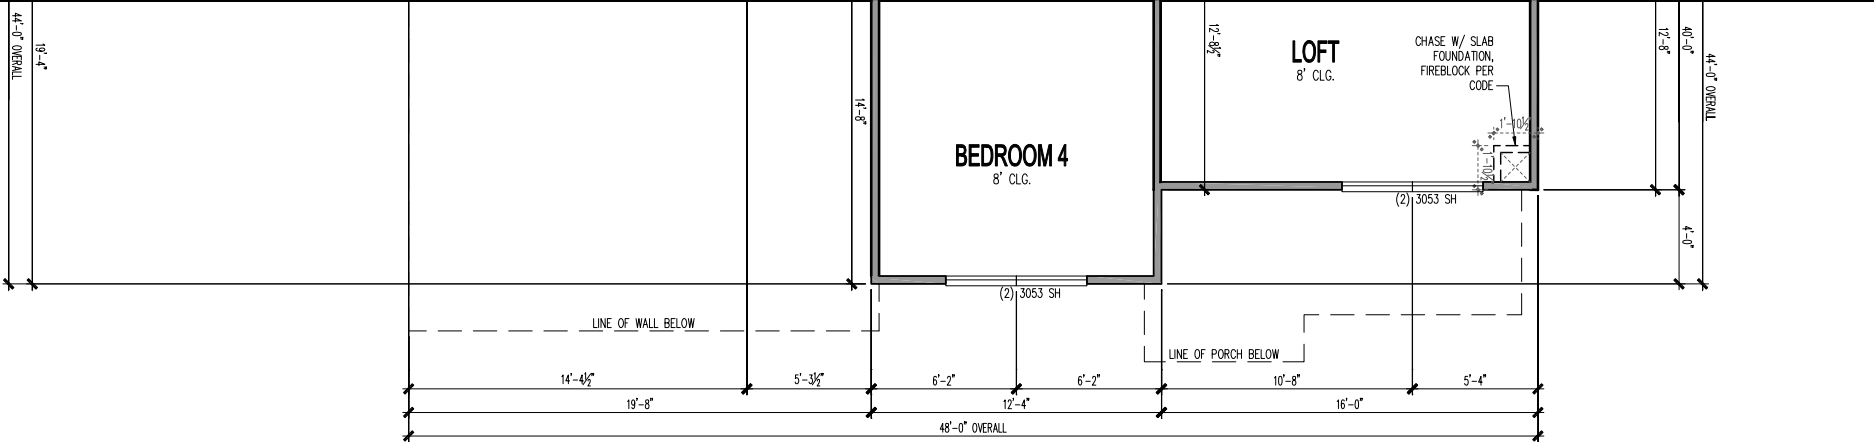

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Partial Plans and General Notes  
2 Car Front Entry  
Heartland 2G


PRODUCT MANAGER Rick Starkey INITIAL RELEASE DATE: 01/18/2019
REV# DATE/DESCRIPTION
01/18/2019
PLAN REFRESH
04/16/2019
PLAN REVISIONS
11/27/2019
PCR REVISIONS

GARAGE HANDING  
LEFT

SPECIFICATION LEVEL

PLAN NAME  
Riverton  
NPC CHILD NUMBER  
1853.302

SHEET  
A3-HR2G  
2FB4.2

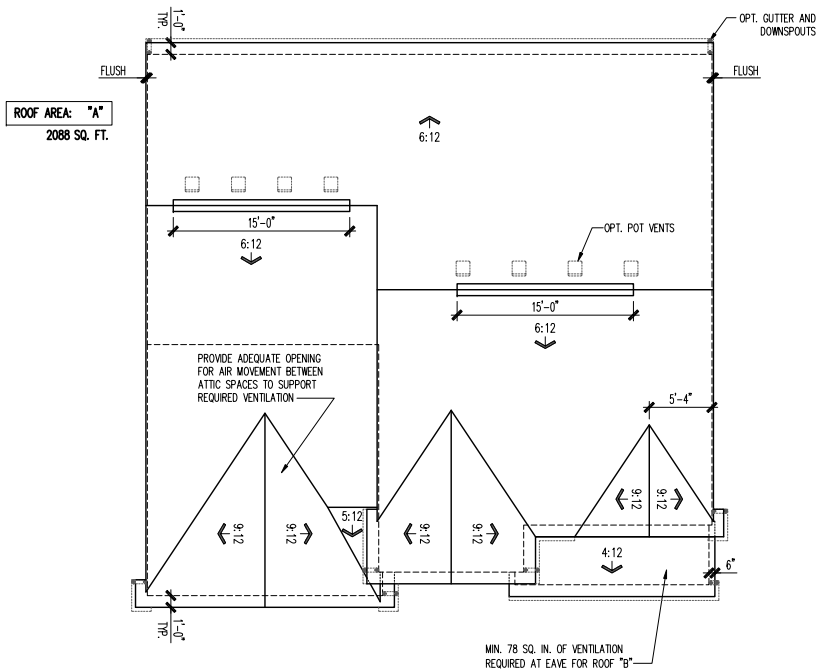


ROOF PLAN  
SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
Heartland 2M									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON PITCH, VENT VALUES AND ROOF AREA VALUES SHOWN IN TABLE ABOVE.									
* CALCULATED MINIMUM VENTILATION ARE RECOMMENDED FOR VENTING THAT MEETS THE MIN. SUPPLY VENTILATION TO MEET CODE REQUIREMENTS.									
* VENTILATION HAS BEEN CALCULATED ASSUMING ONE VENTILATION AT 30-SQ. FT. TOTAL AND ROOF AT 6:12-PITCH. TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FT.	2088	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT. LARGE (S.A. IN. MIN.)	POT. SMALL (S.A. IN. MIN.)	ROOF VENT (S.A. IN. MIN.)	SAVE VENT (S.A. IN. MIN.)	CONC. VENT (S.A. IN. MIN.)		
HIGH-POT. VENT ONLY	3.78	3.48	3.39	44.12	8	0			
AT EAVE	4.18	3.48	3.94	33.88			0	87.00	
TOTAL REQ.	6.94	6.94	7.33	100.00					
HIGH-POT. VENT ONLY	3.78	3.48	3.75	48.85	0	0	30.00		
AT EAVE	4.18	3.48	3.94	81.25			0	87.00	
TOTAL REQ.	6.94	6.94	7.71	100.00	ADDITIONAL POT. VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AVAILABLE				


SIDE AND REAR WINDOWS PER  
COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

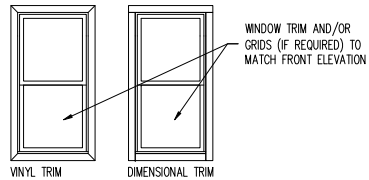


FRONT ELEVATION  
SCALE: 1/4" = 1'-0"


NO WINDOW GRIDS OR TRIM ON/AROUND SIDE OR REAR WINDOWS  
unless noted in community specs.

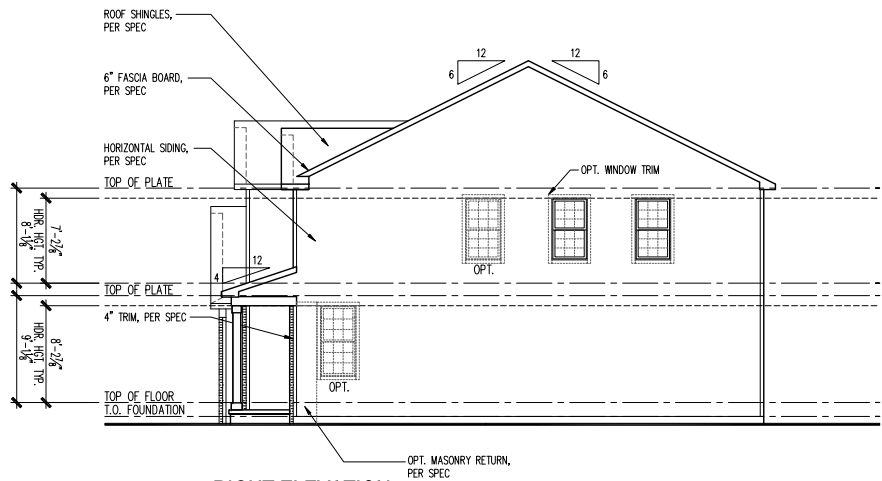

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

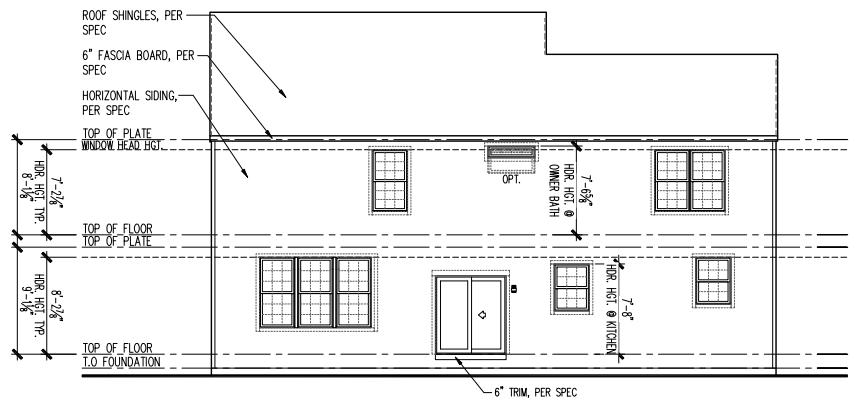


REAR ELEVATION  
SCALE: 1/8" = 1'-0"

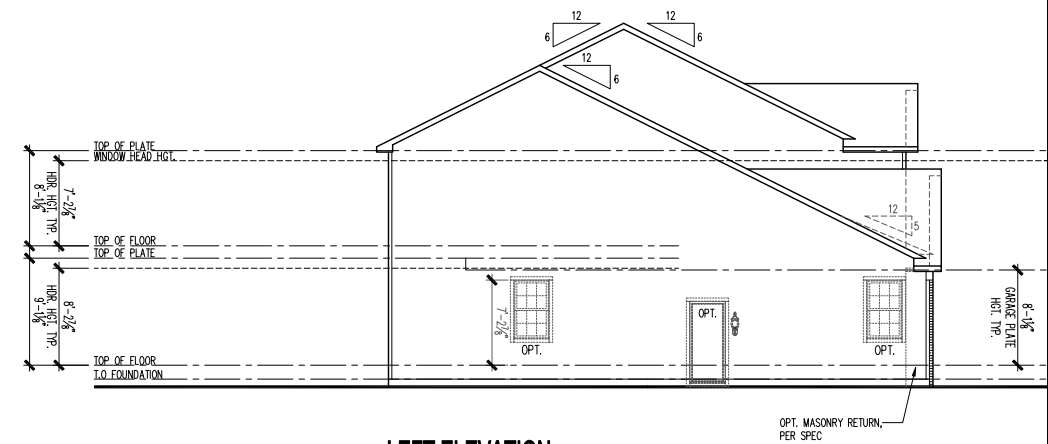

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"




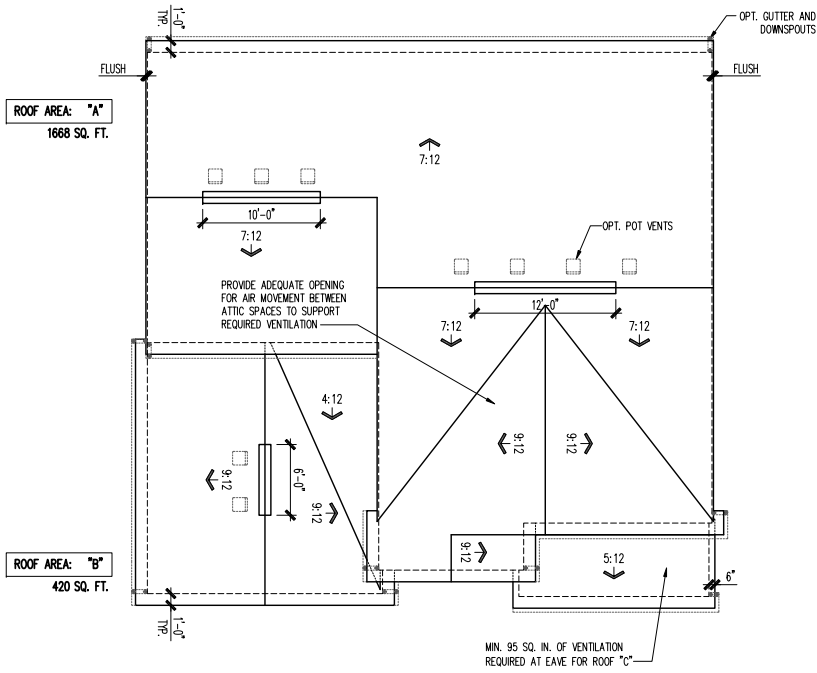

ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
Heartland 3M									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINGENCY REGULATORY EVALUATION ARE RESPONSIBLE FOR VERIFYING THAT VALUES USED WERE SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50'-0" OF TOTAL AND RIDGE AT 40'-0" OF TOTAL REQUIRED VENTILATION									
Heartland 3M									
ROOF AREA "A"	SQ. FTG	1668	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	RIDGE VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONC. VENT (SQ. FT. RANGE)		
HEAVY POT VENT ONLY	3.23 - 2.79	3.27	47.08	7	0				
AT EAVE	3.34 - 2.79	3.33	33.75			0		48.00	
TOTAL (sq. ft.)	5.56	5.56	6.30	100.00					
HEAVY RIDGE VENT	3.23 - 2.79	2.79	45.31	0	0	22.00			
AT EAVE	3.34 - 2.79	3.33	34.79			0		48.00	
TOTAL (sq. ft.)	5.56	5.56	6.08	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				
ROOF AREA "B"	SQ. FTG	420	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	RIDGE VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONC. VENT (SQ. FT. RANGE)		
HEAVY POT VENT ONLY	0.54 - 0.70	0.85	20.41	2	0				
AT EAVE	0.54 - 0.70	0.83	49.39			0		12.00	
TOTAL (sq. ft.)	1.40	1.40	1.48	100.00					
HEAVY RIDGE VENT	0.54 - 0.70	0.70	47.37	0	0	4.00			
AT EAVE	0.54 - 0.70	0.83	32.43			0		12.00	
TOTAL (sq. ft.)	1.40	1.40	1.58	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

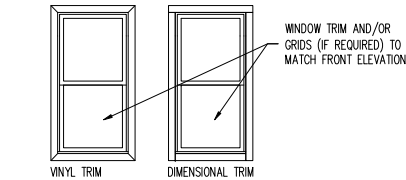


SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

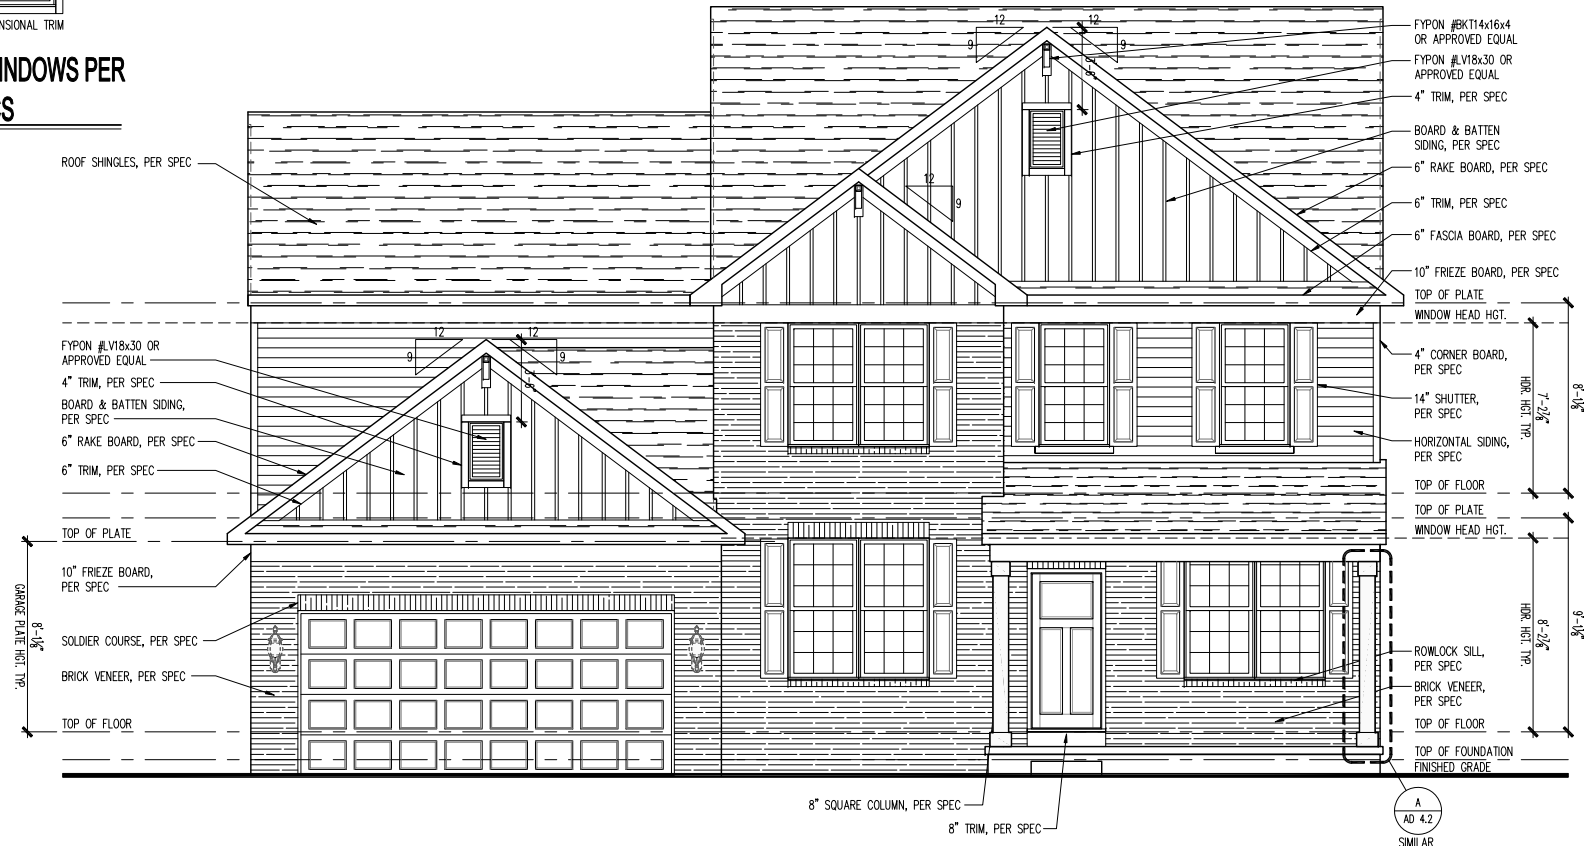


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

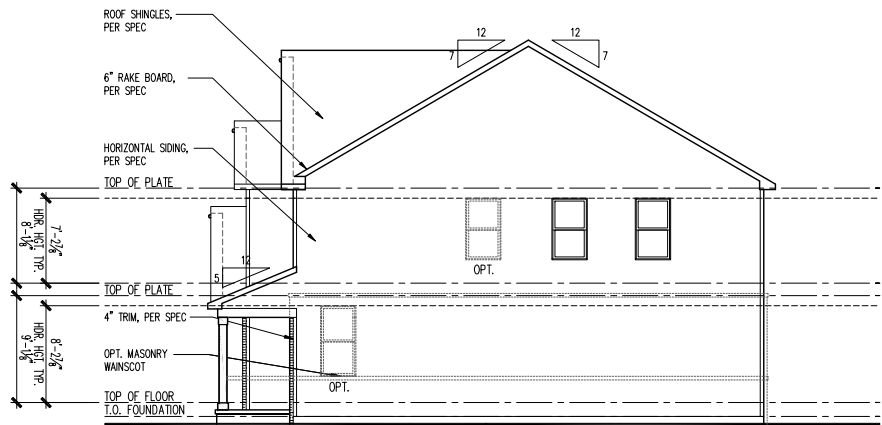


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

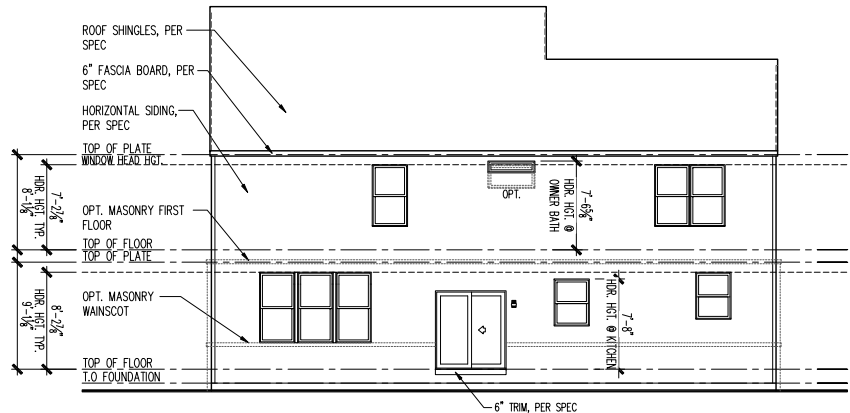

REAR ELEVATION


SCALE: 1/8" = 1'-0"

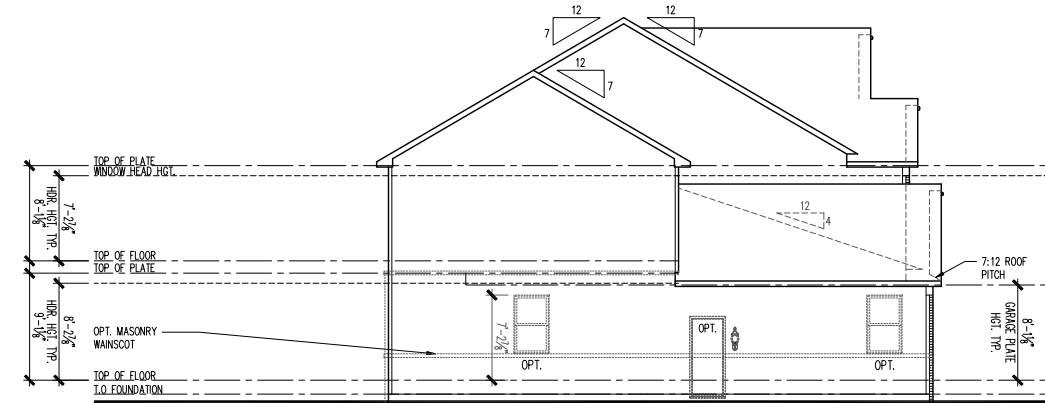

LEFT ELEVATION


SCALE: 1/8" = 1'-0"

PLOTTED: November 8, 2019 / Annie Lee / A3-NC2G 2FB.DWG

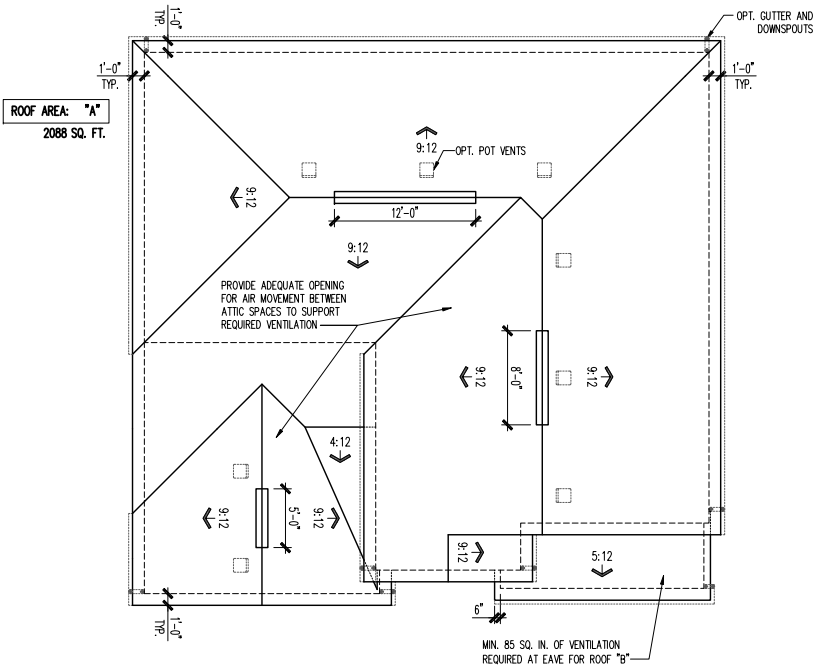

ROOF PLAN  
SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
Northern Craftsman 2G									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND ROOF VENT VALUES SHOWN IN TABLE ABOVE.									
* CONTINGENCY RESERVING EVALUATION ARE RESPONSIBLE FOR VERIFYING THAT VALUES USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50'-0" OF TOTAL AND ROOF AT 40'-0" OF TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FTG	2088	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. OFFICIAL SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	ROOF VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONF. VENT (SQ. FT. RANGE)		
HIGH-POT VENT ONLY	3.78	3.40	3.39	44.04	0	0			
AT EAVE	4.18	3.40	3.39	35.44		0	56.00		
TOTAL	6.96	6.96	7.28	100.00					
HIGH RIDGE VENT	3.78	3.40	3.15	44.00	0	0	25.00		
AT EAVE	4.18	3.40	3.39	35.45		0	56.00		
TOTAL	6.96	6.96	7.01	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

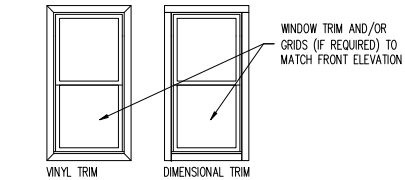


SIDE AND REAR WINDOWS PER COMMUNITY SPECS  
SCALE: 1/4" = 1'-0"




FRONT ELEVATION  
SCALE: 1/4" = 1'-0"

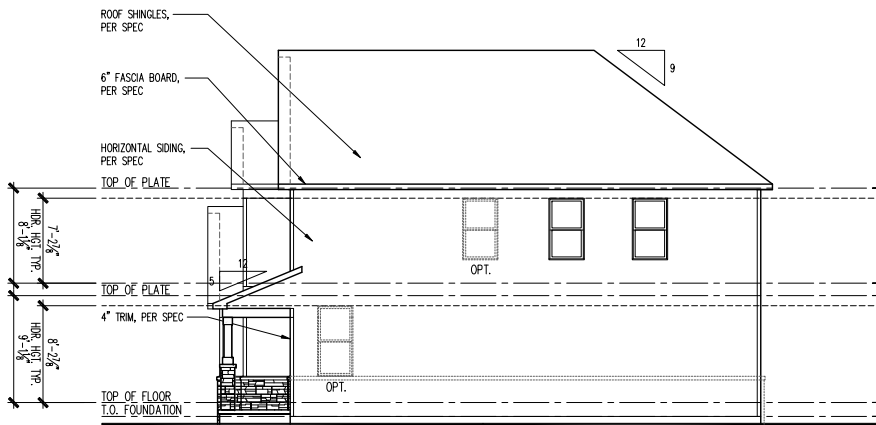

RIGHT ELEVATION  
SCALE: 1/8" = 1'-0"

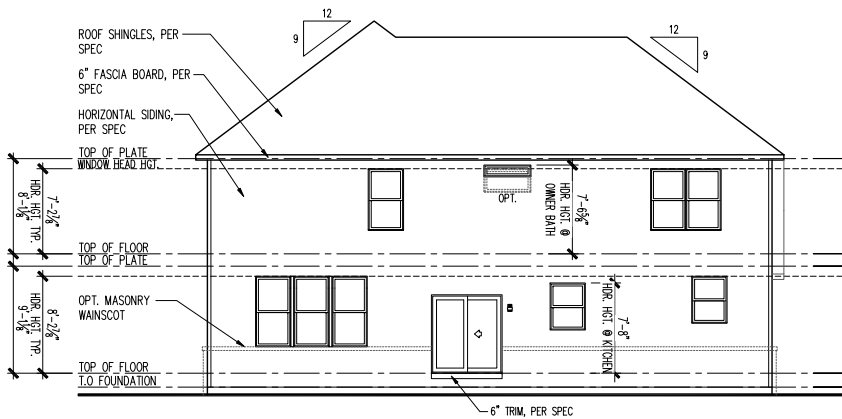

REAR ELEVATION  
SCALE: 1/8" = 1'-0"

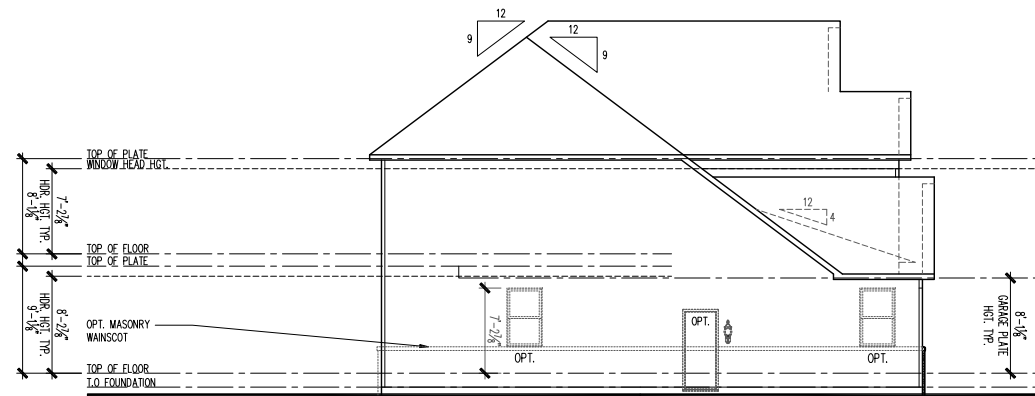

LEFT ELEVATION  
SCALE: 1/8" = 1'-0"

(c) Copyright 2019, PulteGroup, Inc.

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



Front, Side and Rear Elevations  
2 Car Front Entry  
Northern Craftsman 2G

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019 PLAN REFRESH
2	04/16/2019 PLAN REVISIONS
3	11/27/2019 PCR REVISIONS
4	
5	
6	
7	
8	


GARAGE HANDING  
LEFT

SPECIFICATION LEVEL

PLAN NAME  
Riverton  
NPC CHILD NUMBER  
1853.302

SHEET  
A3-NC2G  
2FB.1


PLOTTED: November 8, 2019 / A3-PR2M 2FB.LDW

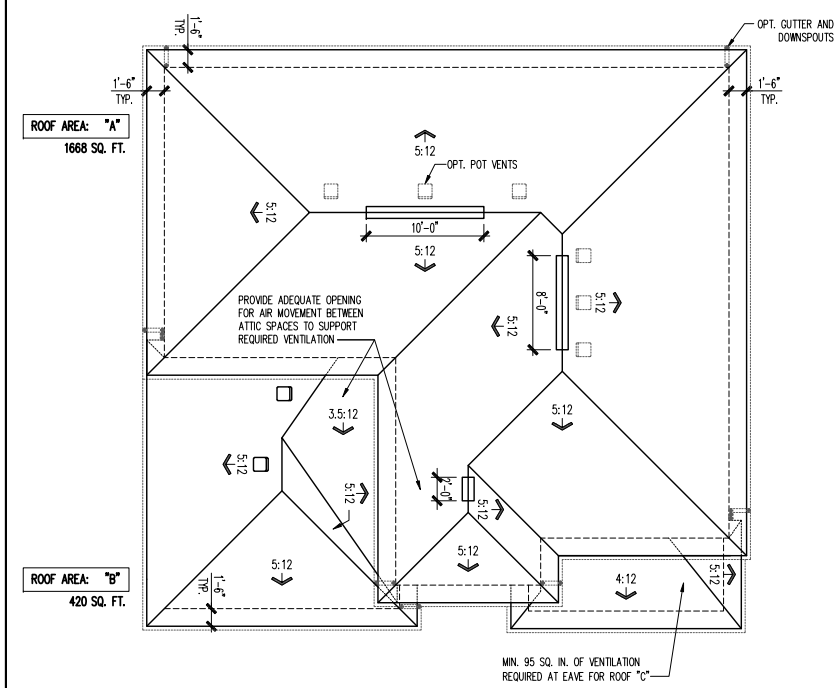

ROOF PLAN


SCALE: 1/8" = 1'-0"

Attic Vent Schedule									
Prairie 2M									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50'-0" OF TOTAL AND RIDGE AT 40'-0" OF TOTAL REQUIRED VENTILATION									
ROOF AREA "A"	SQ. FTG	1668	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	RIDGE VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONC. VENT (SQ. FT. RANGE)		
ROOF POT VENT ONLY	3.22 - 2.79	3.24	45.41	6	0				
AT EAVE	3.34 - 2.79	3.35	54.39			0	44.00		
TOTAL (sq. ft.)	5.56	5.56	5.60	100.00					
ROOF RIDGE VENT	3.22 - 2.79	3.20	45.00	0	0	20.00			
AT EAVE	3.34 - 2.79	3.35	55.00			0	44.00		
TOTAL (sq. ft.)	5.56	5.56	5.56	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				
ROOF AREA "B"	SQ. FTG	420	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. FT. RANGE)	POT SMALL (SQ. FT. RANGE)	RIDGE VENT (SQ. FT. RANGE)	SAVE VENT (SQ. FT. RANGE)	CONC. VENT (SQ. FT. RANGE)		
ROOF POT VENT ONLY	0.54 - 0.70	0.65	20.41	2	0				
AT EAVE	0.54 - 0.70	0.60	41.39			0	12.00		
TOTAL (sq. ft.)	1.40	1.40	1.48	100.00					
ROOF RIDGE VENT	0.54 - 0.70	0.60	44.00	0	0	0.00			
AT EAVE	0.54 - 0.70	0.60	44.00			0	0.00		
TOTAL (sq. ft.)	1.40	1.40	0.00	44.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

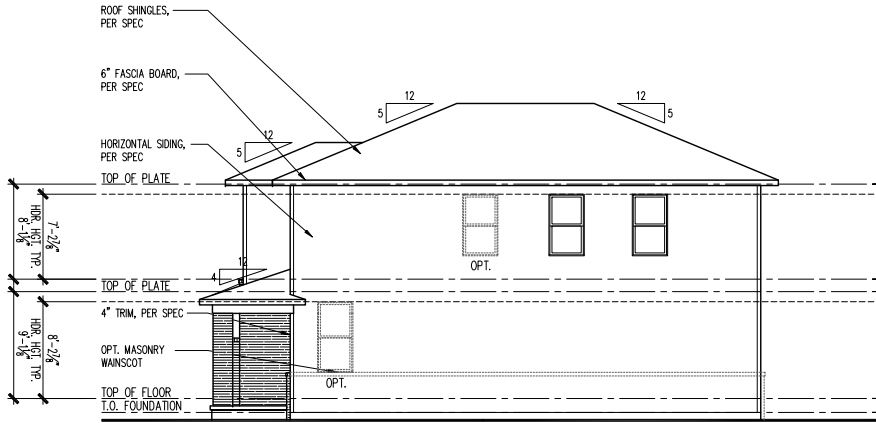


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

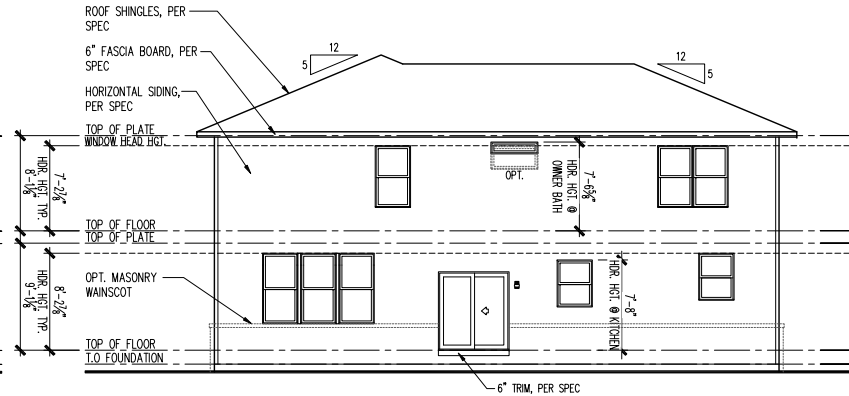


REAR ELEVATION

SCALE: 1/8" = 1'-0"

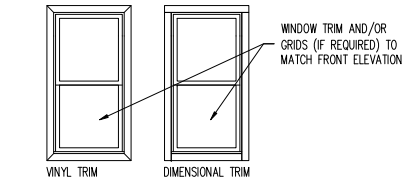

SIDE AND REAR WINDOWS PER COMMUNITY SPECS


SCALE: 1/4" = 1'-0"

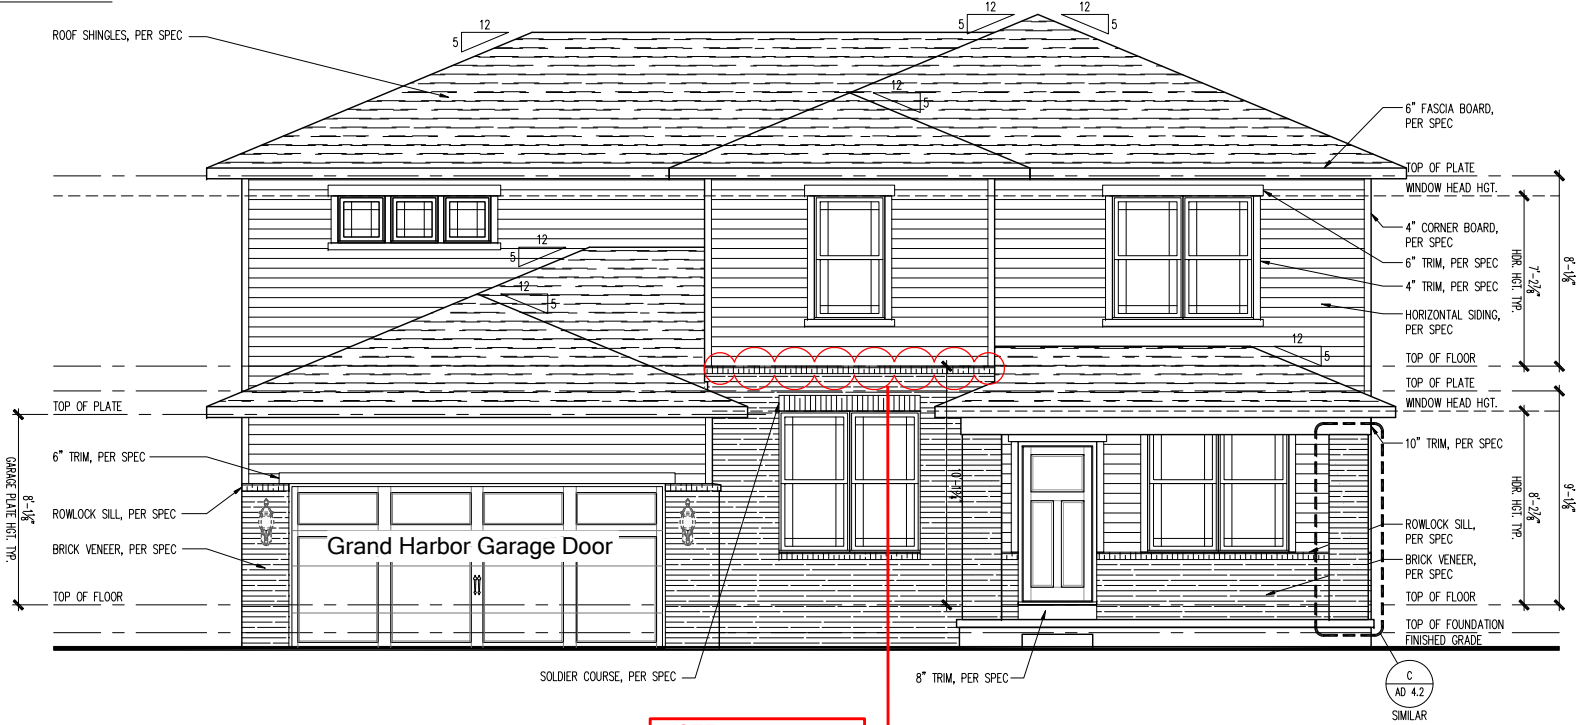

FRONT ELEVATION

SCALE: 1/4" = 1'-0"

NOTE:  
 "L" FLASHING OVER BRICK SILL - THRU-WALL FLASHING BEHIND BRICK WITH WEEP HOLES AT 24" ON CENTER

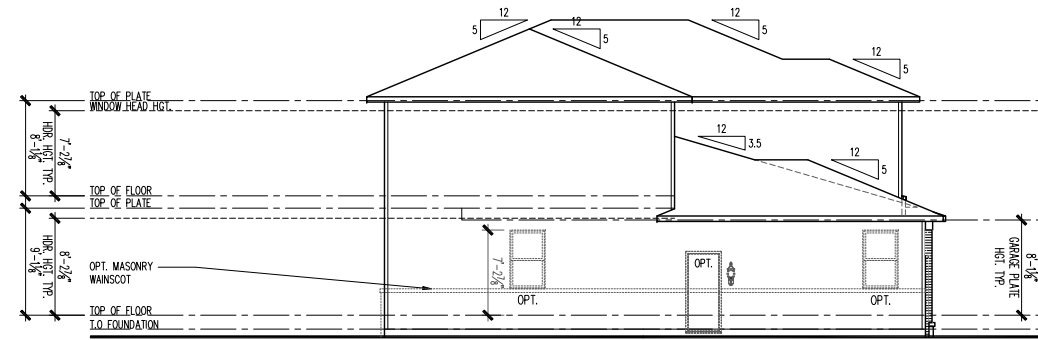

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

(c) Copyright 2019, PulteGroup, Inc.

Midwest Zone Office  
 1900 Golf Road - Suite 300  
 Schaumburg, Illinois 60173



Front, Side and Rear Elevations

2 Car Front Entry

Prairie 2M

PRODUCT MANAGER	
Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	01/18/2019
3	04/16/2019
4	11/27/2019
5	11/27/2019
6	11/27/2019
7	11/27/2019
8	11/27/2019
9	11/27/2019
10	11/27/2019

GARAGE HANDING  
 LEFT

SPECIFICATION LEVEL

PLAN NAME  
 Riverton  
 NPC CHILD NUMBER  
 1853.302

SHEET  
 A3-PR2M  
 2FB.1



# WESTCHESTER

4-7 Bedrooms | 2.5-5 Bathrooms | 3,300+ sq. ft.  
Expanded Everyday Entry® | Pulte Planning Center® | Spacious Loft






## Westchester Home Exteriors


---



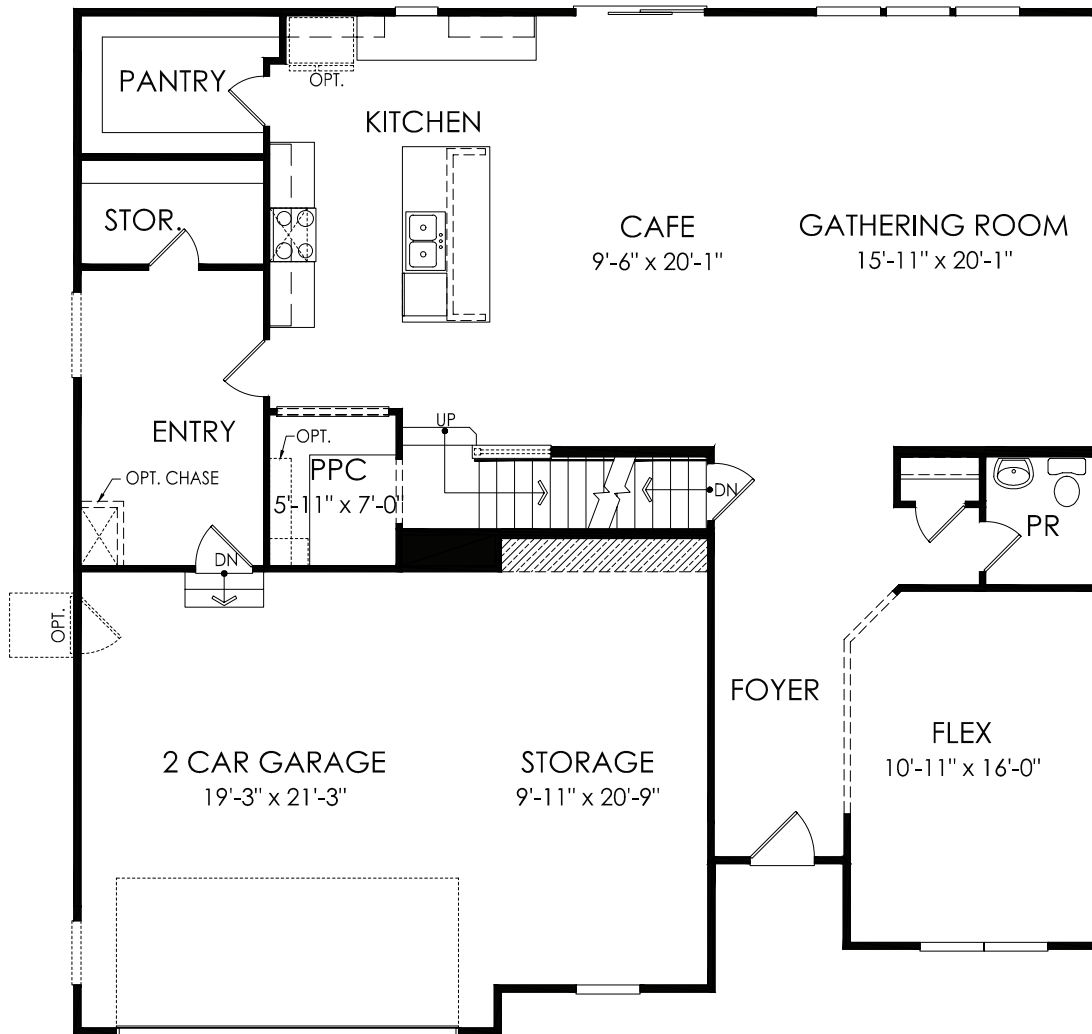

## AVAILABLE OPTIONS


Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on [Pulte.com](https://www.pulte.com).

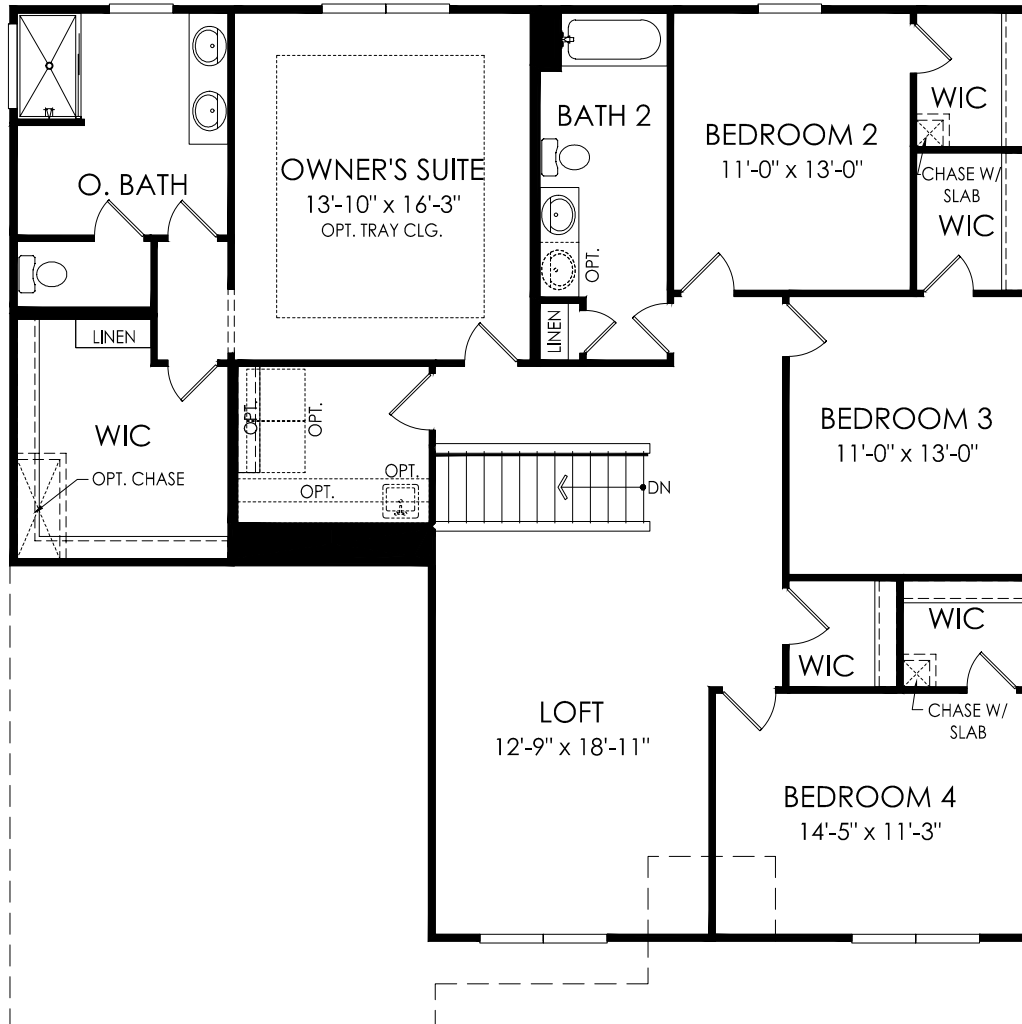

FLOORPLAN NOTES

GENERAL SPECIFICATIONS

1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
2. ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED
3. ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE
4. ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
5. PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
6. PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
7. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
9. PROVIDE 3/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
10. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
11. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
12. PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
13. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
14. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
15. BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-LEVEL WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
16. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

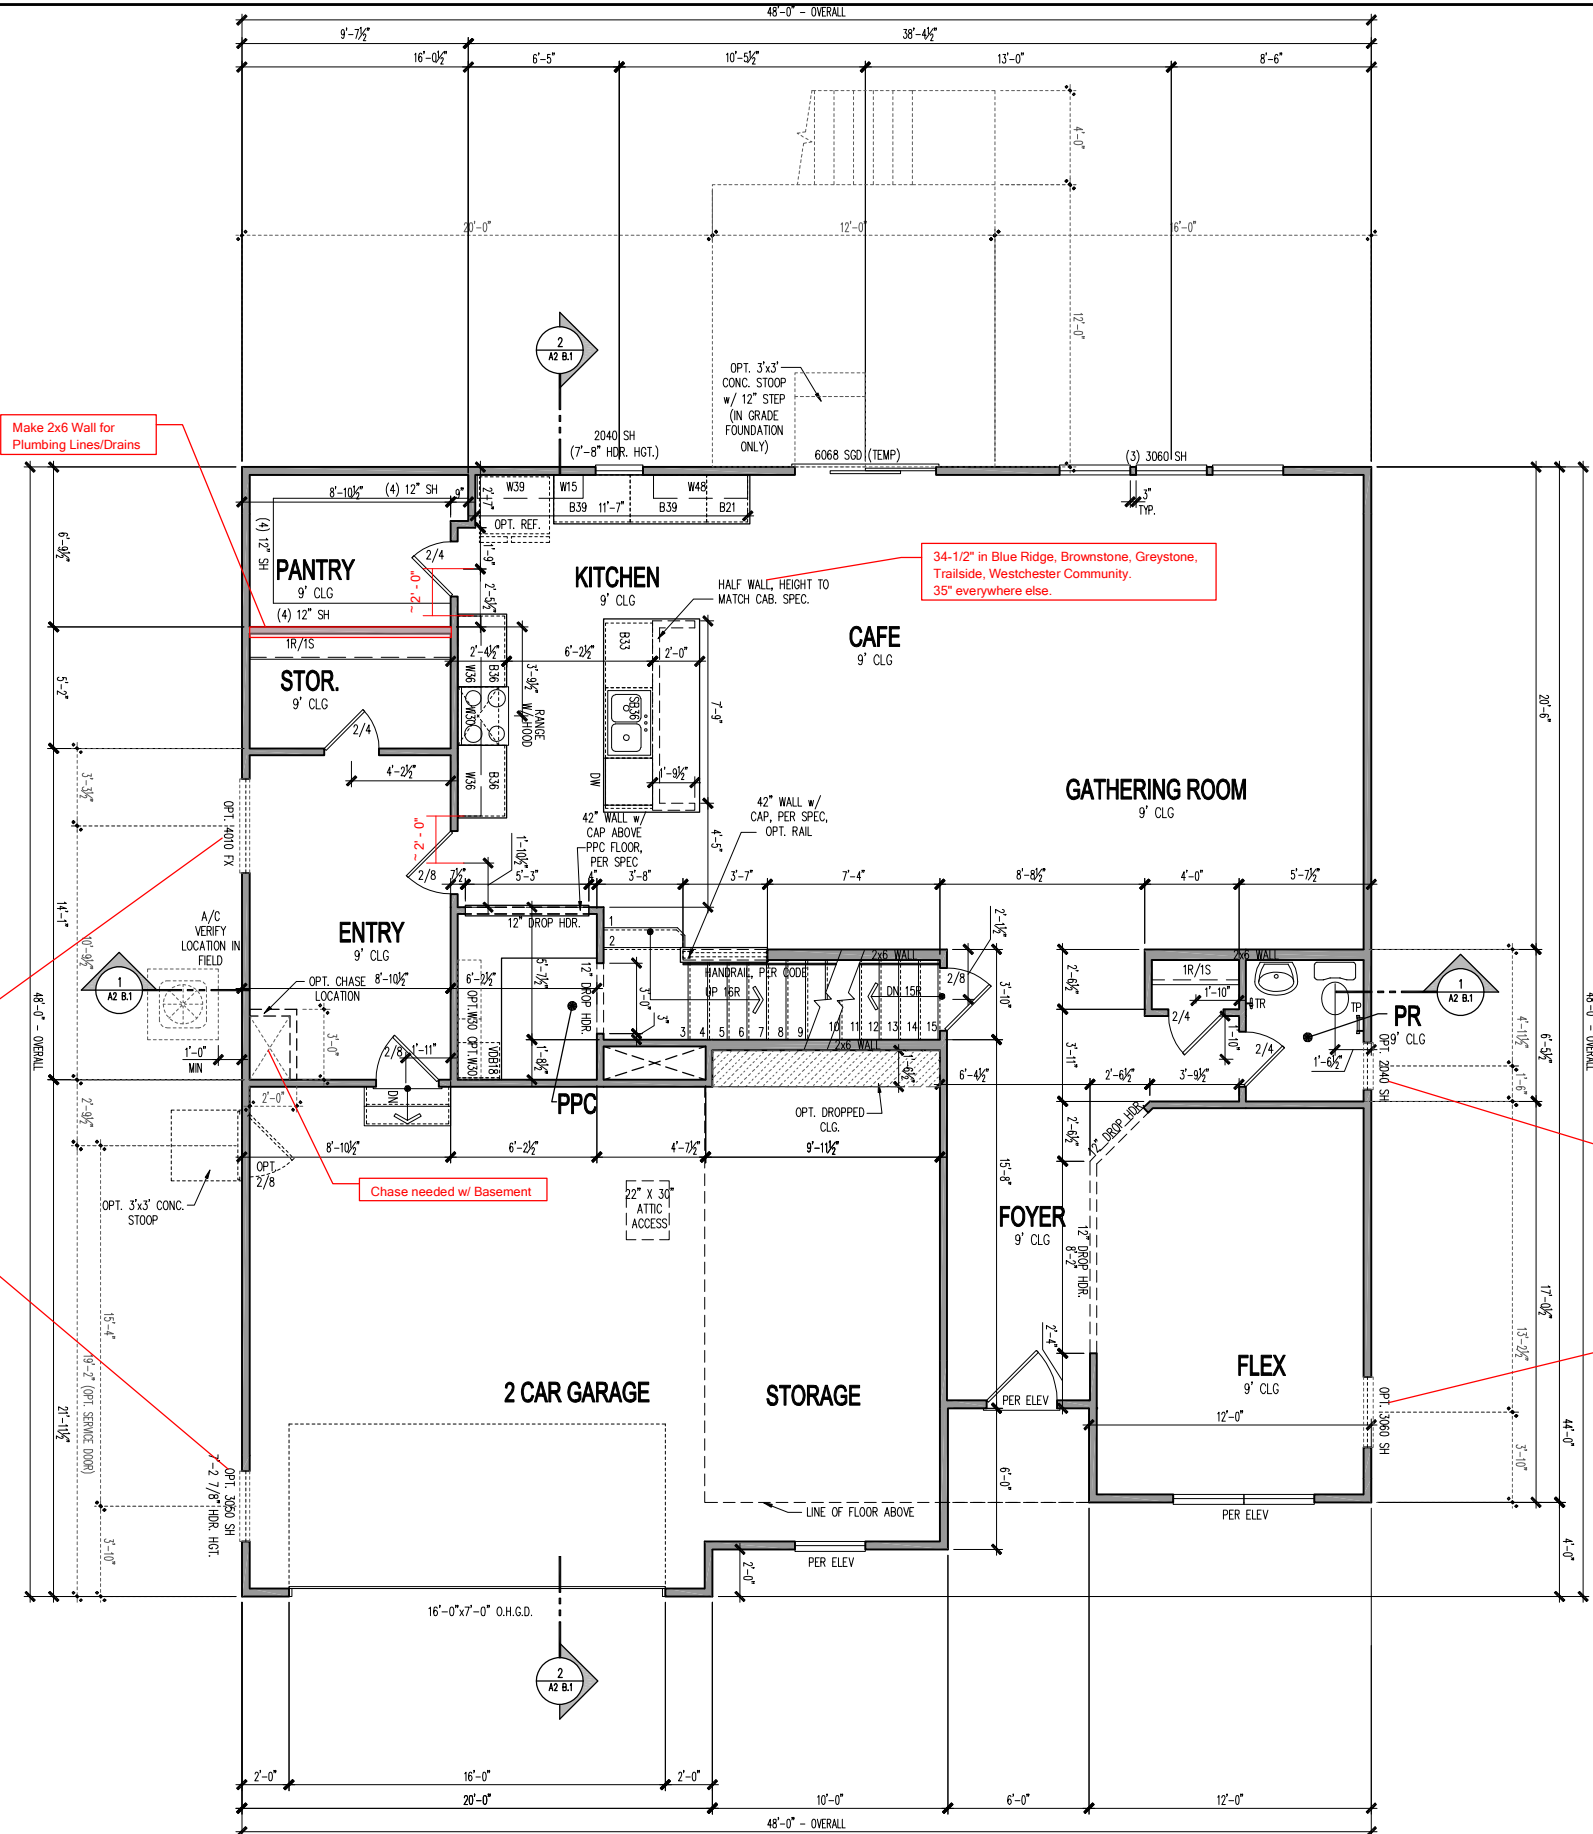

FIRST FLOOR PLAN - 4" EXTERIOR WALLS

SCALE: 1/4" = 1'-0"

Midwest Zone Office  
1900 Golf Road - Suite 300  
Schaumburg, Illinois 60173



First Floor Plan

4" Exterior Walls

PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	11/27/2019
3	
4	
5	
6	
7	
8	
9	
10	

GARAGE HANDING  
LEFT

SPECIFICATION LEVEL  
1

PLAN NAME  
WESTCHESTER  
NPC CHILD NUMBER  
1852.302

SHEET  
A1  
4-1.1

Standard in Brownsstone, Greystone,  
Hunters Run, Blue Ridge, Wood Hollow,  
Lochaven, Westchester, Westmoor, Oakcrest  
communities

Standard in Brownsstone, Greystone,  
Hunters Run, Blue Ridge, Wood Hollow,  
Lochaven, Westchester, Westmoor, Oakcrest  
communities

34-1/2" in Blue Ridge, Brownstone, Greystone,  
Trailside, Westchester Community.  
35" everywhere else.

Chase needed w/ Basement


Make 2x6 Wall for  
Plumbing Lines/Drains



FLOORPLAN NOTES

GENERAL SPECIFICATIONS

1. ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE.
2. ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED.
3. ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE.
4. ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
5. PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
6. PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
7. PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
8. PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
9. PROVIDE 3/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
10. ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
11. ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
12. PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
13. ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
14. ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
15. BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-LEVEL WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
16. FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES.

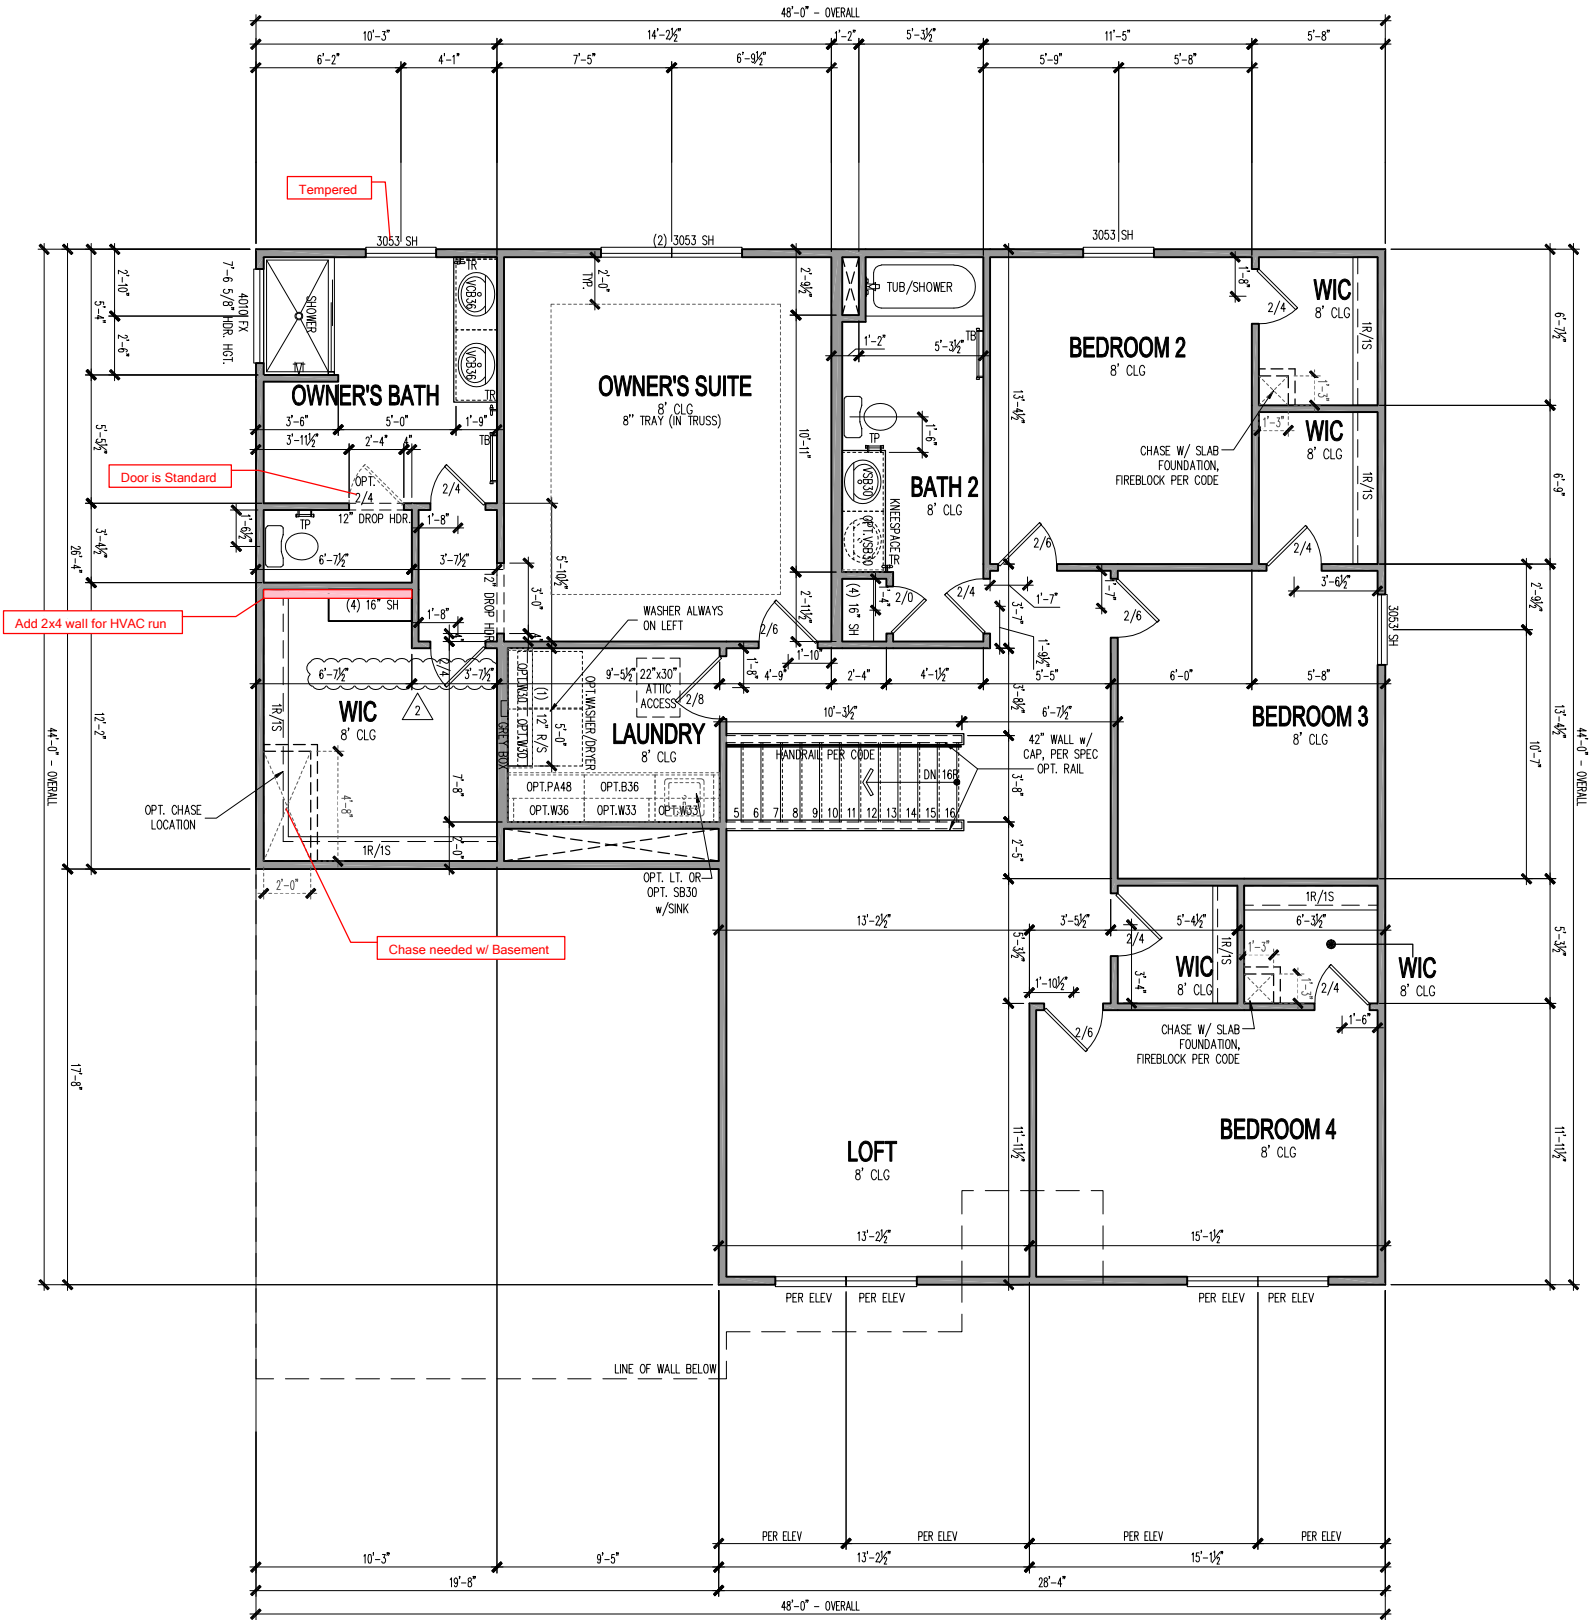


SECOND FLOOR PLAN - 4" EXTERIOR WALLS

SCALE: 1/4" = 1'-0"

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
△	01/18/2019
△	PCR REVISIONS
△	11/27/2019
△	PCR REVISIONS
△	
△	
△	
△	
△	
△	




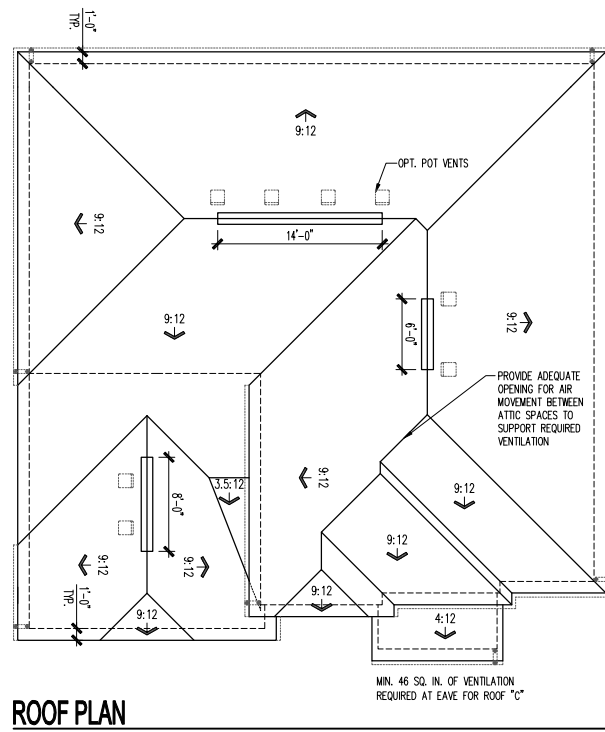

ROOF PLAN

SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE									
VERIFICATION REQUIRED: FIELD SUPPLY IS BASED ON PCF VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE. *CONTRACTOR MUST VERIFY VENTILATION AND REPORT FOR VERIFICATION TO PULTE HOME. VERIFICATION WILL BE REQUIRED TO MEET CODE REQUIREMENTS. *VENTILATION HAS BEEN CALCULATED ASSUMING 80% VENTILATION AT RIDGE OF TOTAL AND 20% AT EAVE OF TOTAL REQUIRED VENTILATION.									
Euro Country 2G									
ROOF AREA "A"	SQ. FTG	2222	AT / NEAR RIDGE			AT / NEAR EAVE			
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	PCF LARGE PLAIN	PCF SMALL PLAIN	RIDGE VENT PLAIN	EAVE VENT PLAIN	CONT. VENT PLAIN	
WIND-UP VENT ONLY	3.34	3.70	3.34	45.00	0	40.00	10.00	30.00	10.00
AT EAVE	4.44	3.70	4.44	64.33			0	68.00	
TOTAL min	7.41	7.41	7.42	100.00					
WIND-UP ROOF VENT	3.34	3.70	3.34	45.17	0	0	37.00		
AT EAVE	4.44	3.70	4.16	64.80			0	68.00	
TOTAL min	7.41	7.41	7.47	100.00					
ADDITIONAL FOR VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOF AVAILABLE									

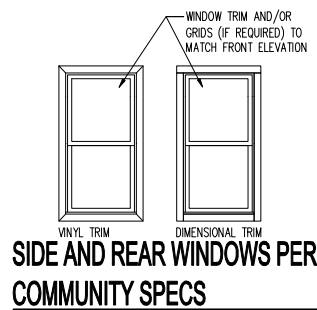


SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




FRONT ELEVATION

SCALE: 1/4" = 1'-0"

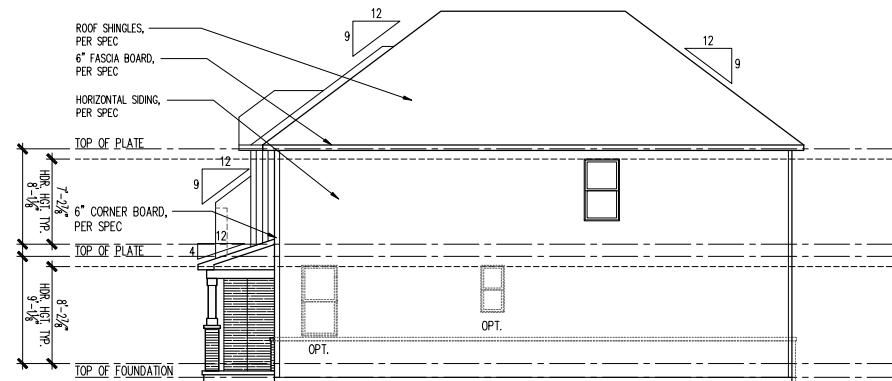


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

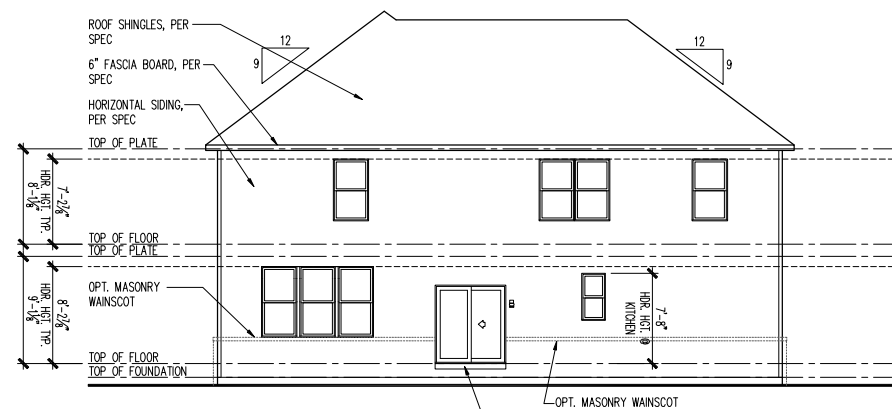


REAR ELEVATION

SCALE: 1/8" = 1'-0"





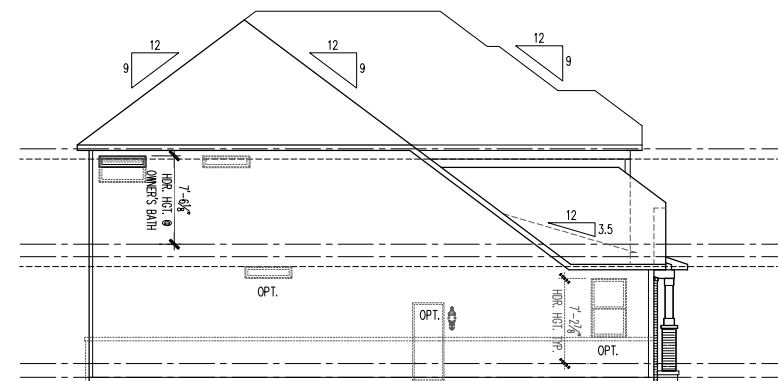


LEFT ELEVATION


SCALE: 1/8" = 1'-0"







SCALE:  $1/8" = 1'-0"$






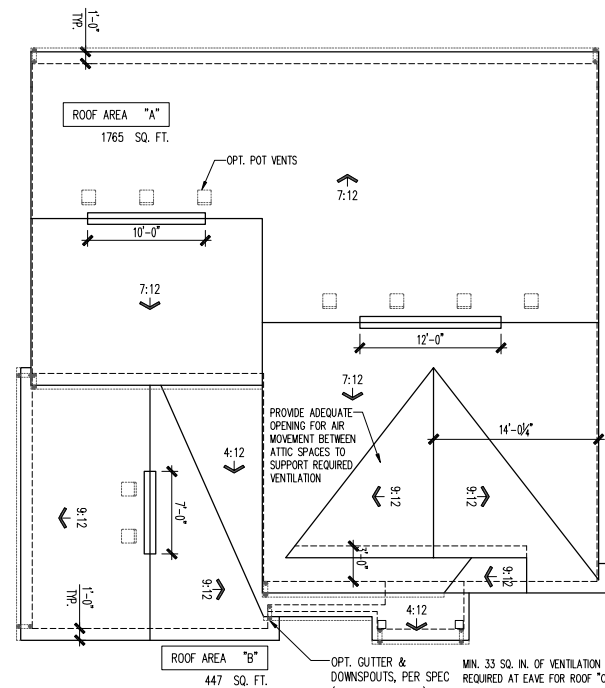

ATTIC VENT SCHEDULE							
VERIFICATION REQUIRED: HODD SUPPLIER & SAVED FOR TOTAL VENT VALUE AND RIDGE VENT VALUE SHOWN IN TABLE ABOVE DISCOUNTS REQUIRED: DISCOUNTS FOR RIDGE VENT VALUE MUST BE TAKEN OFF THE TOTAL VENT VALUE *ADDITIONAL VENT REQUIRED: ADDITIONAL VENT REQUIRED AT RIDGE OF TOTAL VENT VALUE AT RIDGE OF TOTAL REQUIRED *ADDITIONAL VENT REQUIRED: ADDITIONAL VENT REQUIRED AT RIDGE OF TOTAL VENT VALUE AT RIDGE OF TOTAL REQUIRED							
Heartland 2G							
ROOF AREA "A"		SQ FT	1765	AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOUR LARGE VENTS (4x16)	FOUR SMALL VENTS (4x12)	RIDGE VENT (2x16x12)	SAVE VENT (2x16x12)
				61.00	45.00	18.00	28.00
							10.00
HIGH-LOW VENT ONLY	2.50	2.54	2.57	48.8	7	0	
AT EAVE	3.54	3.54	3.13	21.3			0
							45.00
TOTAL SAVED	5.88	5.88	4.09	100.00			
ADDITIONAL VENT REQUIRED IF THREE IS INSUFFICIENT RIDGE AVAILABLE							
ROOF AREA "B"		SQ FT	447	AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOUR LARGE VENTS (4x16)	FOUR SMALL VENTS (4x12)	RIDGE VENT (2x16x12)	SAVE VENT (2x16x12)
				61.00	45.00	18.00	28.00
							10.00
HIGH-LOW VENT ONLY	0.60	0.78	0.83	48.1	2	0	
AT EAVE	0.89	0.78	0.70	21.09			0
							13.00
TOTAL SAVED	1.49	1.49	1.78	100.00			
ADDITIONAL VENT REQUIRED IF THREE IS INSUFFICIENT RIDGE AVAILABLE							
ROOF AREA "C"		SQ FT	447	AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	FOUR LARGE VENTS (4x16)	FOUR SMALL VENTS (4x12)	RIDGE VENT (2x16x12)	SAVE VENT (2x16x12)
				61.00	45.00	18.00	28.00
							10.00
HIGH-LOW VENT ONLY	0.60	0.78	0.83	48.1	2	0	
AT EAVE	0.89	0.78	0.70	21.09			0
							13.00
TOTAL SAVED	1.49	1.49	1.78	100.00			
ADDITIONAL VENT REQUIRED IF THREE IS INSUFFICIENT RIDGE AVAILABLE							

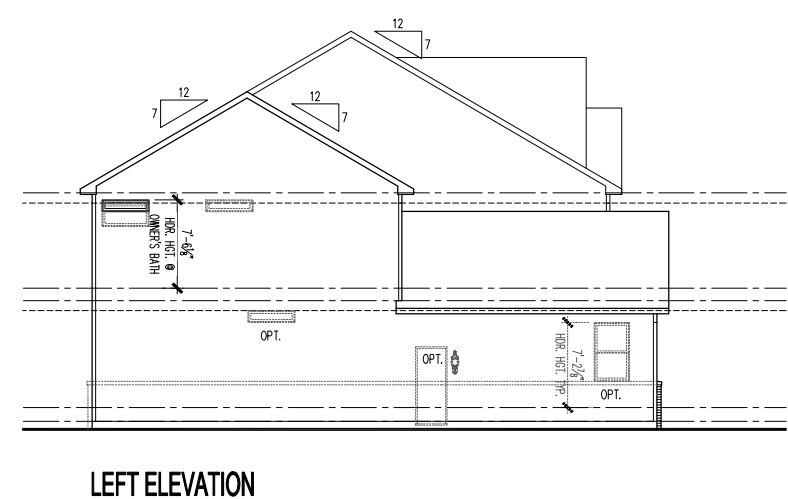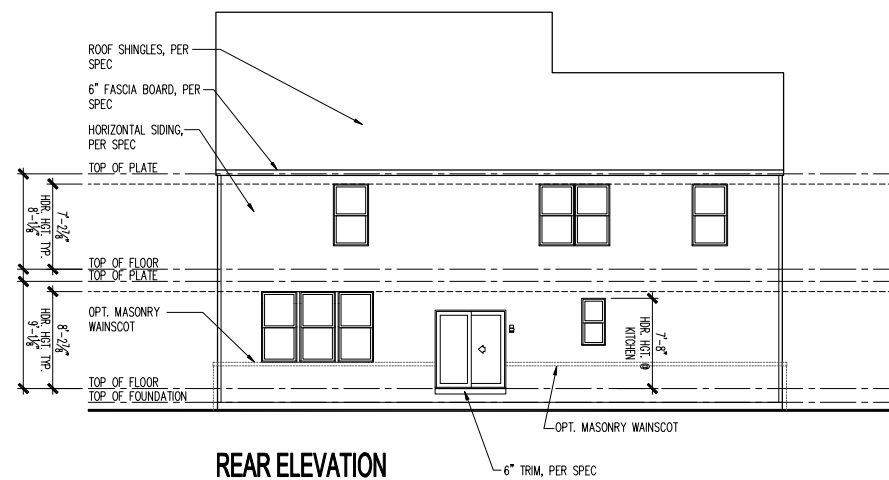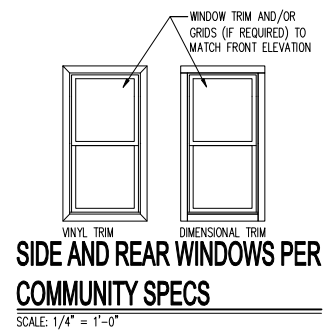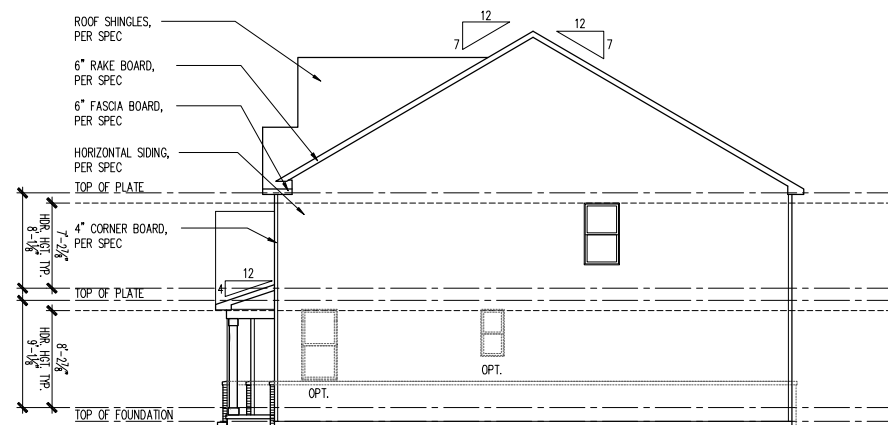

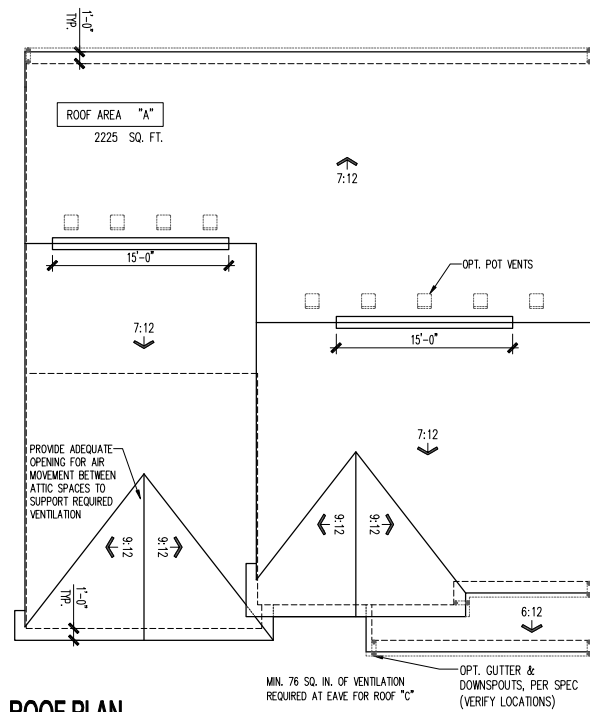

## ATTIC VENT SCHEDULE

VENTILATION REQUIRED AND SUPPLY IS BASED ON FOT 100V VALUES AND REQ'D VENT VALUES SHOWN IN TABLE ABOVE  
 \*CORRELATES ATTIC VENTILATION ARE REQUIRED FOR VENTING GAS VENTED INTO SUPPLY VENTILATION TO MEET CODE REQUIREMENTS  
 \*INCLUDE THE BEST CALCULATED AIRFLOW AND VENTILATION VALUES AT REQ'D RATE OF TOTAL ROOM AIRFLOW






### Heartland 2M


ROOF AREA "A"		SQ FT	2225	AT / NEAR RIDGE			AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLY	POI LARGE AIRFLOW	POI SMALL AIRFLOW	RIDGE VENT AIRFLOW	SAVE VENT AIRFLOW	CONT. VENT AIRFLOW
HIGH-POI VENTILATION	3.97 - 3.71	3.81	49.35	1	0			
AT EAVE	4.46 - 3.71	3.89	50.50			18.00	28.00	10.00
							0	\$6.00
<b>TOTAL</b>	<b>8.44</b>	<b>7.62</b>	<b>7.70</b>	<b>100.00</b>				

HIGH-POI VENT		SQ FT	2225	AT / NEAR RIDGE			AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLY	POI LARGE AIRFLOW	POI SMALL AIRFLOW	RIDGE VENT AIRFLOW	SAVE VENT AIRFLOW	CONT. VENT AIRFLOW
HIGH-POI VENT	3.97 - 3.71	3.75	49.09	0	0	35.00		
AT EAVE	4.46 - 3.71	3.89	50.91				0	\$6.00
<b>TOTAL</b>	<b>8.44</b>	<b>7.62</b>	<b>7.64</b>	<b>100.00</b>				

ADDITIONAL POI VENT MAY BE REQUIRED IF THERE IS INSUFFICIENT ROOM AIR AVAILABLE



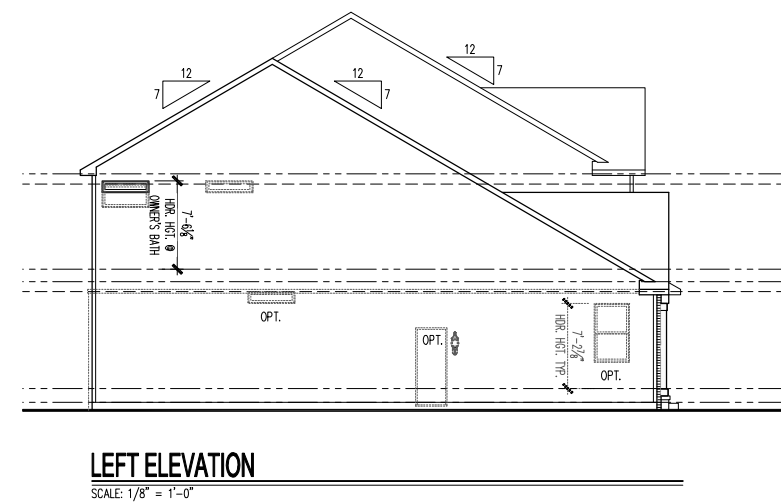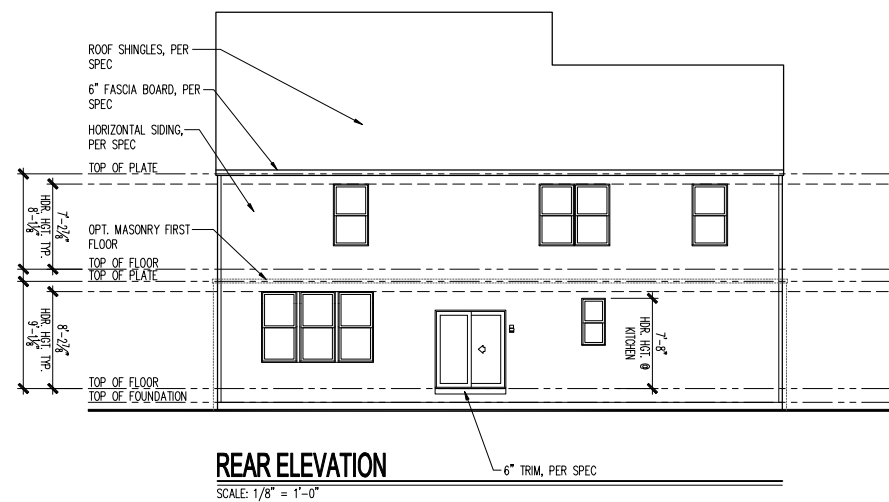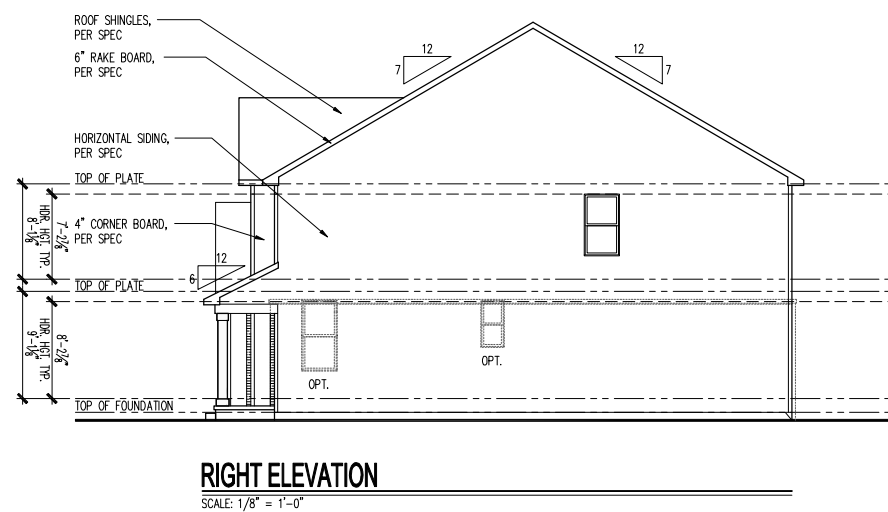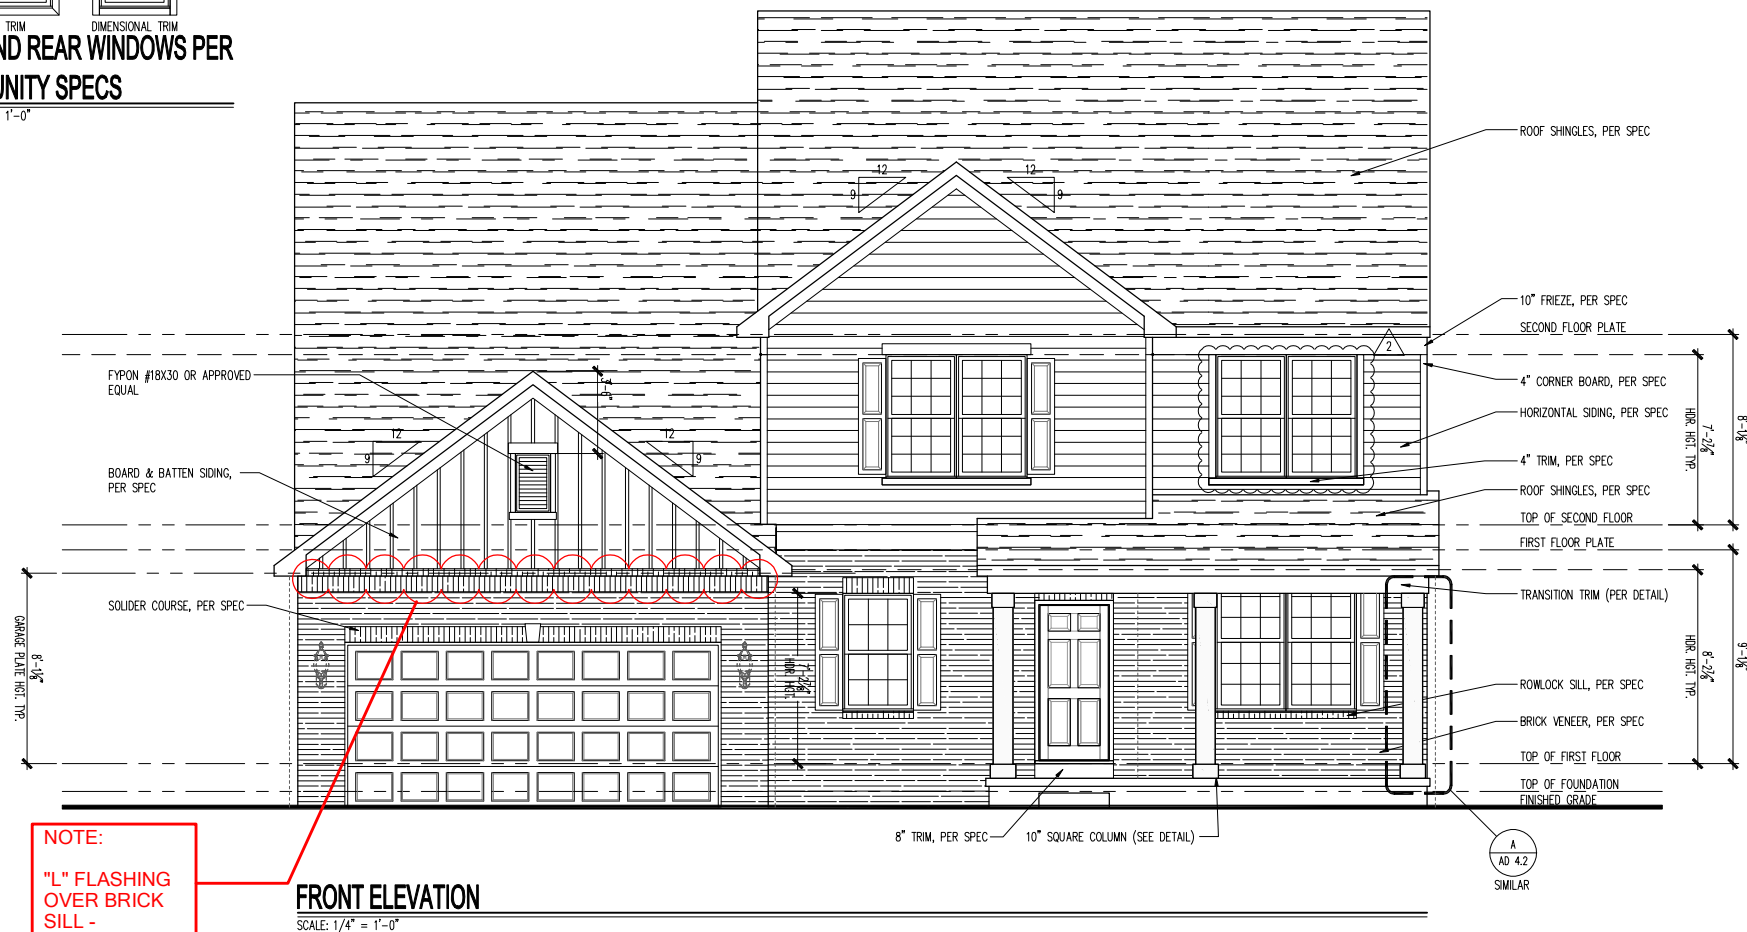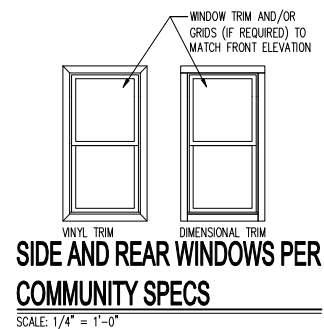
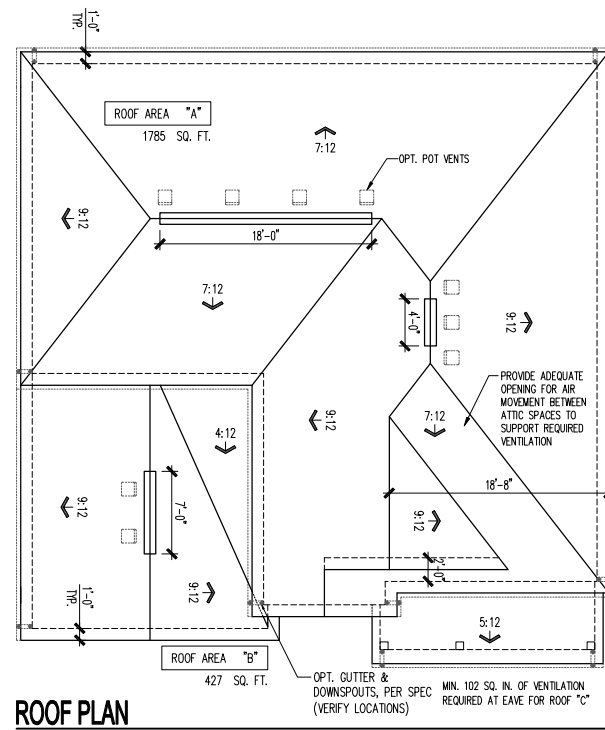
## ATTIC VENT SCHEDULE

VENTILATION REQUIREMENTS AND SUPPLY AIR BASED ON PER SQ. FT. VALUE AND RIDGE VENT VALUE SHOWN IN TABLE ABOVE  
 REQUIREMENTS RELATING TO THESE VENTS ARE BASED ON THE FACTS THAT THEY ARE ALL LEAKY VENTS AND MUST COMPLY WITH MINIMUM  
 REQUIREMENTS FOR LEAKY VENTS. THEREFORE, THESE VENTS ARE NOT TO BE USED FOR SUPPLY AIR OR FOR EXHAUST AIR.

\* INCLUDE THE PERCENT CALCULATED AIRWAYS BEING VENTILATED AT 25% OF TOTAL AND RIDGE AT 40% OF TOTAL VENTILATION






### Heartland SS


ROOF AREA "A"		SQ. FTG.	1785	AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	PORT LARGE (24" DIA.)	PORT SMALL (18" DIA.)	SAVE VENT (24" DIA.)	CONV. VENT (24" DIA.)
WASH-ROOF VENT ONLY	2.58	3.98	3.97	48.81	7	0	0
AT EAVE	3.58	5.98	5.93	51.29		0	45.00
TOTAL 9999	5.95	5.95	4.09	100.00			
WASH-ROOF VENT ONLY	2.58	3.98	3.93	48.81	0	0	25.00
AT EAVE	3.58	5.98	5.75	49.19		0	45.00
TOTAL 9999	5.95	5.95	5.88	100.00			

ADDITIONAL PORT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE






ROOF AREA "B"		SQ. FTG.	427	AT / NEAR RIDGE		AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	PORT LARGE (24" DIA.)	PORT SMALL (18" DIA.)	SAVE VENT (24" DIA.)	CONV. VENT (24" DIA.)
WASH-ROOF VENT ONLY	0.57	0.71	0.68	48.81	2	0	0
AT EAVE	0.68	0.71	0.70	51.19		0	13.00
TOTAL 9999	1.42	1.42	1.78	100.00			
WASH-ROOF VENT ONLY	0.57	0.71	0.68	48.81	0	0	7.00
AT EAVE	0.68	0.71	0.70	50.76		0	13.00
TOTAL 9999	1.42	1.42	1.78	100.00			

ADDITIONAL PORT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE

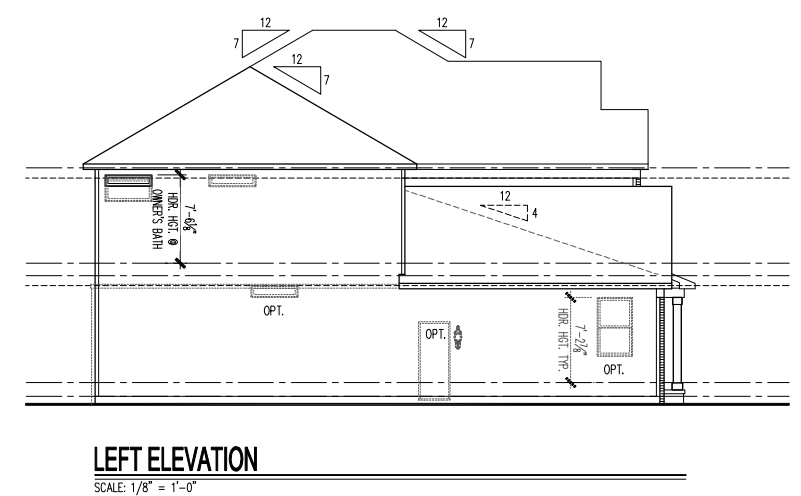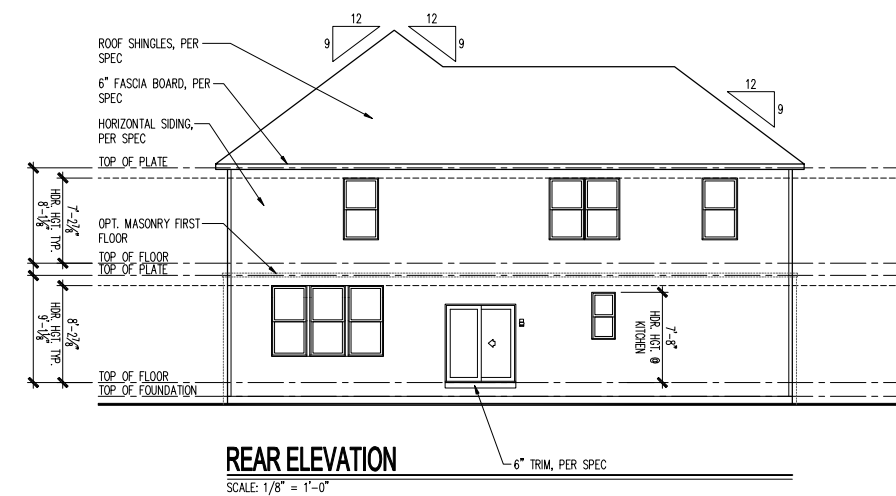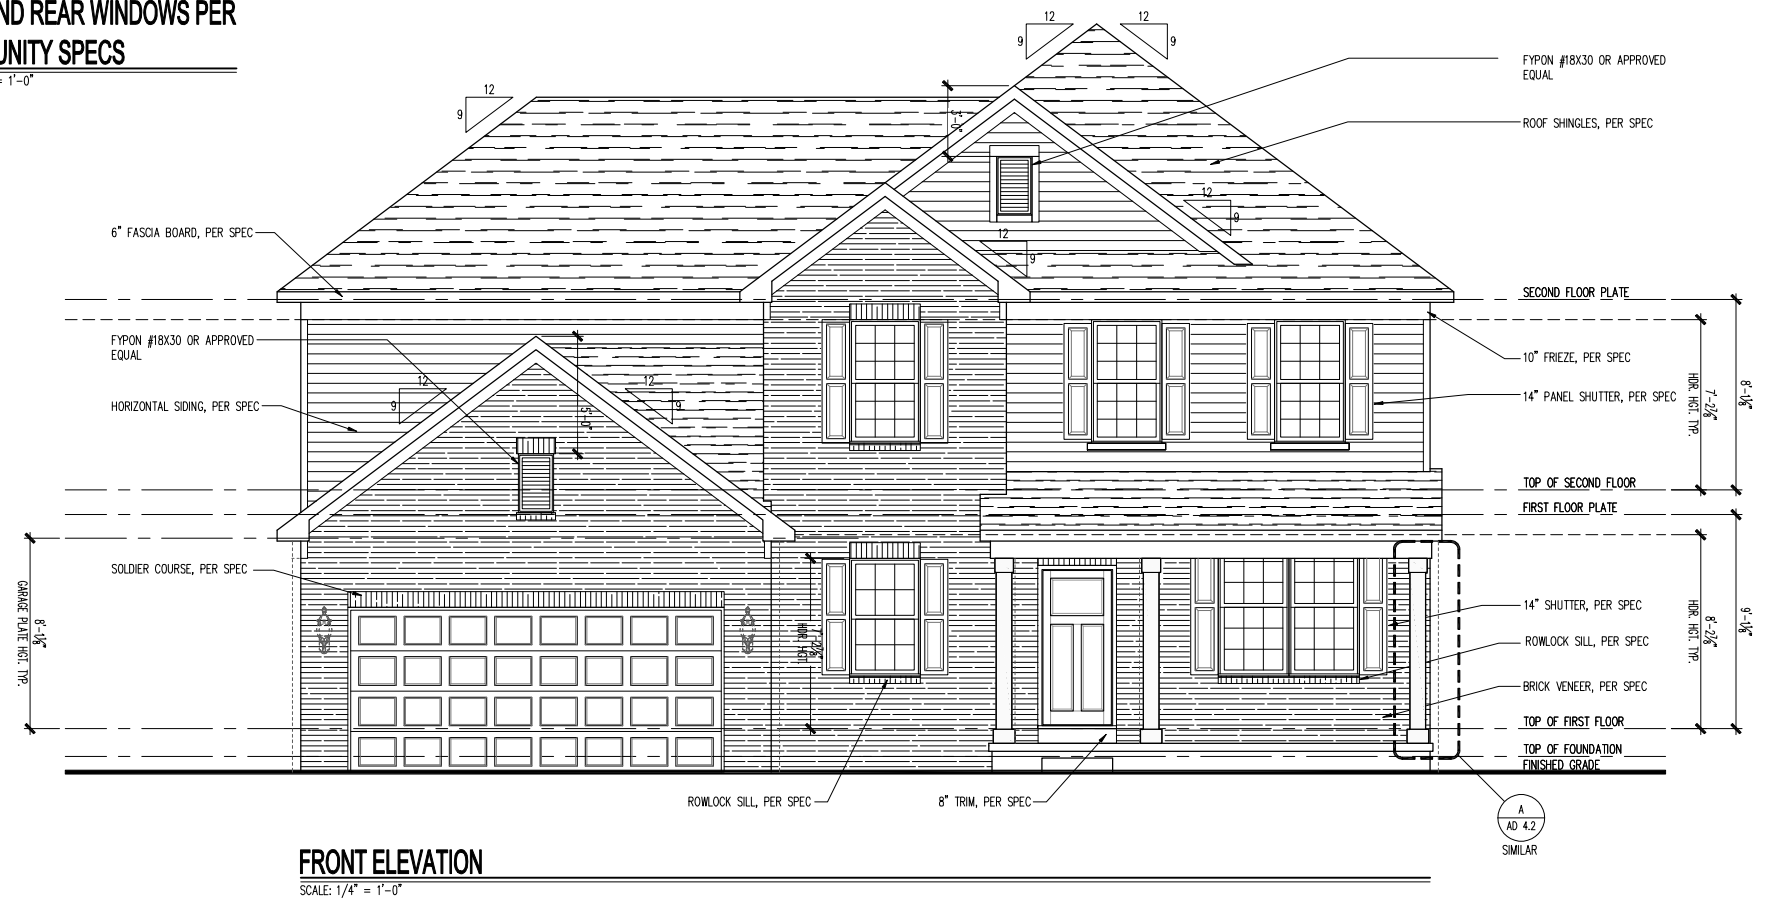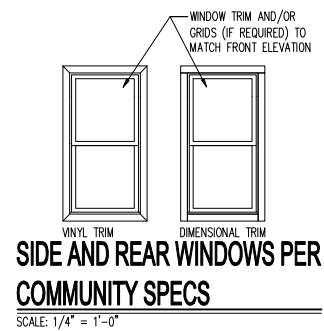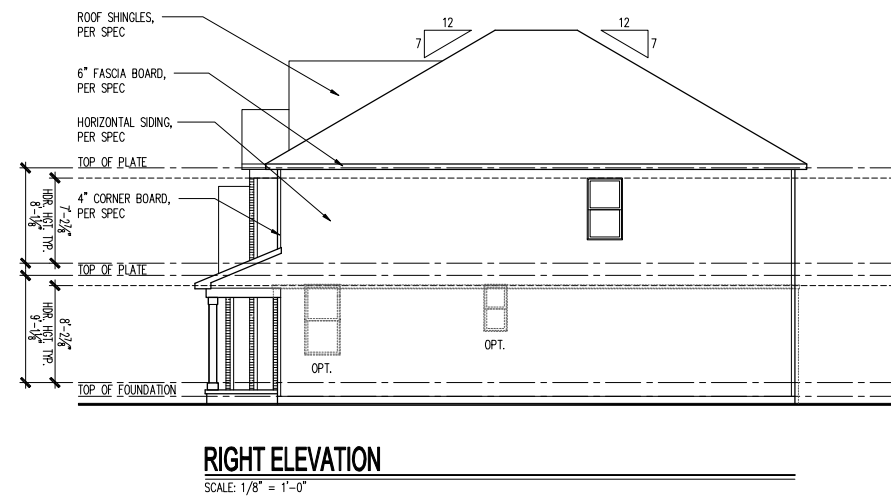


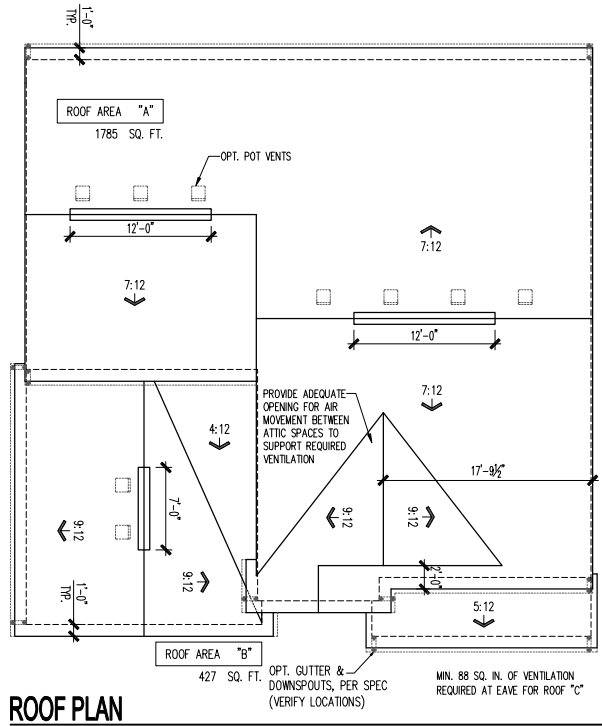

ATTIC VENT SCHEDULE										
<small>           VENTILATION REQUIRED AND SUPPLIED IS BASED ON PITCH VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.            *COMBINATION REQUIRED VENTILATION ARE REQUIRED FOR VENTING TWO VENT TYPES WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENT.            FURNISHING HAS BEEN CALCULATED ASSUMING DATA VENTILATION AT RIDGE OF TOTAL AND RIDGE AT RIDGE OF TOTAL REQUIRED VENTILATION.         </small>										
Heartland 3T										
ROOF AREA "A"	SQ. FTG	1785	AT / NEAR RIDGE		AT / NEAR EAVE					
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE (SQUARE FEET)	POE SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONC. VENT (SQUARE FEET)		
HIGH-POE VENT ONLY	3.38	3.38	5.97	48.49	7	0	40.00	18.00	38.00	10.00
AT EAVE	3.87	3.38	5.13	91.31				0	40.00	
TOTAL	4.44	5.95	4.09	100.00						
HIGH-ROOF VENT	3.38	3.38	5.95	48.49	0	0	34.00			
AT EAVE	3.87	3.38	5.13	91.03				0	40.00	
TOTAL	4.44	5.95	6.13	100.00						
ADDITIONAL POE VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										
ROOF AREA "B"	SQ. FTG	427	AT / NEAR RIDGE		AT / NEAR EAVE					
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE (SQUARE FEET)	POE SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CONC. VENT (SQUARE FEET)		
HIGH-POE VENT ONLY	0.87	0.71	0.88	48.41	2	0				
AT EAVE	0.88	0.71	0.90	91.89				0	13.00	
TOTAL	1.42	1.42	1.78	100.00						
HIGH-ROOF VENT	0.87	0.71	0.88	49.32	0	0	7.00			
AT EAVE	0.88	0.71	0.90	90.78				0	13.00	
TOTAL	1.42	1.42	1.78	100.00						
ADDITIONAL POE VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE										

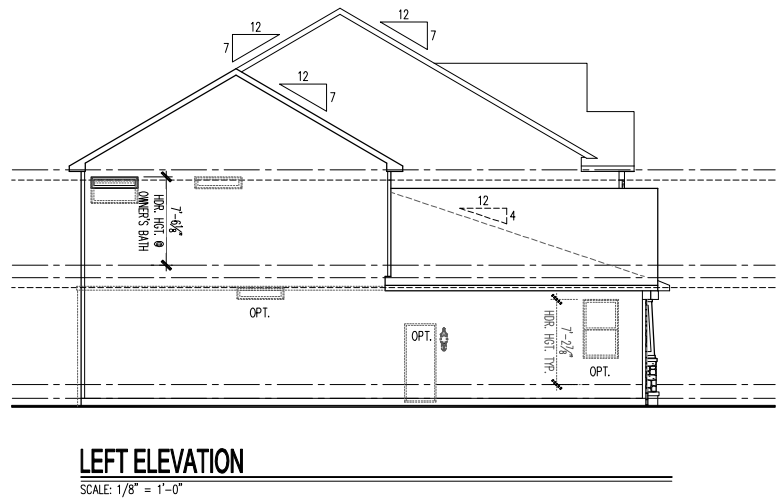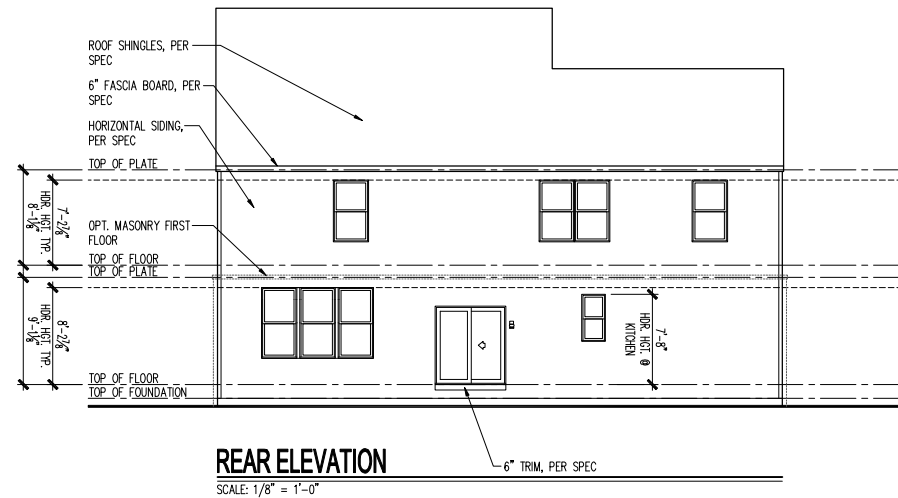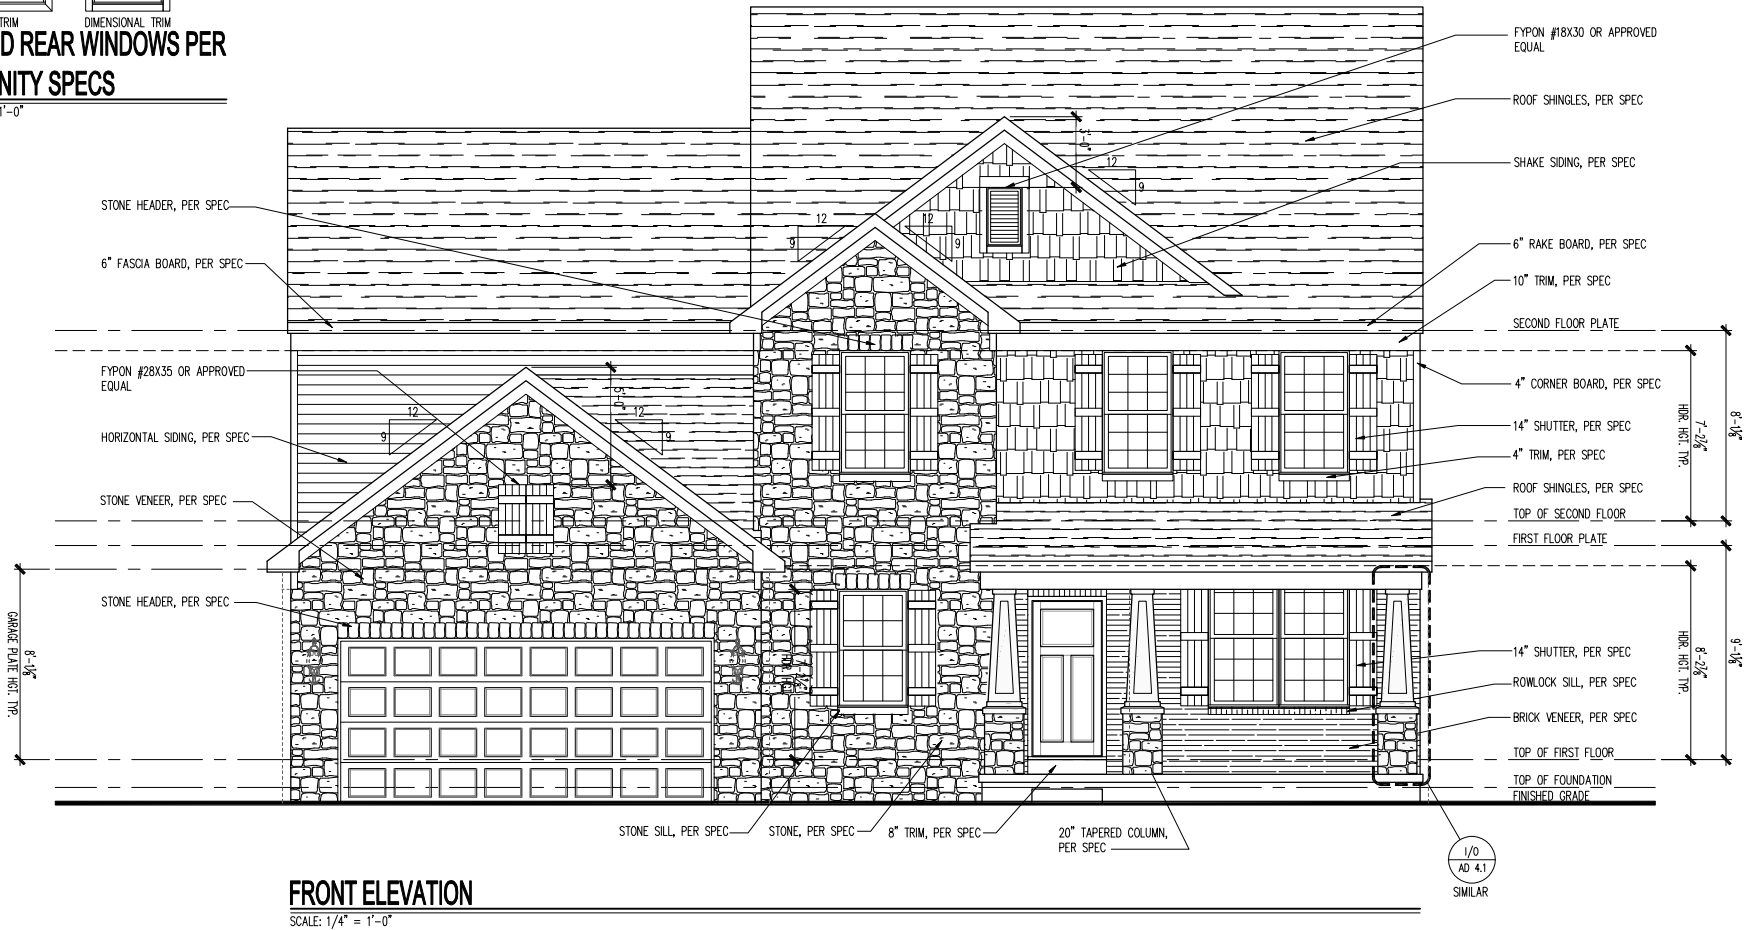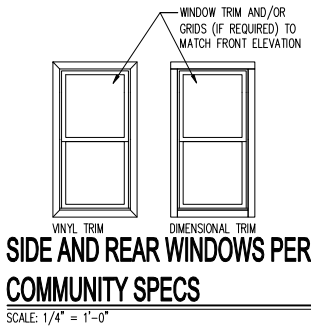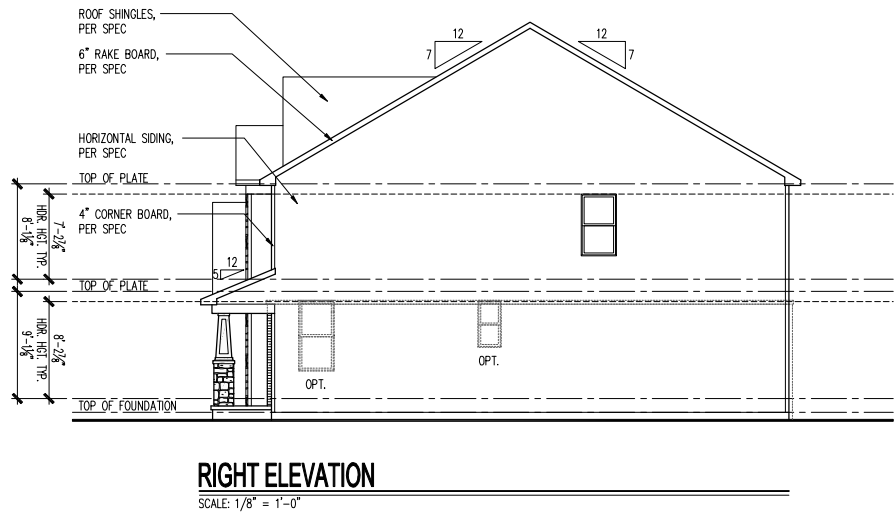



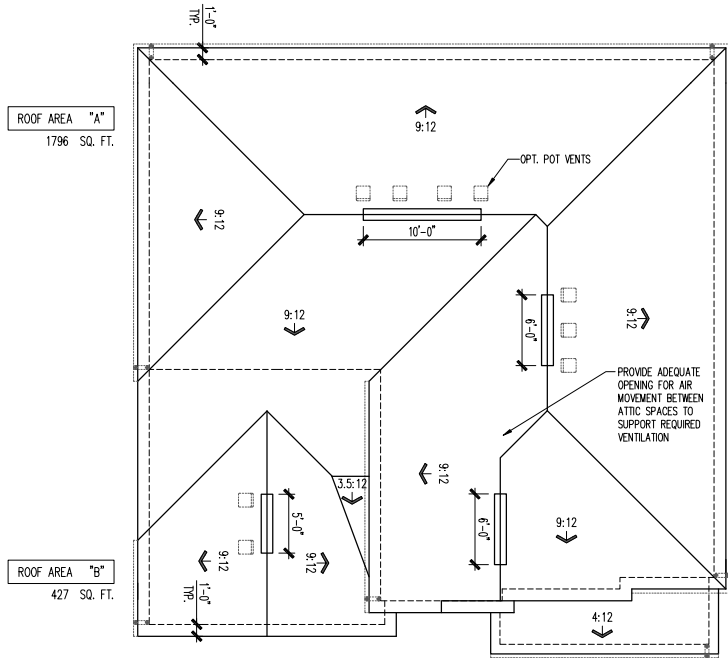

ROOF PLAN


SCALE: 1/8" = 1'-0"

ATTIC VENT SCHEDULE

VERMILION SHEDDING ASSUMED BASED ON 1" VENT TYPES AND RIDGE VENTS SHOWN IN TABLE ABOVE  
CORRELATIONS BETWEEN VERMILION AND REQUIREMENTS VERIFIED THAT VERMILION MEETS EAVE VERMILION TO MEET CODE REQUIREMENTS  
\*SHEDDING HAS BEEN CALCULATED BASED ON 1" VENT TYPES AND RIDGE VENTS AT 48 INCHES OF TOTAL REQUIRED VERMILION

Northern Craftsman 2G

ROOF AREA "A"				AT / NEAR RIDGE			AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE (SQUARE FEET)	POE SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CORNER VENT (SQUARE FEET)
HIGH-POE VENTS ONLY	3.39	3.39	3.37	48.80	7	0		
AT EAVE	3.39	3.39	3.33	48.33			0	48.00
TOTAL	3.39	5.99	4.09	100.00				
ADDITIONAL POE VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE								
ROOF AREA "B"				AT / NEAR RIDGE			AT / NEAR EAVE	
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POE LARGE (SQUARE FEET)	POE SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CORNER VENT (SQUARE FEET)
HIGH-POE VENTS ONLY	0.87	0.71	0.83	48.98	2	0		
AT EAVE	0.88	0.71	0.80	48.00			0	10.00
TOTAL	1.42	1.42	1.54	100.00				
HIGH-POE VENTS ONLY	0.87	0.71	0.83	43.84	0	0	8.00	
AT EAVE	0.88	0.71	0.83	57.14			0	12.00
TOTAL	1.42	1.42	1.66	100.00	ADDITIONAL POE VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE			

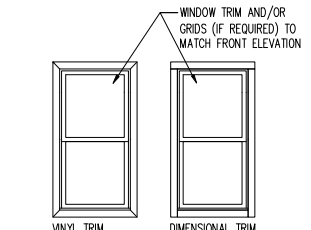


SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"




FRONT ELEVATION

SCALE: 1/4" = 1'-0"

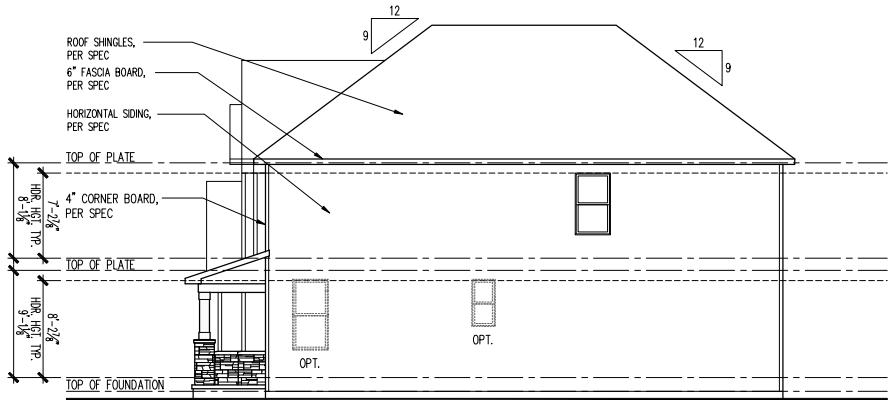


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

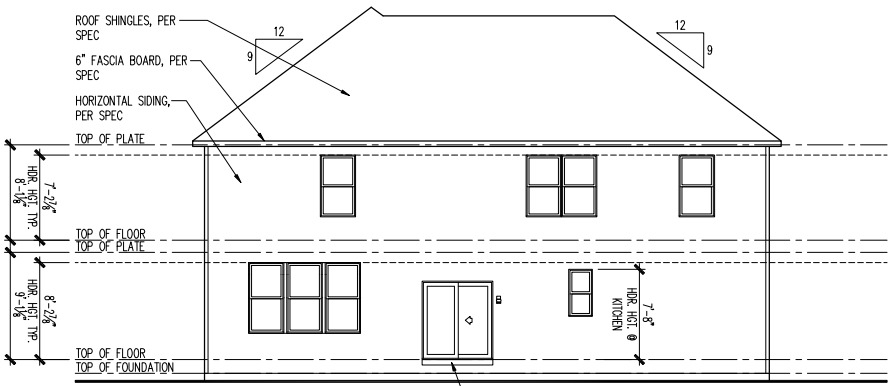

REAR ELEVATION

SCALE: 1/8" = 1'-0"

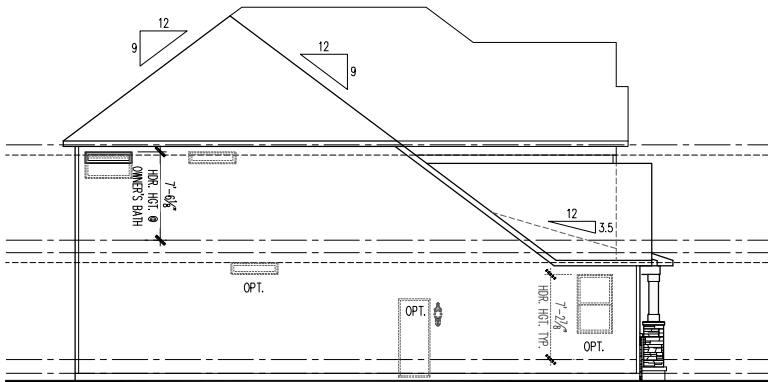

LEFT ELEVATION

SCALE: 1/8" = 1'-0"


PRODUCT MANAGER Rick Starkey	
INITIAL RELEASE	
DATE: 01/18/2019	
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PCR REVISIONS
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	

GARAGE HANDING
LEFT

SPECIFICATION LEVEL


PLAN NAME
WESTCHESTER
NPC CHILD NUMBER
1852.302

SHEET
A3-NC2G
2FB.1

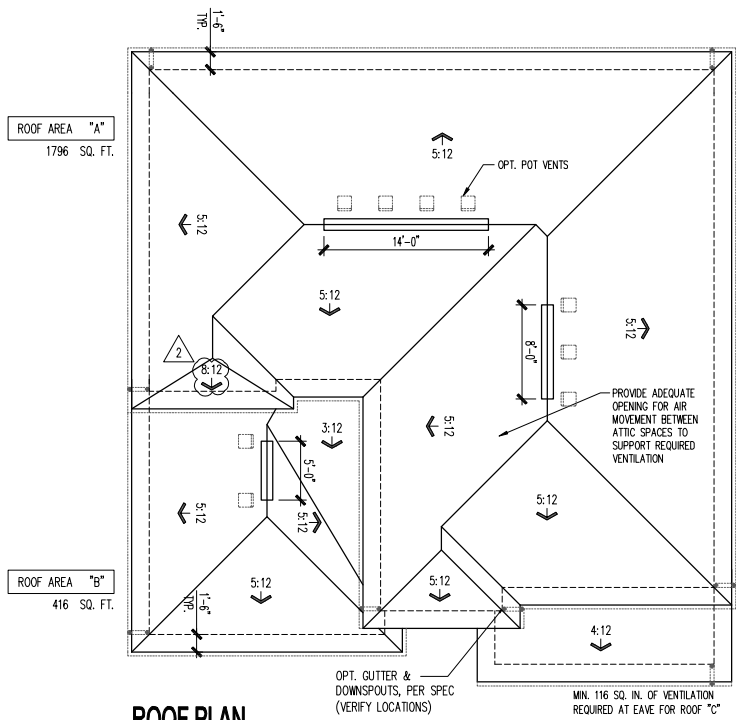


ROOF PLAN  
 SCALE: 1/8" = 1'-0"


ATTIC VENT SCHEDULE									
<small>           VENTILATION REQUIRED AND SUPPLIED IS BASED ON POF VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE.            **CORRELATION REQUIRED: VENTILATION AND REQUIRED FOR VENTING TWO VENT TYPES WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENT.            *PERCENTAGE HAS BEEN CALCULATED ASSUMING BOTH VENTILATION AT RIDGE OF TOTAL AND RIDGE AT GRADE OF TOTAL REQUIRED VENTILATION.         </small>									
Prairie 2M									
ROOF AREA "A"	SQ. FTG	1796	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POF LARGE (SQUARE FEET)	POF SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CORR. VENT (SQUARE FEET)	
HIGH-POF VENTS ONLY	2.39	2.39	0.97	48.00	7	0			
AT EAVE	2.39	2.39	0.10	0.00			0	48.00	
TOTAL	5.99	5.99	4.09	100.00					
HIGH-POF ROOF VENT	2.39	2.39	0.70	48.00	0	0	32.00		
AT EAVE	2.39	2.39	0.30	0.00			0	48.00	
TOTAL	5.99	5.99	6.00	100.00	ADDITIONAL POF VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				
ROOF AREA "B"	SQ. FTG	416	AT / NEAR RIDGE		AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POF LARGE (SQUARE FEET)	POF SMALL (SQUARE FEET)	RIDGE VENT (SQUARE FEET)	EAVE VENT (SQUARE FEET)	CORR. VENT (SQUARE FEET)	
HIGH-POF VENTS ONLY	0.80	0.80	0.80	84.00	2	0			
AT EAVE	0.80	0.80	0.20	0.00			0	10.00	
TOTAL	1.29	1.29	1.00	100.00					
HIGH-POF ROOF VENT	0.80	0.80	0.80	84.00	0	0	8.00		
AT EAVE	0.80	0.80	0.20	0.00			0	12.00	
TOTAL	1.29	1.29	1.00	100.00	ADDITIONAL POF VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				

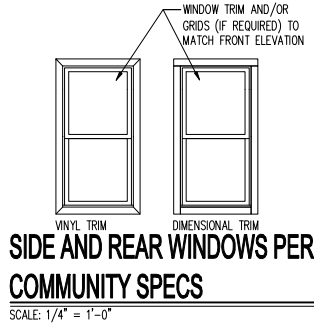


SIDE AND REAR WINDOWS PER  
 COMMUNITY SPECS  
 SCALE: 1/4" = 1'-0"

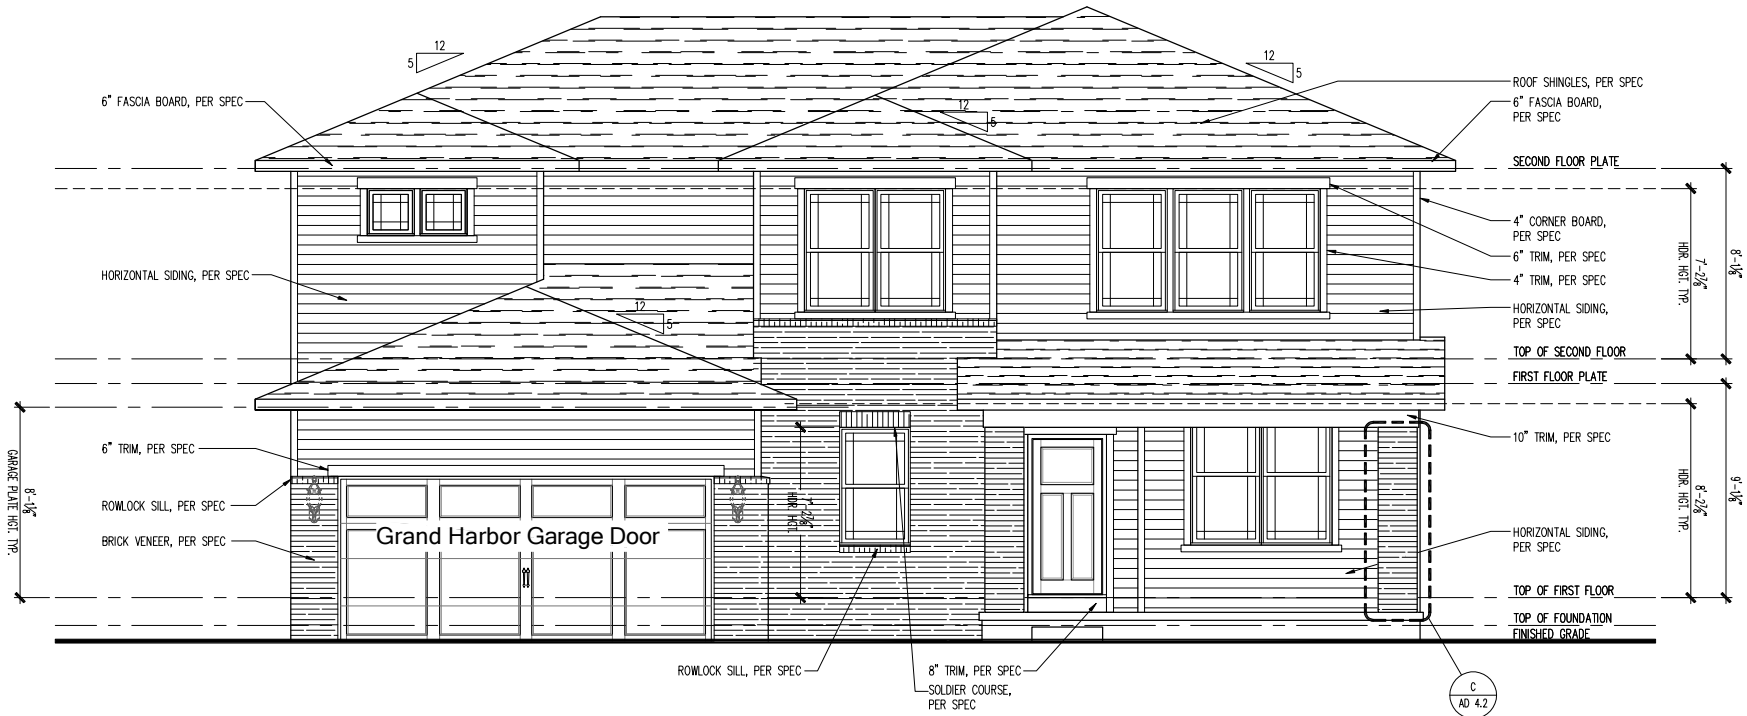


FRONT ELEVATION  
 SCALE: 1/4" = 1'-0"

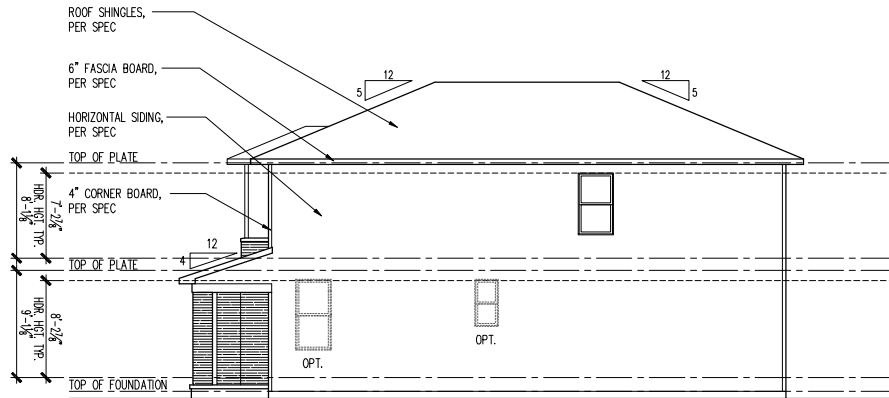

RIGHT ELEVATION  
 SCALE: 1/8" = 1'-0"

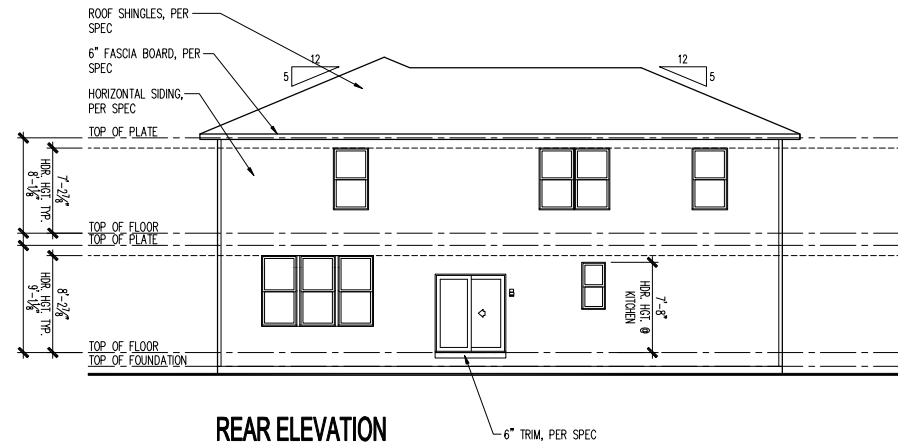

REAR ELEVATION  
 SCALE: 1/8" = 1'-0"

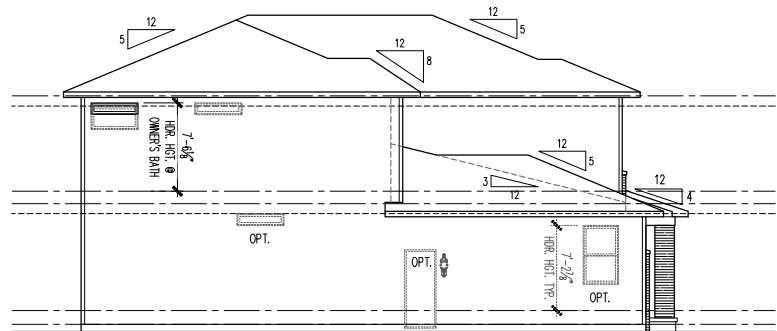

LEFT ELEVATION  
 SCALE: 1/8" = 1'-0"

PRODUCT MANAGER	Rick Starkey
INITIAL RELEASE	
DATE:	01/18/2019
REV#	DATE/DESCRIPTION
1	01/18/2019
2	PCR REVISIONS
3	11/27/2019
4	PCR REVISIONS
5	
6	
7	
8	
9	
10	